



Lead and Copper Compliance Report July through December 2015

Table 1 summarizes the District of Columbia Water and Sewer Authority’s (DC Water) Lead and Copper compliance results for the monitoring period July through December 2015.

Table 1. Lead and Copper Summary Data

Number of Samples	
Lead and Copper	110
90th Percentile First Draw Concentrations	
Lead mg/L	0.004
Copper mg/L	0.086
Service Line Materials	
Full Lead	77%
Partial Lead	23%

The appendices and attachments contain the following information and data:

- Appendix A: Lead and Copper Compliance Data
 - Table A.1 First Draw Lead Results
 - Table A.2 First Draw Copper Results

- Appendix B: Additional Monitoring Data
 - Table B.1 Second Draw Lead Results
 - Table B.2 Second Draw Copper Results

- Appendix C: Additional Sampling Information
 - Table C.1 Sample Kit Distribution
 - Table C.2 Sample Kits Not Returned
 - Table C.3 Samples Returned but Rejected for Compliance Analysis
 - Table C.4 Deviations from Sample Kit Distribution Order
 - Table C.5 Sites with Compliance Results from July 2014 – June 2015 and No Results in July – December 2015
 - Table C.6 Customer Notification of Results

- Appendix D: Sample Invalidation Request and EPA Response, dated January 8, 2016
- Attachment 1: Washington Aqueduct Test Results for 1st and 2nd Draw
- Attachment 2: Other Additional Monitoring Data:
 - Customer Requested Tests
 - Post-LSR
 - Lead profiles
 - Fountain and Sink Samples
 - Other Research
- Attachment 3: Certification of Consumer Tap Results for July through December 2015 and Customer Letters



Appendix A: Lead and Copper Compliance Data

Table A.1 First Draw Lead Results

No.	Address	Pipe Material	Collection Date	Lead 1st Draw (mg/L)
1	1119 C ST NE	Lead	11/18/2015	0.0000
2	1436 S St NW	Partial Lead	10/27/2015	0.0000
3	3036 P St NW	Partial Lead	10/28/2015	0.0000
4	36 Florida Ave NW	Partial Lead	10/28/2015	0.0000
5	414 G ST NE	Lead	8/27/2015	0.0000
6	423 GALLATIN ST NW	Lead	10/27/2015	0.0000
7	6213 7TH ST NW	Partial Lead	10/28/2015	0.0000
8	6409 7TH ST NW	Lead	11/17/2015	0.0000
9	744 9TH ST SE	Partial Lead	10/29/2015	0.0000
10	75 Bates St NW	Lead	9/29/2015	0.0000
11	413 4th St SE	Partial Lead	10/28/2015	0.0000
12	1613 Webster St NW	Lead	8/14/2015	0.0000
13	313 10TH ST SE	Partial Lead	10/27/2015	0.0000
14	3414 LOWELL ST NW	Partial Lead	11/23/2015	0.0000
15	3510 QUESADA ST NW	Lead	8/25/2015	0.0000
16	3722 MCKINLEY ST NW	Partial Lead	10/29/2015	0.0000
17	3838 BEECHER ST NW	Lead	10/30/2015	0.0000
18	1012 DOUGLAS ST NE	Lead	11/18/2015	0.0000
19	1706 NEW JERSEY AVE NW	Lead	7/29/2015	0.0000
20	2825 27TH ST NE	Lead	11/17/2015	0.0000
21	412 BRANDYWINE ST SE	Lead	8/25/2015	0.0000
22	4818 8th St NW	Partial Lead	10/26/2015	0.0000
23	1018 JACKSON ST NE	Lead	11/23/2015	0.0000
24	15 Milmarson PI NW	Lead	7/30/2015	0.0000
25	307 7th St NE	Lead	8/26/2015	0.0000
26	3907 13th St NW	Partial Lead	10/26/2015	0.0000
27	3920 5TH ST NW	Lead	11/19/2015	0.0000
28	1517 C ST SE	Lead	10/27/2015	0.0000
29	1635 WEBSTER ST NW	Lead	7/30/2015	0.0000
30	3405 HOLMEAD PL NW	Lead	8/26/2015	0.0000
31	3724 CHESAPEAKE ST NW	Lead	8/26/2015	0.0000
32	3809 ALTON PL NW	Partial Lead	10/29/2015	0.0000
33	4214 8th St NW	Lead	8/24/2015	0.0000
34	4425 14th St NE	Lead	9/30/2015	0.0000

No.	Address	Pipe Material	Collection Date	Lead 1st Draw (mg/L)
35	5600 NEBRASKA AVE NW	Lead	11/17/2015	0.0000
36	619 12th St NE	Lead	9/30/2015	0.0000
37	2408 2nd St NE	Partial Lead	10/28/2015	0.0000
38	3030 44TH ST NW	Partial Lead	10/27/2015	0.0000
39	313 5TH ST NE	Lead	8/27/2015	0.0000
40	4719 9TH ST NW	Lead	9/29/2015	0.0000
41	4810 KANSAS AVE NW	Lead	10/27/2015	0.0000
42	1353 JEFFERSON ST NW	Partial Lead	10/29/2015	0.0000
43	1420 INGRAHAM ST NW	Lead	7/29/2015	0.0000
44	1620 Webster St NW	Lead	7/29/2015	0.0000
45	1808 KEARNY ST NE	Partial Lead	10/28/2015	0.0000
46	231 K St NE	Partial Lead	10/29/2015	0.0000
47	4806 Kansas Ave NW	Lead	9/30/2015	0.0000
48	5923 33rd St NW	Lead	9/30/2015	0.0000
49	905 Kent Pl NE	Lead	9/29/2015	0.0000
50	1000 DOUGLAS ST NE	Lead	11/17/2015	0.0000
51	1412 S St NW	Partial Lead	10/27/2015	0.0000
52	1600 POTOMAC AVE SE	Lead	10/27/2015	0.0000
53	1632 T ST SE	Lead	11/18/2015	0.0000
54	3206 38th St NW	Lead	8/27/2015	0.0000
55	4215 39th St NW	Partial Lead	10/26/2015	0.0000
56	4811 Illinois Ave NW	Lead	10/1/2015	0.0000
57	4926 Glenbrook Rd NW	Lead	9/30/2015	0.0000
58	543 TENNESSEE AVE NE	Lead	10/29/2015	0.0000
59	905 WEBSTER ST NW	Lead	11/17/2015	0.0000
60	1222 HAMILTON ST NW	Partial Lead	10/29/2015	0.0010
61	3908 13TH ST NW	Lead	8/25/2015	0.0010
62	1505 CRITTENDEN ST NW	Lead	11/18/2015	0.0011
63	3710 Huntington St NW	Lead	8/26/2015	0.0011
64	14 CHANNING ST NW	Lead	11/18/2015	0.0012
65	2032 37TH ST NW	Lead	7/29/2015	0.0012
66	3301 BROWN St NW	Partial Lead	10/28/2015	0.0012
67	3625 Albemarle St NW	Lead	8/26/2015	0.0012
68	502 A ST SE	Lead	9/29/2015	0.0012
69	816 MADISON ST NW	Lead	9/30/2015	0.0012
70	1627 Gales St NE	Lead	7/28/2015	0.0014
71	1738 ALLISON ST NW	Lead	7/29/2015	0.0014
72	3636 13TH ST NW	Lead	8/25/2015	0.0014
73	421 Hamilton St NW	Lead	8/25/2015	0.0014
74	5223 KANSAS AVE NW	Lead	9/30/2015	0.0014
75	5328 41ST ST NW	Lead	11/17/2015	0.0014

No.	Address	Pipe Material	Collection Date	Lead 1st Draw (mg/L)
76	1211 Carrollsburg PI SW	Partial Lead	9/30/2015	0.0015
77	1428 VARNUM ST NW	Lead	7/29/2015	0.0015
78	1715 IRVING ST NE	Lead	7/28/2015	0.0016
79	12 14TH ST SE	Partial Lead	9/30/2015	0.0017
80	7755 16TH ST NW	Lead	11/18/2015	0.0017
81	119 16TH ST NE	Lead	7/29/2015	0.0018
82	5337 BROAD BRANCH RD NW	Lead	11/18/2015	0.0018
83	6308 8th St NW	Lead	10/1/2015	0.0018
84	6516 8TH ST NW	Lead	9/30/2015	0.0018
85	2804 6TH ST NE	Lead	8/25/2015	0.0019
86	1425 VARNUM ST NW	Lead	11/18/2015	0.0020
87	912 Emerson St NW	Lead	10/1/2015	0.0020
88	1346 F St NE	Lead	7/27/2015	0.0022
89	1410 ALLISON ST NW	Lead	8/3/2015	0.0022
90	3309 35TH ST NW	Lead	8/25/2015	0.0022
91	3211 Central Ave NE	Lead	8/26/2015	0.0023
92	450 Newton PI NW	Lead	10/4/2015	0.0023
93	1649 HARVARD ST NW	Lead	7/29/2015	0.0024
94	923 9TH ST NE	Lead	9/28/2015	0.0024
95	1519 Olive St NE	Lead	7/29/2015	0.0025
96	4413 IOWA AVE NW	Lead	11/18/2015	0.0025
97	3205 38TH ST NW	Lead	11/18/2015	0.0030
98	2435 33RD ST SE	Lead	8/25/2015	0.0035
99	5234 Illinois Ave NW	Lead	10/5/2015	0.0037
100	1529 27TH ST NW	Partial Lead	7/30/2015	0.0038
101	8 N St SW	Lead	9/30/2015	0.0038
102	1513 27TH ST NW	Partial Lead	7/28/2015	0.0039
103	4525 15TH ST NW	Lead	9/30/2015	0.0042
104	2719 O ST NW	Lead	8/27/2015	0.0054
105	1020 INDEPENDENCE AVE SE	Lead	7/27/2015	0.0060
106	125 Madison St NW	Lead	7/29/2015	0.0061
107	4703 Macarthur Blvd NW	Lead	9/30/2015	0.0065
108	314 VARNUM ST NW	Lead	8/27/2015	0.0066
109	702 9th St SE	Lead	9/30/2015	0.0085
110	5731 3rd PI NW	Lead	10/2/2015	1.269

Notes:

- 1) All addresses meet Tier 1 criteria under 40 CFR 141.86(a)(3)(ii) as single family structures with either full or partial lead service lines based on DC Water's customer information and service line inventory records.

- 2) Service line material listings are representative of the pipe material known at the time the sample was collected.
- 3) Results expressed as “0.0000” may have been reported by the laboratory as less than 0.001 mg/L or non-detect.

Table A.2 First Draw Copper Results

No.	Address	Pipe Material	Collection Date	Copper 1st Draw (mg/L)
1	1519 Olive St NE	Lead	7/29/2015	0.006
2	6213 7TH ST NW	Partial Lead	10/28/2015	0.006
3	912 Emerson St NW	Lead	10/1/2015	0.006
4	1600 POTOMAC AVE SE	Lead	10/27/2015	0.008
5	412 BRANDYWINE ST SE	Lead	8/25/2015	0.008
6	313 5TH ST NE	Lead	8/27/2015	0.009
7	1410 ALLISON ST NW	Lead	8/3/2015	0.010
8	1425 VARNUM ST NW	Lead	11/18/2015	0.010
9	6409 7TH ST NW	Lead	11/17/2015	0.010
10	816 MADISON ST NW	Lead	9/30/2015	0.010
11	4214 8th St NW	Lead	8/24/2015	0.011
12	1000 DOUGLAS ST NE	Lead	11/17/2015	0.012
13	1635 WEBSTER ST NW	Lead	7/30/2015	0.014
14	3205 38TH ST NW	Lead	11/18/2015	0.014
15	3301 BROWN St NW	Partial Lead	10/28/2015	0.014
16	314 VARNUM ST NW	Lead	8/27/2015	0.015
17	423 GALLATIN ST NW	Lead	10/27/2015	0.015
18	543 TENNESSEE AVE NE	Lead	10/29/2015	0.015
19	744 9TH ST SE	Partial Lead	10/29/2015	0.015
20	3710 Huntington St NW	Lead	8/26/2015	0.016
21	3920 5TH ST NW	Lead	11/19/2015	0.016
22	1119 C ST NE	Lead	11/18/2015	0.017
23	1346 F St NE	Lead	7/27/2015	0.017
24	1529 27TH ST NW	Partial Lead	7/30/2015	0.018
25	1632 T ST SE	Lead	11/18/2015	0.018
26	414 G ST NE	Lead	8/27/2015	0.018
27	1012 DOUGLAS ST NE	Lead	11/18/2015	0.019
28	1420 INGRAHAM ST NW	Lead	7/29/2015	0.020
29	3206 38th St NW	Lead	8/27/2015	0.020
30	5328 41ST ST NW	Lead	11/17/2015	0.020
31	905 Kent Pl NE	Lead	9/29/2015	0.020
32	75 Bates St NW	Lead	9/29/2015	0.021
33	125 Madison St NW	Lead	7/29/2015	0.022
34	4818 8th ST NW	Partial Lead	10/26/2015	0.022
35	3030 44TH ST NW	Partial Lead	10/27/2015	0.023
36	5234 Illinois Ave NW	Lead	10/5/2015	0.023
37	413 4th St SE	Partial Lead	10/28/2015	0.024
38	12 14TH ST SE	Partial Lead	9/30/2015	0.025
39	3636 13TH ST NW	Lead	8/25/2015	0.025
40	450 Newton Pl NW	Lead	10/4/2015	0.025

No.	Address	Pipe Material	Collection Date	Copper 1st Draw (mg/L)
41	619 12th St NE	Lead	9/30/2015	0.025
42	1706 NEW JERSEY AVE NW	Lead	7/29/2015	0.026
43	1620 Webster St NW	Lead	7/29/2015	0.027
44	1715 IRVING ST NE	Lead	7/28/2015	0.027
45	6516 8TH ST NW	Lead	9/30/2015	0.027
46	1020 INDEPENDENCE AVE SE	Lead	7/27/2015	0.028
47	3809 ALTON PL NW	Partial Lead	10/29/2015	0.028
48	2408 2nd St NE	Partial Lead	10/28/2015	0.029
49	4719 9TH ST NW	Lead	9/29/2015	0.030
50	1222 HAMILTON ST NW	Partial Lead	10/29/2015	0.031
51	7755 16TH ST NW	Lead	11/18/2015	0.031
52	3405 HOLMEAD PL NW	Lead	8/26/2015	0.033
53	4926 Glenbrook Rd NW	Lead	9/30/2015	0.033
54	1428 VARNUM ST NW	Lead	7/29/2015	0.034
55	1649 HARVARD ST NW	Lead	7/29/2015	0.035
56	3510 QUESADA ST NW	Lead	8/25/2015	0.036
57	702 9th St SE	Lead	9/30/2015	0.036
58	1513 27TH ST NW	Partial Lead	7/28/2015	0.037
59	2804 6TH ST NE	Lead	8/25/2015	0.037
60	313 10TH ST SE	Partial Lead	10/27/2015	0.037
61	3625 Albemarle St NW	Lead	8/26/2015	0.039
62	4525 15TH ST NW	Lead	9/30/2015	0.039
63	2719 O ST NW	Lead	8/27/2015	0.040
64	307 7th St NE	Lead	8/26/2015	0.040
65	2435 33RD ST SE	Lead	8/25/2015	0.041
66	1627 Gales St NE	Lead	7/28/2015	0.042
67	1353 JEFFERSON ST NW	Partial Lead	10/29/2015	0.043
68	421 Hamilton St NW	Lead	8/25/2015	0.045
69	2825 27TH ST NE	Lead	11/17/2015	0.048
70	6308 8th St NW	Lead	10/1/2015	0.049
71	1808 KEARNY ST NE	Partial Lead	10/28/2015	0.050
72	4425 14th St NE	Lead	9/30/2015	0.050
73	119 16TH ST NE	Lead	7/29/2015	0.052
74	3036 P St NW	Partial Lead	10/28/2015	0.052
75	3724 CHESAPEAKE ST NW	Lead	8/26/2015	0.052
76	1738 ALLISON ST NW	Lead	7/29/2015	0.053
77	502 A ST SE	Lead	9/29/2015	0.053
78	4215 39th St NW	Partial Lead	10/26/2015	0.054
79	3908 13TH ST NW	Lead	8/25/2015	0.056
80	3211 Central Ave NE	Lead	8/26/2015	0.057
81	3309 35TH ST NW	Lead	8/25/2015	0.059

No.	Address	Pipe Material	Collection Date	Copper 1st Draw (mg/L)
82	4810 KANSAS AVE NW	Lead	10/27/2015	0.060
83	5337 BROAD BRANCH RD NW	Lead	11/18/2015	0.063
84	8 N St SW	Lead	9/30/2015	0.065
85	1613 Webster St NW	Lead	8/14/2015	0.066
86	2032 37TH ST NW	Lead	7/29/2015	0.067
87	5600 NEBRASKA AVE NW	Lead	11/17/2015	0.068
88	1018 JACKSON ST NE	Lead	11/23/2015	0.069
89	923 9TH ST NE	Lead	9/28/2015	0.070
90	15 Milmarson Pl NW	Lead	7/30/2015	0.072
91	14 CHANNING ST NW	Lead	11/18/2015	0.074
92	4413 IOWA AVE NW	Lead	11/18/2015	0.074
93	5223 KANSAS AVE NW	Lead	9/30/2015	0.075
94	1505 CRITTENDEN ST NW	Lead	11/18/2015	0.079
95	4811 Illinois Ave NW	Lead	10/1/2015	0.079
96	3722 MCKINLEY ST NW	Partial Lead	10/29/2015	0.080
97	231 K St NE	Partial Lead	10/29/2015	0.081
98	1412 S St NW	Partial Lead	10/27/2015	0.083
99	1211 Carrollsburg Pl SW	Partial Lead	9/30/2015	0.086
100	1517 C St SE	Lead	10/27/2015	0.086
101	3838 BEECHER ST NW	Lead	10/30/2015	0.102
102	5923 33rd St NW	Lead	9/30/2015	0.109
103	3907 13th St NW	Partial Lead	10/26/2015	0.111
104	4703 Macarthur Blvd NW	Lead	9/30/2015	0.136
105	4806 Kansas Ave NW	Lead	9/30/2015	0.136
106	36 Florida Ave NW	Partial Lead	10/28/2015	0.142
107	5731 3rd Pl NW	Lead	10/2/2015	0.147
108	905 WEBSTER ST NW	Lead	11/17/2015	0.160
109	1436 S St NW	Partial Lead	10/27/2015	0.164
110	3414 LOWELL ST NW	Partial Lead	11/23/2015	0.171

Notes:

- 1) All addresses meet Tier 1 criteria under 40 CFR 141.86(a)(3)(ii) as single family structures with either full or partial lead service lines based on DC Water's customer information and service line inventory records.
- 2) Service line material listings are representative of the pipe material known at the time the sample was collected.

Appendix B: Additional Monitoring Data

Tables B.1 and B.2 present results from the second draw samples collected at the time of the Lead and Copper Rule compliance sampling. Additional monitoring data presented in Attachment 2 to this report contains sample data collected from other DC Water programs that focused on lead, copper, or other metals that included lead sample results. A description of the program followed by the data set is included in Attachment 2.

Table B.1 Second Draw Lead Results

No.	Address	Pipe Material	Collection Date	Lead 2nd Draw (mg/L)
1	1119 C ST NE	Lead	11/18/2015	0.0000
2	1436 S St NW	Partial Lead	10/27/2015	0.0000
3	3036 P St NW	Partial Lead	10/28/2015	0.0000
4	36 Florida Ave NW	Partial Lead	10/28/2015	0.0000
5	3722 MCKINLEY ST NW	Partial Lead	10/29/2015	0.0000
6	3838 BEECHER ST NW	Lead	10/30/2015	0.0000
7	413 4th St SE	Partial Lead	10/28/2015	0.0000
8	414 G ST NE	Lead	8/27/2015	0.0000
9	4926 Glenbrook Rd NW	Lead	9/30/2015	0.0000
10	619 12th St NE	Lead	9/30/2015	0.0000
11	6213 7TH ST NW	Partial Lead	10/28/2015	0.0000
12	6409 7TH ST NW	Lead	11/17/2015	0.0000
13	744 9TH ST SE	Partial Lead	10/29/2015	0.0000
14	75 Bates St NW	Lead	9/29/2015	0.0000
15	7755 16TH ST NW	Lead	11/18/2015	0.0000
16	3724 CHESAPEAKE ST NW	Lead	8/26/2015	0.0000
17	12 14TH ST SE	Partial Lead	9/30/2015	0.0000
18	1613 Webster St NW	Lead	8/14/2015	0.0000
19	313 10TH ST SE	Partial Lead	10/27/2015	0.0000
20	3510 QUESADA ST NW	Lead	8/25/2015	0.0000
21	3920 5TH ST NW	Lead	11/19/2015	0.0000
22	423 GALLATIN ST NW	Lead	10/27/2015	0.0000
23	905 Kent PI NE	Lead	9/29/2015	0.0000
24	1412 S St NW	Partial Lead	10/27/2015	0.0000
25	1808 KEARNY ST NE	Partial Lead	10/28/2015	0.0000
26	3907 13th St NW	Partial Lead	10/26/2015	0.0000
27	5223 KANSAS AVE NW	Lead	9/30/2015	0.0000
28	1012 DOUGLAS ST NE	Lead	11/18/2015	0.0000
29	1018 JACKSON ST NE	Lead	11/23/2015	0.0000
30	1222 HAMILTON ST NW	Partial Lead	10/29/2015	0.0000
31	1353 JEFFERSON ST NW	Partial Lead	10/29/2015	0.0000
32	4214 8th St NW	Lead	8/24/2015	0.0000
33	4810 KANSAS AVE NW	Lead	10/27/2015	0.0000

No.	Address	Pipe Material	Collection Date	Lead 2nd Draw (mg/L)
34	4818 8th ST NW	Partial Lead	10/26/2015	0.0000
35	3030 44TH ST NW	Partial Lead	10/27/2015	0.0000
36	3405 HOLMEAD PL NW	Lead	8/26/2015	0.0000
37	4425 14th St NE	Lead	9/30/2015	0.0000
38	905 WEBSTER ST NW	Lead	11/17/2015	0.0000
39	3908 13TH ST NW	Lead	8/25/2015	0.0000
40	1632 T ST SE	Lead	11/18/2015	0.0000
41	307 7th St NE	Lead	8/26/2015	0.0000
42	543 TENNESSEE AVE NE	Lead	10/29/2015	0.0000
43	1600 POTOMAC AVE SE	Lead	10/27/2015	0.0000
44	231 K St NE	Partial Lead	10/29/2015	0.0000
45	3414 LOWELL ST NW	Partial Lead	11/23/2015	0.0000
46	816 MADISON ST NW	Lead	9/30/2015	0.0000
47	1620 Webster St NW	Lead	7/29/2015	0.0011
48	3301 BROWN St NW	Partial Lead	10/28/2015	0.0011
49	4215 39th St NW	Partial Lead	10/26/2015	0.0011
50	4806 Kansas Ave NW	Lead	9/30/2015	0.0011
51	14 CHANNING ST NW	Lead	11/18/2015	0.0012
52	1715 IRVING ST NE	Lead	7/28/2015	0.0012
53	3206 38th St NW	Lead	8/27/2015	0.0013
54	3625 Albemarle St NW	Lead	8/26/2015	0.0013
55	4413 IOWA AVE NW	Lead	11/18/2015	0.0013
56	1410 ALLISON ST NW	Lead	8/3/2015	0.0014
57	15 Milmarson PI NW	Lead	7/30/2015	0.0014
58	5337 BROAD BRANCH RD NW	Lead	11/18/2015	0.0014
59	3809 ALTON PL NW	Partial Lead	10/29/2015	0.0015
60	6308 8th St NW	Lead	10/1/2015	0.0015
61	923 9TH ST NE	Lead	9/28/2015	0.0016
62	125 Madison St NW	Lead	7/29/2015	0.0017
63	1428 VARNUM ST NW	Lead	7/29/2015	0.0018
64	1649 HARVARD ST NW	Lead	7/29/2015	0.0018
65	1738 ALLISON ST NW	Lead	7/29/2015	0.0018
66	502 A ST SE	Lead	9/29/2015	0.0018
67	5328 41ST ST NW	Lead	11/17/2015	0.0018
68	119 16TH ST NE	Lead	7/29/2015	0.0021
69	1425 VARNUM ST NW	Lead	11/18/2015	0.0023
70	1635 WEBSTER ST NW	Lead	7/30/2015	0.0023
71	5600 NEBRASKA AVE NW	Lead	11/17/2015	0.0024
72	1706 NEW JERSEY AVE NW	Lead	7/29/2015	0.0025
73	2825 27TH ST NE	Lead	11/17/2015	0.0025
74	3710 Huntington St NW	Lead	8/26/2015	0.0026

No.	Address	Pipe Material	Collection Date	Lead 2nd Draw (mg/L)
75	4811 Illinois Ave NW	Lead	10/1/2015	0.0027
76	3309 35TH ST NW	Lead	8/25/2015	0.0029
77	1529 27TH ST NW	Partial Lead	7/30/2015	0.0030
78	3636 13TH ST NW	Lead	8/25/2015	0.0031
79	5923 33rd St NW	Lead	9/30/2015	0.0031
80	8 N St SW	Lead	9/30/2015	0.0039
81	1627 Gales St NE	Lead	7/28/2015	0.0040
82	2719 O ST NW	Lead	8/27/2015	0.0040
83	5234 Illinois Ave NW	Lead	10/5/2015	0.0041
84	3205 38TH ST NW	Lead	11/18/2015	0.0042
85	4525 15TH ST NW	Lead	9/30/2015	0.0043
86	1519 Olive St NE	Lead	7/29/2015	0.0048
87	6516 8TH ST NW	Lead	9/30/2015	0.0051
88	4703 Macarthur Blvd NW	Lead	9/30/2015	0.0052
89	1000 DOUGLAS ST NE	Lead	11/17/2015	0.0053
90	450 Newton Pl NW	Lead	10/4/2015	0.0055
91	2032 37TH ST NW	Lead	7/29/2015	0.0056
92	912 Emerson St NW	Lead	10/1/2015	0.0061
93	4719 9TH ST NW	Lead	9/29/2015	0.0062
94	1346 F St NE	Lead	7/27/2015	0.0068
95	1020 INDEPENDENCE AVE SE	Lead	7/27/2015	0.0070
96	2408 2nd St NE	Partial Lead	10/28/2015	0.0071
97	421 Hamilton St NW	Lead	8/25/2015	0.0079
98	1211 Carrollsburg Pl SW	Partial Lead	9/30/2015	0.0086
99	5731 3rd Pl NW	Lead	10/2/2015	0.0087
100	3211 Central Ave NE	Lead	8/26/2015	0.0101
101	1513 27TH ST NW	Partial Lead	7/28/2015	0.0102
102	314 VARNUM ST NW	Lead	8/27/2015	0.0102
103	313 5TH ST NE	Lead	8/27/2015	0.0153
104	702 9th St SE	Lead	9/30/2015	0.0164

Notes:

- 1) Service line material listings are representative of the pipe material at the time the sample was collected.
- 2) Results expressed as “0.0000” may have been reported by the laboratory as less than 0.001 mg/L or non-detect.
- 3) The second draw samples were rejected due to sampling errors:
 - 1420 INGRAHAM ST NW
 - 2435 33RD ST SE
 - 412 BRANDYWINE ST SE
 - 2804 6TH ST NE
 - 1505 CRITTENDEN ST NW
 - 1517 C ST SE

Table B.2 Second Draw Copper Results

No.	Address	Pipe Material	Collection Date	Copper 2 nd Draw (mg/L)
1	314 VARNUM ST NW	Lead	8/27/2015	0.005
2	3206 38th St NW	Lead	8/27/2015	0.005
3	3625 Albemarle St NW	Lead	8/26/2015	0.005
4	125 Madison St NW	Lead	7/29/2015	0.006
5	1620 Webster St NW	Lead	7/29/2015	0.006
6	3510 QUESADA ST NW	Lead	8/25/2015	0.006
7	6213 7TH ST NW	Partial Lead	10/28/2015	0.006
8	816 MADISON ST NW	Lead	9/30/2015	0.006
9	912 Emerson St NW	Lead	10/1/2015	0.006
10	1346 F St NE	Lead	7/27/2015	0.007
11	2032 37TH ST NW	Lead	7/29/2015	0.007
12	3036 P St NW	Partial Lead	10/28/2015	0.007
13	3309 35TH ST NW	Lead	8/25/2015	0.007
14	4214 8th St NW	Lead	8/24/2015	0.007
15	6516 8TH ST NW	Lead	9/30/2015	0.007
16	1020 INDEPENDENCE AVE SE	Lead	7/27/2015	0.008
17	1513 27TH ST NW	Partial Lead	7/28/2015	0.008
18	1519 Olive St NE	Lead	7/29/2015	0.008
19	1600 POTOMAC AVE SE	Lead	10/27/2015	0.008
20	3205 38TH ST NW	Lead	11/18/2015	0.008
21	3710 Huntington St NW	Lead	8/26/2015	0.008
22	3920 5TH ST NW	Lead	11/19/2015	0.008
23	744 9TH ST SE	Partial Lead	10/29/2015	0.008
24	3211 Central Ave NE	Lead	8/26/2015	0.009
25	5731 3rd Pl NW	Lead	10/2/2015	0.009
26	6409 7TH ST NW	Lead	11/17/2015	0.009
27	702 9th St SE	Lead	9/30/2015	0.009
28	7755 16TH ST NW	Lead	11/18/2015	0.009
29	119 16TH ST NE	Lead	7/29/2015	0.010
30	1425 VARNUM ST NW	Lead	11/18/2015	0.010
31	1635 WEBSTER ST NW	Lead	7/30/2015	0.010
32	1706 NEW JERSEY AVE NW	Lead	7/29/2015	0.010
33	414 G ST NE	Lead	8/27/2015	0.010
34	4818 8th ST NW	Partial Lead	10/26/2015	0.010
35	5328 41ST ST NW	Lead	11/17/2015	0.010
36	1632 T ST SE	Lead	11/18/2015	0.011
37	307 7th St NE	Lead	8/26/2015	0.011
38	3405 HOLMEAD PL NW	Lead	8/26/2015	0.012
39	413 4th St SE	Partial Lead	10/28/2015	0.012
40	905 Kent Pl NE	Lead	9/29/2015	0.012

No.	Address	Pipe Material	Collection Date	Copper 2 nd Draw (mg/L)
41	1119 C ST NE	Lead	11/18/2015	0.013
42	313 10TH ST SE	Partial Lead	10/27/2015	0.013
43	3636 13TH ST NW	Lead	8/25/2015	0.013
44	450 Newton Pl NW	Lead	10/4/2015	0.013
45	4703 Macarthur Blvd NW	Lead	9/30/2015	0.013
46	5223 KANSAS AVE NW	Lead	9/30/2015	0.013
47	543 TENNESSEE AVE NE	Lead	10/29/2015	0.013
48	1627 Gales St NE	Lead	7/28/2015	0.014
49	3301 BROWN St NW	Partial Lead	10/28/2015	0.014
50	5923 33rd St NW	Lead	9/30/2015	0.015
51	1529 27TH ST NW	Partial Lead	7/30/2015	0.016
52	1000 DOUGLAS ST NE	Lead	11/17/2015	0.017
53	1012 DOUGLAS ST NE	Lead	11/18/2015	0.017
54	1738 ALLISON ST NW	Lead	7/29/2015	0.018
55	3809 ALTON PL NW	Partial Lead	10/29/2015	0.018
56	2825 27TH ST NE	Lead	11/17/2015	0.019
57	3722 MCKINLEY ST NW	Partial Lead	10/29/2015	0.019
58	5234 Illinois Ave NW	Lead	10/5/2015	0.019
59	421 Hamilton St NW	Lead	8/25/2015	0.020
60	4215 39th St NW	Partial Lead	10/26/2015	0.020
61	1018 JACKSON ST NE	Lead	11/23/2015	0.022
62	1715 IRVING ST NE	Lead	7/28/2015	0.022
63	36 Florida Ave NW	Partial Lead	10/28/2015	0.022
64	4719 9TH ST NW	Lead	9/29/2015	0.022
65	1649 HARVARD ST NW	Lead	7/29/2015	0.023
66	313 5TH ST NE	Lead	8/27/2015	0.023
67	3414 LOWELL ST NW	Partial Lead	11/23/2015	0.023
68	4810 KANSAS AVE NW	Lead	10/27/2015	0.023
69	1410 ALLISON ST NW	Lead	8/3/2015	0.024
70	14 CHANNING ST NW	Lead	11/18/2015	0.025
71	1436 S St NW	Partial Lead	10/27/2015	0.025
72	5600 NEBRASKA AVE NW	Lead	11/17/2015	0.025
73	619 12th St NE	Lead	9/30/2015	0.025
74	2408 2nd St NE	Partial Lead	10/28/2015	0.026
75	1428 VARNUM ST NW	Lead	7/29/2015	0.027
76	502 A ST SE	Lead	9/29/2015	0.028
77	4425 14th St NE	Lead	9/30/2015	0.029
78	1613 Webster St NW	Lead	8/14/2015	0.030
79	12 14TH ST SE	Partial Lead	9/30/2015	0.032
80	1222 HAMILTON ST NW	Partial Lead	10/29/2015	0.032
81	1353 JEFFERSON ST NW	Partial Lead	10/29/2015	0.032

No.	Address	Pipe Material	Collection Date	Copper 2 nd Draw (mg/L)
82	1808 KEARNY ST NE	Partial Lead	10/28/2015	0.032
83	423 GALLATIN ST NW	Lead	10/27/2015	0.032
84	4525 15TH ST NW	Lead	9/30/2015	0.033
85	4926 Glenbrook Rd NW	Lead	9/30/2015	0.034
86	2719 O ST NW	Lead	8/27/2015	0.036
87	15 Milmarson Pl NW	Lead	7/30/2015	0.038
88	4811 Illinois Ave NW	Lead	10/1/2015	0.043
89	6308 8th St NW	Lead	10/1/2015	0.045
90	1211 Carrollsburg Pl SW	Partial Lead	9/30/2015	0.047
91	3908 13TH ST NW	Lead	8/25/2015	0.047
92	5337 BROAD BRANCH RD NW	Lead	11/18/2015	0.048
93	8 N St SW	Lead	9/30/2015	0.048
94	3724 CHESAPEAKE ST NW	Lead	8/26/2015	0.050
95	3838 BEECHER ST NW	Lead	10/30/2015	0.050
96	3030 44TH ST NW	Partial Lead	10/27/2015	0.053
97	905 WEBSTER ST NW	Lead	11/17/2015	0.062
98	231 K St NE	Partial Lead	10/29/2015	0.064
99	75 Bates St NW	Lead	9/29/2015	0.069
100	923 9TH ST NE	Lead	9/28/2015	0.082
101	3907 13th St NW	Partial Lead	10/26/2015	0.088
102	4806 Kansas Ave NW	Lead	9/30/2015	0.107
103	1412 S St NW	Partial Lead	10/27/2015	0.152
104	4413 IOWA AVE NW	Lead	11/18/2015	0.188

Notes:

- 1) Service line material listings are representative of the pipe material at the time the sample was collected.
- 2) Results expressed as “0.000” may have been reported by the laboratory as less than 0.001 mg/L or non-detect.
- 3) The second draw samples were rejected due to sampling errors:
 - 1420 INGRAHAM ST NW
 - 2435 33RD ST SE
 - 412 BRANDYWINE ST SE
 - 2804 6TH ST NE
 - 1505 CRITTENDEN ST NW
 - 1517 C ST SE

Appendix C – Additional Sampling Information

Table C.1 Sample Kit Distribution

No	Address	Bottle Drop Off Date
1	10 S St NW	7/27/2015
2	1003 Otis St NE	7/27/2015
3	1003 Quebec Pl NW	7/27/2015
4	1010 10th St NE	7/27/2015
5	1011 Taylor St NE	7/27/2015
6	1020 INDEPENDENCE AVE SE	7/27/2015
7	109 19th St SE	7/27/2015
8	1113 STAPLES ST NE	7/27/2015
9	119 16TH ST NE	7/27/2015
10	123 TENNESSEE AVE NE	7/27/2015
11	125 Madison St NW	7/27/2015
12	1262 COLUMBIA RD NW	7/27/2015
13	1305 TAYLOR ST NW	7/27/2015
14	1315 FRANKLIN ST NE	7/27/2015
15	1331 Irving St NE	7/27/2015
16	1339 CHILDRESS ST NE	7/27/2015
17	1346 F St NE	7/27/2015
18	1357 C St NE	7/27/2015
19	1375 MONROE ST NW	7/27/2015
20	1410 ALLISON ST NW	7/27/2015
21	1420 INGRAHAM ST NW	7/27/2015
22	1424 S ST NW	7/27/2015
23	1428 VARNUM ST NW	7/27/2015
24	1453 S St NW	7/27/2015
25	15 MADISON ST NW	7/27/2015
26	15 Milmarson Pl NW	7/27/2015
27	1505 Buchanan St NW	7/27/2015
28	1508 GOOD HOPE RD SE	7/27/2015
29	1513 27TH ST NW	7/27/2015
30	1519 Olive St NE	7/27/2015
31	1529 27TH ST NW	7/27/2015
32	1529 UPSHUR ST NW	7/27/2015
33	1613 Webster St NW	7/27/2015
34	1620 Webster St NW	7/27/2015
35	1627 Gales St NE	7/27/2015
36	1635 WEBSTER ST NW	7/27/2015
37	1649 HARVARD ST NW	7/27/2015

No	Address	Bottle Drop Off Date
38	1659 NEWTON ST NW	7/27/2015
39	1703 D St NE	7/27/2015
40	1705 D St NE	7/27/2015
41	1706 NEW JERSEY AVE NW	7/27/2015
42	1715 IRVING ST NE	7/27/2015
43	1738 ALLISON ST NW	7/27/2015
44	1826 Jackson St NE	7/27/2015
45	1831 MONROE ST NE	7/27/2015
46	1911 P ST SE	7/27/2015
47	1916 PARK RD NW	7/27/2015
48	2007 37TH ST NW	7/27/2015
49	2032 37TH ST NW	7/27/2015
50	2036 17TH ST NW	7/27/2015
51	2107 2nd St NE	8/24/2015
52	2121 3RD ST NE	8/24/2015
53	2212 38th St NW	8/24/2015
54	228 V ST NE	8/24/2015
55	2435 33RD ST SE	8/24/2015
56	2719 O ST NW	8/24/2015
57	2804 6TH ST NE	8/24/2015
58	2830 BRENTWOOD RD NE	8/24/2015
59	2832 BRENTWOOD RD NE	8/24/2015
60	2904 P ST SE	8/24/2015
61	2913 Brandywine St NW	8/24/2015
62	2923 Cathedral AVE NW	8/24/2015
63	3033 CAMBRIDGE PL NW	8/24/2015
64	307 7th St NE	8/24/2015
65	309 11TH ST SE	8/24/2015
66	313 5TH ST NE	8/24/2015
67	314 VARNUM ST NW	8/24/2015
68	3206 38th St NW	8/24/2015
69	3211 Central Ave NE	8/24/2015
70	3218 MACOMB ST NW	8/24/2015
71	3218 MORRISON ST NW	8/24/2015
72	322 TENNESSEE AVE NE	8/24/2015
73	3309 35TH ST NW	8/24/2015
74	336 Quackenbos St NE	8/24/2015
75	3405 HOLMEAD PL NW	8/24/2015
76	3510 QUESADA ST NW	8/24/2015
77	3621 Van Ness St NW	8/24/2015
78	3625 Albemarle St NW	8/24/2015

No	Address	Bottle Drop Off Date
79	3636 13TH ST NW	8/24/2015
80	37 U ST NE	8/24/2015
81	3706 35th St NW	8/24/2015
82	3710 Huntington St NW	8/24/2015
83	3724 CHESAPEAKE ST NW	8/24/2015
84	3727 T St NW	8/24/2015
85	3761 W ST NW	8/24/2015
86	3908 13TH ST NW	8/24/2015
87	3916 5TH ST NW	8/24/2015
88	4002 ILLINOIS AVE NW	8/24/2015
89	4014 Grant St NE	8/24/2015
90	412 BRANDYWINE ST SE	8/24/2015
91	4120 Grant St NE	8/24/2015
92	4131 YUMA ST NW	8/24/2015
93	414 G ST NE	8/24/2015
94	421 Hamilton St NW	8/24/2015
95	4214 8th St NW	8/24/2015
96	4233 JENIFER ST NW	8/24/2015
97	424 Luray Pl NW	8/24/2015
98	4408 HAYES ST NE	8/24/2015
99	4409 Lowell St NW	8/24/2015
100	4413 5th St NW	8/24/2015
101	12 14TH ST SE	9/28/2015
102	1211 Carrollsburg Pl SW	9/28/2015
103	4418 14th St NE	9/28/2015
104	4425 14th St NE	9/28/2015
105	449 S St NW	9/28/2015
106	450 Newton Pl NW	9/28/2015
107	4525 15TH ST NW	9/28/2015
108	4550 30TH ST NW	9/28/2015
109	4610 KANSAS AVE NW	9/28/2015
110	4627 49th St NW	9/28/2015
111	4703 Macarthur Blvd NW	9/28/2015
112	4719 9TH ST NW	9/28/2015
113	4806 Kansas Ave NW	9/28/2015
114	4811 Illinois Ave NW	9/28/2015
115	4921 30th Pl NW	9/28/2015
116	4926 Glenbrook Rd NW	9/28/2015
117	5007 13TH ST NW	9/28/2015
118	502 A ST SE	9/28/2015
119	5024 7th St NW	9/28/2015

No	Address	Bottle Drop Off Date
120	522 4TH ST SE	9/28/2015
121	5223 KANSAS AVE NW	9/28/2015
122	5234 Illinois Ave NW	9/28/2015
123	531 Tennessee Ave NE	9/28/2015
124	5312 ILLINOIS AVE NW	9/28/2015
125	5318 9TH ST NW	9/28/2015
126	5731 3rd PI NW	9/28/2015
127	5923 33rd St NW	9/28/2015
128	609 49TH PL NE	9/28/2015
129	6105 Dix St NE	9/28/2015
130	619 12th St NE	9/28/2015
131	620 44TH ST NE	9/28/2015
132	6205 14TH ST NW	9/28/2015
133	6308 8th St NW	9/28/2015
134	636 ROCK CRK CHURCH RD NW	9/28/2015
135	6516 8TH ST NW	9/28/2015
136	702 9th St SE	9/28/2015
137	714 4th St NE	9/28/2015
138	75 Bates St NW	9/28/2015
139	8 N St SW	9/28/2015
140	804 Delafield PI NW	9/28/2015
141	807 Buchanan St NW	9/28/2015
142	816 MADISON ST NW	9/28/2015
143	87 S St NW	9/28/2015
144	905 Kent PI NE	9/28/2015
145	912 Emerson St NW	9/28/2015
146	923 9TH ST NE	9/28/2015
147	926 Hamilton St NW	9/28/2015
148	1222 HAMILTON ST NW	10/26/2015
149	1319 POTOMAC AVE SE	10/26/2015
150	1353 JEFFERSON ST NW	10/26/2015
151	1412 S St NW	10/26/2015
152	1420 Hamlin St NE	10/26/2015
153	1421 TAYLOR ST NW	10/26/2015
154	1436 S St NW	10/26/2015
155	1465 GIRARD ST NW	10/26/2015
156	1517 C ST SE	10/26/2015
157	1600 POTOMAC AVE SE	10/26/2015
158	1671 Rosedale St NE	10/26/2015
159	1736 Bay St SE	10/26/2015
160	1808 KEARNY ST NE	10/26/2015

No	Address	Bottle Drop Off Date
161	1850 2ND ST NW	10/26/2015
162	223 14th PI NE	10/26/2015
163	231 K St NE	10/26/2015
164	2408 2nd St NE	10/26/2015
165	303 V ST NE	10/26/2015
166	3030 44TH ST NW	10/26/2015
167	3036 P St NW	10/26/2015
168	308 9th St SE	10/26/2015
169	313 10TH ST SE	10/26/2015
170	317 9th St SE	10/26/2015
171	3202 38TH ST NW	10/26/2015
172	3301 BROWN St NW	10/26/2015
173	333 34th St NE	10/26/2015
174	3414 LOWELL ST NW	10/26/2015
175	3416 9th St NE	10/26/2015
176	36 Florida Ave NW	10/26/2015
177	3722 MCKINLEY ST NW	10/26/2015
178	3809 ALTON PL NW	10/26/2015
179	3838 BEECHER ST NW	10/26/2015
180	3907 13th St NW	10/26/2015
181	3913 8TH ST NW	10/26/2015
182	3917 8th St NW	10/26/2015
183	413 4th St SE	10/26/2015
184	420 Kenyon St NW	10/26/2015
185	4215 39th St NW	10/26/2015
186	423 GALLATIN ST NW	10/26/2015
187	4810 KANSAS AVE NW	10/26/2015
188	4818 8th ST NW	10/26/2015
189	5003 7TH ST NW	10/26/2015
190	53 P St NW	10/26/2015
191	53 V St NW	10/26/2015
192	5301 RENO RD NW	10/26/2015
193	5404 39TH ST NW	10/26/2015
194	543 TENNESSEE AVE NE	10/26/2015
195	605 ROCK CRK CHURCH RD NW	10/26/2015
196	6213 7TH ST NW	10/26/2015
197	632 OTIS PL NW	10/26/2015
198	715 GRESHAM PL NW	10/26/2015
199	744 9TH ST SE	10/26/2015
200	3414 LOWELL ST NW	11/9/2015
201	1000 DOUGLAS ST NE	11/16/2015

No	Address	Bottle Drop Off Date
202	1011 CONSTITUTION AVE NE	11/16/2015
203	1012 DOUGLAS ST NE	11/16/2015
204	1017 48TH ST NE	11/16/2015
205	1018 JACKSON ST NE	11/16/2015
206	1119 C ST NE	11/16/2015
207	1155 ABBEY PL NE	11/16/2015
208	117 15TH ST SE	11/16/2015
209	1311 K ST SE	11/16/2015
210	1322 FARRAGUT ST NW	11/16/2015
211	1335 TAYLOR ST NW	11/16/2015
212	14 CHANNING ST NW	11/16/2015
213	1409 POTOMAC AVE SE	11/16/2015
214	1425 VARNUM ST NW	11/16/2015
215	1505 CRITTENDEN ST NW	11/16/2015
216	1518 MASSACHUSETTS AVE SE	11/16/2015
217	1551 4TH ST NW	11/16/2015
218	1632 T ST SE	11/16/2015
219	1851 CALIFORNIA ST NW	11/16/2015
220	207 13TH ST SE	11/16/2015
221	214 S ST NW	11/16/2015
222	217 15TH ST SE	11/16/2015
223	2434 20TH ST NW	11/16/2015
224	26 16TH ST SE	11/16/2015
225	2624 MONROE ST NE	11/16/2015
226	2825 27TH ST NE	11/16/2015
227	3137 38TH ST NW	11/16/2015
228	3205 38TH ST NW	11/16/2015
229	3400 WARDER ST NW	11/16/2015
230	3920 5TH ST NW	11/16/2015
231	414 DOUGLAS ST NE	11/16/2015
232	418 HAMILTON ST NW	11/16/2015
233	4311 12TH ST NE	11/16/2015
234	4413 IOWA AVE NW	11/16/2015
235	500 PEABODY ST NW	11/16/2015
236	509 COLUMBIA RD NW	11/16/2015
237	5122 7TH ST NW	11/16/2015
238	521 BUTTERNUT ST NW	11/16/2015
239	5328 41ST ST NW	11/16/2015
240	5337 BROAD BRANCH RD NW	11/16/2015
241	5412 KANSAS AVE NW	11/16/2015
242	5600 NEBRASKA AVE NW	11/16/2015

No	Address	Bottle Drop Off Date
243	605 ROCK CRK CHURCH RD NW	11/16/2015
244	6409 7TH ST NW	11/16/2015
245	642 GALLATIN ST NW	11/16/2015
246	721 QUEBEC PL NW	11/16/2015
247	7755 16TH ST NW	11/16/2015
248	810 9TH ST NE	11/16/2015
249	821 E ST SE	11/16/2015
250	905 WEBSTER ST NW	11/16/2015
251	909 DELAFIELD PL NW	11/16/2015

Table C.2 Sample Kits Not Returned

No	Address	Bottle Drop Off Date
1	10 S St NW	7/27/2015
2	1003 Otis St NE	7/27/2015
3	1003 Quebec Pl NW	7/27/2015
4	1010 10th St NE	7/27/2015
5	109 19th St SE	7/27/2015
6	1113 STAPLES ST NE	7/27/2015
7	123 TENNESSEE AVE NE	7/27/2015
8	1305 TAYLOR ST NW	7/27/2015
9	1315 FRANKLIN ST NE	7/27/2015
10	1331 Irving St NE	7/27/2015
11	1339 CHILDRESS ST NE	7/27/2015
12	1357 C St NE	7/27/2015
13	1375 MONROE ST NW	7/27/2015
14	1424 S ST NW	7/27/2015
15	1453 S St NW	7/27/2015
16	1505 Buchanan St NW	7/27/2015
17	1508 GOOD HOPE RD SE	7/27/2015
18	1529 UPSHUR ST NW	7/27/2015
19	1659 NEWTON ST NW	7/27/2015
20	1703 D St NE	7/27/2015
21	1705 D St NE	7/27/2015
22	1826 Jackson St NE	7/27/2015
23	1911 P ST SE	7/27/2015
24	1916 PARK RD NW	7/27/2015
25	2036 17TH ST NW	7/27/2015
26	2107 2nd St NE	8/24/2015
27	2121 3RD ST NE	8/24/2015
28	2212 38th St NW	8/24/2015
29	228 V ST NE	8/24/2015
30	2830 BRENTWOOD RD NE	8/24/2015
31	2832 BRENTWOOD RD NE	8/24/2015
32	2904 P ST SE	8/24/2015
33	2913 Brandywine St NW	8/24/2015
34	3218 MACOMB ST NW	8/24/2015
35	3218 MORRISON ST NW	8/24/2015
36	322 TENNESSEE AVE NE	8/24/2015
37	336 Quackenbos St NE	8/24/2015
38	3621 Van Ness St NW	8/24/2015
39	3706 35th St NW	8/24/2015

No	Address	Bottle Drop Off Date
40	3761 W ST NW	8/24/2015
41	3916 5TH ST NW	8/24/2015
42	4002 ILLINOIS AVE NW	8/24/2015
43	4014 Grant St NE	8/24/2015
44	4120 Grant St NE	8/24/2015
45	4131 YUMA ST NW	8/24/2015
46	4233 JENIFER ST NW	8/24/2015
47	4408 HAYES ST NE	8/24/2015
48	4409 Lowell St NW	8/24/2015
49	4413 5th St NW	8/24/2015
50	449 S St NW	9/28/2015
51	4550 30TH ST NW	9/28/2015
52	4610 KANSAS AVE NW	9/28/2015
53	4921 30th Pl NW	9/28/2015
54	522 4TH ST SE	9/28/2015
55	531 Tennessee Ave NE	9/28/2015
56	5312 ILLINOIS AVE NW	9/28/2015
57	609 49TH PL NE	9/28/2015
58	620 44TH ST NE	9/28/2015
59	6205 14TH ST NW	9/28/2015
60	636 ROCK CRK CHURCH RD NW	9/28/2015
61	714 4th St NE	9/28/2015
62	804 Delafield Pl NW	9/28/2015
63	807 Buchanan St NW	9/28/2015
64	87 S St NW	9/28/2015
65	1319 POTOMAC AVE SE	10/26/2015
66	1420 Hamlin St NE	10/26/2015
67	1421 TAYLOR ST NW	10/26/2015
68	1465 GIRARD ST NW	10/26/2015
69	1671 Rosedale St NE	10/26/2015
70	1736 Bay St SE	10/26/2015
71	1850 2ND ST NW	10/26/2015
72	223 14th Pl NE	10/26/2015
73	308 9th St SE	10/26/2015
74	317 9th St SE	10/26/2015
75	3202 38TH ST NW	10/26/2015
76	333 34th St NE	10/26/2015
77	3917 8th St NW	10/26/2015
78	420 Kenyon St NW	10/26/2015
79	53 V St NW	10/26/2015
80	5301 RENO RD NW	10/26/2015

No	Address	Bottle Drop Off Date
81	5404 39TH ST NW	10/26/2015
82	632 OTIS PL NW	10/26/2015
83	715 GRESHAM PL NW	10/26/2015
84	1011 CONSTITUTION AVE NE	11/16/2015
85	1017 48TH ST NE	11/16/2015
86	117 15TH ST SE	11/16/2015
87	1311 K ST SE	11/16/2015
88	1322 FARRAGUT ST NW	11/16/2015
89	1335 TAYLOR ST NW	11/16/2015
90	1409 POTOMAC AVE SE	11/16/2015
91	1518 MASSACHUSETTS AVE SE	11/16/2015
92	1851 CALIFORNIA ST NW	11/16/2015
93	207 13TH ST SE	11/16/2015
94	214 S ST NW	11/16/2015
95	217 15TH ST SE	11/16/2015
96	2434 20TH ST NW	11/16/2015
97	26 16TH ST SE	11/16/2015
98	2624 MONROE ST NE	11/16/2015
99	3137 38TH ST NW	11/16/2015
100	414 DOUGLAS ST NE	11/16/2015
101	418 HAMILTON ST NW	11/16/2015
102	4311 12TH ST NE	11/16/2015
103	500 PEABODY ST NW	11/16/2015
104	509 COLUMBIA RD NW	11/16/2015
105	605 ROCK CRK CHURCH RD NW	11/16/2015
106	721 QUEBEC PL NW	11/16/2015
107	810 9TH ST NE	11/16/2015
108	909 DELAFIELD PL NW	11/16/2015

Table C.3 Samples Returned but Rejected for Compliance Analysis

No	Address	Bottle Drop Off Date	Reject Reason
1	1011 Taylor St NE	7/27/2015	Stagnation period less than six hours
2	1262 COLUMBIA RD NW	7/27/2015	Stagnation period less than six hours
3	15 MADISON ST NW	7/27/2015	Stagnation period less than six hours
4	1831 MONROE ST NE	7/27/2015	Full lead service line replacement 7/23/2015
5	2007 37TH ST NW	7/27/2015	Bottle not full
6	2923 Cathedral AVE NW	8/24/2015	Incomplete chain of custody
7	3033 CAMBRIDGE PL NW	8/24/2015	Ice maker on
8	37 U ST NE	8/24/2015	Ice maker, sprinkler, humidifier on
9	3727 T St NW	8/24/2015	Stagnation period over 18 hours
10	424 Luray Pl NW	8/24/2015	Incomplete chain of custody
11	4418 14th St NE	9/28/2015	Bottle not full
12	4627 49th St NW	9/28/2015	No chain of custody submitted
13	5007 13TH ST NW	9/28/2015	Stagnation period less than six hours
14	5024 7th St NW	9/28/2015	No chain of custody submitted
15	5318 9TH ST NW	9/28/2015	Incomplete chain of custody
16	6105 Dix St NE	9/28/2015	No chain of custody submitted
17	926 Hamilton St NW	9/28/2015	Ice maker on
18	303 V ST NE	10/26/2015	Stagnation period less than six hours
19	3414 LOWELL ST NW	10/26/2015	Bottles not labeled 1st / 2nd draw and no collect times
20	3416 9th St NE	10/26/2015	Bottles not labeled 1st / 2nd draw and no collect times
21	3913 8TH ST NW	10/26/2015	Leak in plumbing
22	5003 7TH ST NW	10/26/2015	Incomplete chain of custody
23	53 P St NW	10/26/2015	Test pit identified copper service on public and private property 9/8/2015
24	605 ROCK CRK CHURCH RD NW	10/26/2015	Ice maker on
25	1155 ABBEY PL NE	11/16/2015	Bottle not full
26	1551 4TH ST NW	11/16/2015	Bottles not labeled 1st / 2nd draw and no collect times
27	3400 WARDER ST NW	11/16/2015	Bottles not labeled 1st / 2nd draw and no collect times
28	5122 7TH ST NW	11/16/2015	Incomplete chain of custody
29	521 BUTTERNUT ST NW	11/16/2015	Leak in plumbing
30	5412 KANSAS AVE NW	11/16/2015	Incomplete chain of custody
31	642 GALLATIN ST NW	11/16/2015	Bottles not labeled 1st / 2nd draw and no collect times
32	821 E ST SE	11/16/2015	Incomplete chain of custody

Table C.4 Deviations from Sample Kit Distribution Order

No	Address	Scheduled Month	Reason for Deviation
1	4447 HAWTHORNE ST NW	September	Customer requested to not participate; removed from LCR Sample Pool
2	5220 CHEVY CHASE PKWY NW	September	Customer could not sample at scheduled time and requested to sample next semester
3	6001 33rd St NW	September	Full lead service line replacement 7-1-2015
4	617 6th St NE	September	Construction near home
5	605 ROCK CRK CHURCH RD NW	October	Rejected samples, see Table C.3; dropped again in Nov, see Table C.2
6	3414 LOWELL ST NW	October	Added this semester ^{[1], [2]} ; sampled in October, but Rejected samples, see Table C.3; sampled again in Nov
7	1421 TAYLOR ST NW	October	Added this semester ^[1] ; sampled in October
8	1517 C ST SE	October	Added this semester ^[1] ; sampled in October
9	423 GALLATIN ST NW	October	Added this semester ^[1] ; sampled in October
10	3838 BEECHER ST NW	October	Added this semester ^[1] ; sampled in October
11	543 TENNESSEE AVE NE	October	Added this semester ^[1] ; sampled in October
12	1465 GIRARD ST NW	October	Added this semester ^[1] ; sampled in October
13	632 OTIS PL NW	October	Added this semester ^[1] ; sampled in October
14	1600 POTOMAC AVE SE	October	Added this semester ^[1] ; sampled in October
15	715 GRESHAM PL NW	October	Added this semester ^[1] ; sampled in October
16	303 V ST NE	October	Added this semester ^[1] ; sampled in October
17	4810 KANSAS AVE NW	October	Added this semester ^[1] ; sampled in October
18	3920 5TH ST NW	November	Added this semester ^[1] ; sampled in November
19	1505 CRITTENDEN ST NW	November	Added this semester ^[1] ; sampled in November
20	1335 TAYLOR ST NW	November	Added this semester ^[1] ; sampled in November
21	7755 16TH ST NW	November	Added this semester ^[1] ; sampled in November
22	1155 ABBEY PL NE	November	Added this semester ^[1] ; sampled in November
23	810 9TH ST NE	November	Added this semester ^[1] ; sampled in November
24	1012 DOUGLAS ST NE	November	Added this semester ^[1] ; sampled in November
25	4311 12TH ST NE	November	Added this semester ^[1] ; sampled in November
26	1551 4TH ST NW	November	Added this semester ^[1] ; sampled in November
27	5328 41ST ST NW	November	Added this semester ^[1] ; sampled in November
28	509 COLUMBIA RD NW	November	Added this semester ^[1] ; sampled in November
29	5122 7TH ST NW	November	Added this semester ^[1] ; sampled in November
30	5412 KANSAS AVE NW	November	Added this semester ^[1] ; sampled in November
31	5600 NEBRASKA AVE NW	November	Added this semester ^[1] ; sampled in November
32	1425 VARNUM ST NW	November	Added this semester ^[1] ; sampled in November
33	3137 38TH ST NW	November	Added this semester ^[1] ; sampled in November
34	721 QUEBEC PL NW	November	Added this semester ^[1] ; sampled in November
35	909 DELAFIELD PL NW	November	Added this semester ^[1] ; sampled in November

No	Address	Scheduled Month	Reason for Deviation
36	1311 K ST SE	November	Added this semester ^[1] ; sampled in November
37	905 WEBSTER ST NW	November	Added this semester ^[1] ; sampled in November
38	1322 FARRAGUT ST NW	November	Added this semester ^[1] ; sampled in November
39	214 S ST NW	November	Added this semester ^[1] ; sampled in November
40	642 GALLATIN ST NW	November	Added this semester ^[1] ; sampled in November
41	3205 38TH ST NW	November	Added this semester ^[1] ; sampled in November
42	4413 IOWA AVE NW	November	Added this semester ^[1] ; sampled in November
43	500 PEABODY ST NW	November	Added this semester ^[1] ; sampled in November
44	2434 20TH ST NW	November	Added this semester ^[1] ; sampled in November
45	1851 CALIFORNIA ST NW	November	Added this semester ^[1] ; sampled in November
46	418 HAMILTON ST NW	November	Added this semester ^[1] ; sampled in November
47	6409 7TH ST NW	November	Added this semester ^[1] ; sampled in November
48	14 CHANNING ST NW	November	Added this semester ^[1] ; sampled in November
49	1119 C ST NE	November	Added this semester ^[1] ; sampled in November
50	414 DOUGLAS ST NE	November	Added this semester ^[1] ; sampled in November
51	1018 JACKSON ST NE	November	Added this semester ^[1] ; sampled in November
52	1011 CONSTITUTION AVE NE	November	Added this semester ^[1] ; sampled in November
53	1000 DOUGLAS ST NE	November	Added this semester ^[1] ; sampled in November
54	1409 POTOMAC AVE SE	November	Added this semester ^[1] ; sampled in November
55	2624 MONROE ST NE	November	Added this semester ^[1] ; sampled in November
56	521 BUTTERNUT ST NW	November	Added this semester ^[1] ; sampled in November
57	2825 27TH ST NE	November	Added this semester ^[1] ; sampled in November
58	207 13TH ST SE	November	Added this semester ^[1] ; sampled in November
59	217 15TH ST SE	November	Added this semester ^[1] ; sampled in November
60	821 E ST SE	November	Added this semester ^[1] ; sampled in November
61	5337 BROAD BRANCH RD NW	November	Added this semester ^[1] ; sampled in November
62	26 16TH ST SE	November	Added this semester ^[1] ; sampled in November
63	3400 WARDER ST NW	November	Added this semester ^[1] ; sampled in November
64	1518 MASSACHUSETTS AVE SE	November	Added this semester ^[1] ; sampled in November
65	1632 T ST SE	November	Added this semester ^[1] ; sampled in November
66	117 15TH ST SE	November	Added this semester ^[1] ; sampled in November
67	1017 48TH ST NE	November	Added this semester ^[1] ; sampled in November

Notes:

- 1) Sites added this semester were randomly selected from the addresses that met Tier 1 criteria under 40 CFR 141.86(a)(3)(ii) as single family structure with a full or partial lead service line based on DC Water’s customer information and service line inventory records.
- 2) 3414 Lowell St. NW reported the private portion of their service line was replaced on the November 2015 Chain of Custody; the pipe material reported is “partial lead” to reflect this update.

Table C.5 Sites with Compliance Results from July 2014 through June 2015 and No Results in July through December 2015

No	Address	Explanation
1	10 S St NW	Samples not returned; see Table C.2
2	1003 Otis St NE	Samples not returned; see Table C.2
3	1010 10th St NE	Samples not returned; see Table C.2
4	1011 Taylor St NE	Samples rejected; see Table C.3
5	1113 STAPLES ST NE	Samples not returned; see Table C.2
6	1315 FRANKLIN ST NE	Samples not returned; see Table C.2
7	1319 POTOMAC AVE SE	Samples not returned; see Table C.2
8	1339 CHILDRESS ST NE	Samples not returned; see Table C.2
9	1357 C St NE	Samples not returned; see Table C.2
10	1375 MONROE ST NW	Samples not returned; see Table C.2
11	1412 Shepherd St NW	Removed prior to July 2015
12	1453 S St NW	Samples not returned; see Table C.2
13	15 MADISON ST NW	Samples rejected; see Table C.3
14	1505 Buchanan St NW	Samples not returned; see Table C.2
15	1659 NEWTON ST NW	Samples not returned; see Table C.2
16	1703 D St NE	Samples not returned; see Table C.2
17	1736 Bay St SE	Samples not returned; see Table C.2
18	1826 Jackson St NE	Samples not returned; see Table C.2
19	1831 MONROE ST NE	Samples rejected; see Table C.3
20	1850 2ND ST NW	Samples not returned; see Table C.2
21	2007 37TH ST NW	Samples rejected; see Table C.3
22	2036 17TH ST NW	Samples not returned; see Table C.2
23	2212 38th St NW	Samples not returned; see Table C.2
24	223 14th PI NE	Samples not returned; see Table C.2
25	228 V ST NE	Samples not returned; see Table C.2
26	2830 BRENTWOOD RD NE	Samples not returned; see Table C.2
27	2832 BRENTWOOD RD NE	Samples not returned; see Table C.2
28	2923 Cathedral AVE NW	Samples rejected; see Table C.3
29	308 9th St SE	Samples not returned; see Table C.2
30	309 11th St SE	Samples invalidated, see Attachment 4
31	322 TENNESSEE AVE NE	Samples not returned; see Table C.2
32	331 RALEIGH ST SE	Removed prior to July 2015
33	336 Quackenbos St NE	Samples not returned; see Table C.2
34	3416 9th St NE	Samples rejected; see Table C.3
35	3621 Van Ness St NW	Samples not returned; see Table C.2
36	3727 T St NW	Samples rejected; see Table C.3
37	3755 MCKINLEY ST NW	Removed prior to July 2015
38	3807 KANAWHA ST NW	Removed prior to July 2015
39	3913 8TH ST NW	Samples rejected; see Table C.3

No	Address	Explanation
40	3916 5TH ST NW	Samples not returned; see Table C.2
41	3917 8th St NW	Samples not returned; see Table C.2
42	4002 ILLINOIS AVE NW	Samples not returned; see Table C.2
43	4014 Grant St NE	Samples not returned; see Table C.2
44	4054 GRANT ST NE	Removed prior to July 2015
45	4120 Grant St NE	Samples not returned; see Table C.2
46	4131 YUMA ST NW	Samples not returned; see Table C.2
47	4233 JENIFER ST NW	Samples not returned; see Table C.2
48	4310 37th St NW	Removed prior to July 2015
49	4409 Lowell St NW	Samples not returned; see Table C.2
50	4413 5th St NW	Samples not returned; see Table C.2
51	4418 14th St NE	Samples rejected; see Table C.3
52	4447 HAWTHORNE ST NW	Removed this semester; see Table C.4
53	4550 30TH ST NW	Samples not returned; see Table C.2
54	4627 49th St NW	Samples rejected; see Table C.3
55	4921 30th PI NW	Samples not returned; see Table C.2
56	522 4TH ST SE	Samples not returned; see Table C.2
57	5220 CHEVY CHASE PKWY NW	No bottles dropped; see Table C.4
58	53 P St NW	Samples rejected; see Table C.3
59	5301 RENO RD NW	Samples not returned; see Table C.2
60	5312 ILLINOIS AVE NW	Samples not returned; see Table C.2
61	5404 39TH ST NW	Samples not returned; see Table C.2
62	6001 33rd St NW	Removed this semester; see Table C.4
63	609 49TH PL NE	Samples not returned; see Table C.2
64	617 6th St NE	No bottles dropped; see Table C.4
65	6205 14TH ST NW	Samples not returned; see Table C.2
66	6210 8th St NW	Removed prior to July 2015
67	804 Delafield PI NW	Samples not returned; see Table C.2
68	822 Allison St NW	Removed prior to July 2015
69	87 S St NW	Samples not returned; see Table C.2
70	913 Hamlin St NE	Removed prior to July 2015
71	926 Hamilton St NW	Samples rejected; see Table C.3

Table C.6 Customer Notification of Results

No	Address	Collection Date	Date Results Received From Aqueduct	Date Letter Sent To Customer
1	2032 37TH ST NW	7/29/2015	8/17/2015	8 /19/2015
2	1706 NEW JERSEY AVE NW	7/29/2015	8/17/2015	8 /19/2015
3	1649 HARVARD ST NW	7/29/2015	8/17/2015	8 /19/2015
4	119 16TH ST NE	7/29/2015	8/17/2015	8 /19/2015
5	1635 WEBSTER ST NW	7/30/2015	8/17/2015	8 /19/2015
6	125 Madison St NW	7/29/2015	8/17/2015	8 /19/2015
7	1410 ALLISON ST NW	8/3/2015	8/19/2015	8 /19/2015
8	1529 27TH ST NW	7/30/2015	8/17/2015	8 /19/2015
9	1020 INDEPENDENCE AVE SE	7/27/2015	8/17/2015	8 /19/2015
10	1420 INGRAHAM ST NW	7/29/2015	8/17/2015	8 /19/2015
11	1519 Olive St NE	7/29/2015	8/17/2015	8 /19/2015
12	15 Milmarson Pl NW	7/30/2015	8/17/2015	8 /19/2015
13	1715 IRVING ST NE	7/28/2015	8/17/2015	8 /19/2015
14	1346 F St NE	7/27/2015	8/17/2015	8 /19/2015
15	1627 Gales St NE	7/28/2015	8/17/2015	8 /19/2015
16	1428 VARNUM ST NW	7/29/2015	8/17/2015	8 /19/2015
17	1738 ALLISON ST NW	7/29/2015	8/17/2015	8 /19/2015
18	1513 27TH ST NW	7/28/2015	8/17/2015	8 /19/2015
19	1620 Webster St NW	7/29/2015	8/17/2015	8 /19/2015
20	1613 Webster St NW	8/14/2015	8/27/2015	8 /31/2015
21	412 BRANDYWINE ST SE	8/25/2015	9/22/2015	9 /22/2015
22	2719 O ST NW	8/27/2015	9/22/2015	9 /22/2015
23	3405 HOLMEAD PL NW	8/26/2015	9/22/2015	9 /22/2015
24	313 5TH ST NE	8/27/2015	9/22/2015	9 /22/2015
25	314 VARNUM ST NW	8/27/2015	9/22/2015	9 /22/2015
26	3309 35TH ST NW	8/25/2015	9/22/2015	9 /22/2015
27	2804 6TH ST NE	8/25/2015	9/22/2015	9 /22/2015
28	3510 QUESADA ST NW	8/25/2015	9/22/2015	9 /22/2015
29	3724 CHESAPEAKE ST NW	8/26/2015	9/22/2015	9 /22/2015
30	2435 33RD ST SE	8/25/2015	9/22/2015	9 /22/2015
31	421 Hamilton St NW	8/25/2015	9/22/2015	9 /22/2015
32	3636 13TH ST NW	8/25/2015	9/22/2015	9 /22/2015
33	309 11TH ST SE	8/26/2015	9/22/2015	9 /22/2015
34	3625 Albemarle St NW	8/26/2015	9/22/2015	9 /22/2015
35	4214 8th St NW	8/24/2015	9/22/2015	9 /22/2015
36	307 7th St NE	8/26/2015	9/22/2015	9 /22/2015
37	3206 38th St NW	8/27/2015	9/22/2015	9 /22/2015
38	3710 Huntington St NW	8/26/2015	9/22/2015	9 /22/2015
39	3908 13TH ST NW	8/25/2015	9/22/2015	9 /22/2015

No	Address	Collection Date	Date Results Received From Aqueduct	Date Letter Sent To Customer
40	3211 Central Ave NE	8/26/2015	9/22/2015	9 /22/2015
41	414 G ST NE	8/27/2015	9/22/2015	9 /22/2015
42	4806 Kansas Ave NW	9/30/2015	11/16/2015	11/19/2015
43	5731 3rd Pl NW	10/2/2015	11/16/2015	11/19/2015
44	5234 Illinois Ave NW	10/5/2015	11/16/2015	11/19/2015
45	75 Bates St NW	9/29/2015	11/16/2015	11/19/2015
46	6308 8th St NW	10/1/2015	11/16/2015	11/19/2015
47	450 Newton Pl NW	10/4/2015	11/16/2015	11/19/2015
48	905 Kent Pl NE	9/29/2015	11/16/2015	11/19/2015
49	8 N St SW	9/30/2015	11/16/2015	11/19/2015
50	5923 33rd St NW	9/30/2015	11/16/2015	11/19/2015
51	816 MADISON ST NW	9/30/2015	11/16/2015	11/19/2015
52	619 12th St NE	9/30/2015	11/16/2015	11/19/2015
53	1211 Carrollsburg Pl SW	9/30/2015	11/16/2015	11/19/2015
54	702 9th St SE	9/30/2015	11/16/2015	11/19/2015
55	4703 Macarthur Blvd NW	9/30/2015	11/16/2015	11/19/2015
56	4926 Glenbrook Rd NW	9/30/2015	11/16/2015	11/19/2015
57	12 14TH ST SE	9/30/2015	11/16/2015	11/19/2015
58	912 Emerson St NW	10/1/2015	11/16/2015	11/19/2015
59	4811 Illinois Ave NW	10/1/2015	11/16/2015	11/19/2015
60	4719 9TH ST NW	9/29/2015	11/16/2015	11/19/2015
61	923 9TH ST NE	9/28/2015	11/16/2015	11/19/2015
62	4425 14th St NE	9/30/2015	11/16/2015	11/19/2015
63	4525 15TH ST NW	9/30/2015	11/16/2015	11/19/2015
64	5223 KANSAS AVE NW	9/30/2015	11/16/2015	11/19/2015
65	502 A ST SE	9/29/2015	11/16/2015	11/19/2015
66	6516 8TH ST NW	9/30/2015	11/16/2015	11/19/2015
67	1517 C ST SE	10/27/2015	12/14/2015	12/21/2015
68	5337 BROAD BRANCH RD NW	11/18/2015	12/15/2015	12/21/2015
69	1018 JACKSON ST NE	11/23/2015	12/15/2015	12/21/2015
70	3838 BEECHER ST NW	10/30/2015	12/14/2015	12/21/2015
71	543 TENNESSEE AVE NE	10/29/2015	12/14/2015	12/21/2015
72	4810 KANSAS AVE NW	10/27/2015	12/14/2015	12/21/2015
73	1600 POTOMAC AVE SE	10/27/2015	12/14/2015	12/21/2015
74	1012 DOUGLAS ST NE	11/18/2015	12/15/2015	12/21/2015
75	1000 DOUGLAS ST NE	11/17/2015	12/15/2015	12/21/2015
76	423 GALLATIN ST NW	10/27/2015	12/14/2015	12/21/2015
77	1119 C ST NE	11/18/2015	12/15/2015	12/21/2015
78	313 10TH ST SE	10/27/2015	12/14/2015	12/21/2015
79	6409 7TH ST NW	11/17/2015	12/15/2015	12/21/2015
80	231 K St NE	10/29/2015	12/14/2015	12/21/2015

No	Address	Collection Date	Date Results Received From Aqueduct	Date Letter Sent To Customer
81	4413 IOWA AVE NW	11/18/2015	12/15/2015	12/21/2015
82	3920 5TH ST NW	11/19/2015	12/15/2015	12/21/2015
83	5600 NEBRASKA AVE NW	11/17/2015	12/15/2015	12/21/2015
84	1425 VARNUM ST NW	11/18/2015	12/15/2015	12/21/2015
85	905 WEBSTER ST NW	11/17/2015	12/15/2015	12/21/2015
86	3205 38TH ST NW	11/18/2015	12/15/2015	12/21/2015
87	5328 41ST ST NW	11/17/2015	12/15/2015	12/21/2015
88	14 CHANNING ST NW	11/18/2015	12/15/2015	12/21/2015
89	3301 BROWN St NW	10/28/2015	12/14/2015	12/21/2015
90	7755 16TH ST NW	11/18/2015	12/15/2015	12/21/2015
91	1505 CRITTENDEN ST NW	11/18/2015	12/15/2015	12/21/2015
92	1632 T ST SE	11/18/2015	12/15/2015	12/21/2015
93	3414 LOWELL ST NW	11/23/2015	12/15/2015	12/21/2015
94	2825 27TH ST NE	11/17/2015	12/15/2015	12/21/2015
95	6213 7TH ST NW	10/28/2015	12/14/2015	12/21/2015
96	4818 8th ST NW	10/26/2015	12/14/2015	12/21/2015
97	1222 HAMILTON ST NW	10/29/2015	12/14/2015	12/21/2015
98	3036 P St NW	10/28/2015	12/14/2015	12/21/2015
99	3030 44TH ST NW	10/27/2015	12/14/2015	12/21/2015
100	3722 MCKINLEY ST NW	10/29/2015	12/14/2015	12/21/2015
101	1808 KEARNY ST NE	10/28/2015	12/14/2015	12/21/2015
102	1353 JEFFERSON ST NW	10/29/2015	12/14/2015	12/21/2015
103	1436 S St NW	10/27/2015	12/14/2015	12/21/2015
104	1412 S St NW	10/27/2015	12/14/2015	12/21/2015
105	3907 13th St NW	10/26/2015	12/14/2015	12/21/2015
106	4215 39th St NW	10/26/2015	12/14/2015	12/21/2015
107	2408 2nd St NE	10/28/2015	12/14/2015	12/21/2015
108	413 4th St SE	10/28/2015	12/14/2015	12/21/2015
109	36 Florida Ave NW	10/28/2015	12/14/2015	12/21/2015
110	3809 ALTON PL NW	10/29/2015	12/14/2015	12/21/2015
111	744 9TH ST SE	10/29/2015	12/14/2015	12/22/2015

Appendix D

Sample Invalidation Letter Request and EPA Response



December 28, 2015

Karen Crumlish
Drinking Water Branch (3WP21)
U.S. Environmental Protection Agency Region III
1650 Arch Street
Philadelphia, PA 19103-2029

Dear Ms. Crumlish:

The District of Columbia Water and Sewer Authority (DC Water) requests to invalidate samples collected for the July to December 2015 Lead and Copper Rule (LCR) monitoring period, pursuant to 40 CFR §141.86(f)(ii). The sampling location did not meet the site selection criteria at the time of sampling.

The customer collected first and second draw samples from 309 11th St SE on August 26, 2015. DC Water installed a new water main on the 300 block of 11th St SE and observed copper pipe at meter pit and property line for 309 11th St SE on June 9, 2015. DC Water records prior to the water main replacement activities indicated the service line was lead.

The Washington Aqueduct analyzed the samples for lead, copper, and iron. The laboratory report, construction field report, and customer chain of custody are enclosed with this letter.

Sincerely,

Jessica Edwards-Brandt
Manager, Drinking Water Branch

Enclosures:

cc: Wendy Gray, EPA Region III
Gregory Hope, Principal Counsel, DC Water
Jason Hughes, Director of Utility Services, DC Water
Charles Kiely, Assistant General Manager, DC Water

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-009

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508197-009 Customer Sample Number: 3073397 Project: LCR
Location: 1st draw 309 11TH ST SE Type: Dist.

Collection Date: 8/26/2015 Collection Time: 6:18 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.530 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.043 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	9/10/2015	TPasquale

Comment: 2 X Dilution
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-010

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-010 Customer Sample Number: 3073397 Project: LCR
Location: 2nd draw 309 11TH ST SE Type: Dist.


Collection Date: 8/26/2015 Collection Time: 6:19 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.059 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.029 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

DISTRICT OF COLUMBIA WATER AND SEWER AUTHORITY


Day and Date	Tuesday June 9 2015		
Installation Type	Public		
Premise #	3073397		
Address of Residence	309 11th St. SE DC.		
Plumber Name and License #	DFM 659 Richard Ben		
Public Space Permit Number	PA614167-R2		
Square # / Lot #	□ 970	L 822	
Size of Service Installed	1"	Upsized?	yes
Service Material	Copper		
Size of Corporation Stop			
Size of Curb Stop	1"		
Street where Main is Located	11th St.	Size of Main	8"


Additional Remarks: old meter MTU ID# 47397471

	PUBLIC		PRIVATE
Existing Material	Main to Meter <i>copper</i>	Meter to Curb Stop <i>copper</i>	Curb Stop to House <i>copper</i>
Size	<i>3/4</i>	<i>3/4</i>	<i>3/4</i>
Pipe Replaced	Main to Meter (FT) = <i>10</i>	Meter to Curb Stop (FT) = <i>14</i>	Curb Stop to Face = <i>1</i>
	Meter Setting Ties (FT) = <i>2</i>	Curb Stop Ties (FT) = <i>1</i>	Inside house = <i>-</i>
	Total Linear Feet Installed in Public Space = <i>27</i>		Private side Total = <i>-</i>
Curb Line to Property Line (FT) =	<i>21</i>		Difference Between Property Line / Curb Stop = <i>4</i>
Reason for short of property line: <i>N/A / Obstruction / Face of house / Other, Specify;</i>			

Meter Box Installed	<i>yes</i>	Curb Stop Installed:	<i>yes</i>
Meter Installed	<i>yes</i>	Existing Meter in Private Space:	<i>NO</i>
Meter Number Installed	<i>150063190</i>	Existing Meter in Public Space:	<i>yes</i>
Flushed?	<i>yes</i>	Reason not flushed:	<i>-</i>
Tap Location: From Two Points:	<i>7 ft. to W. curb 109 ft. to S. curb @ C st.</i>		

Contractor Representative: *Joseph P. Hill* DCW: *Karl Dely*

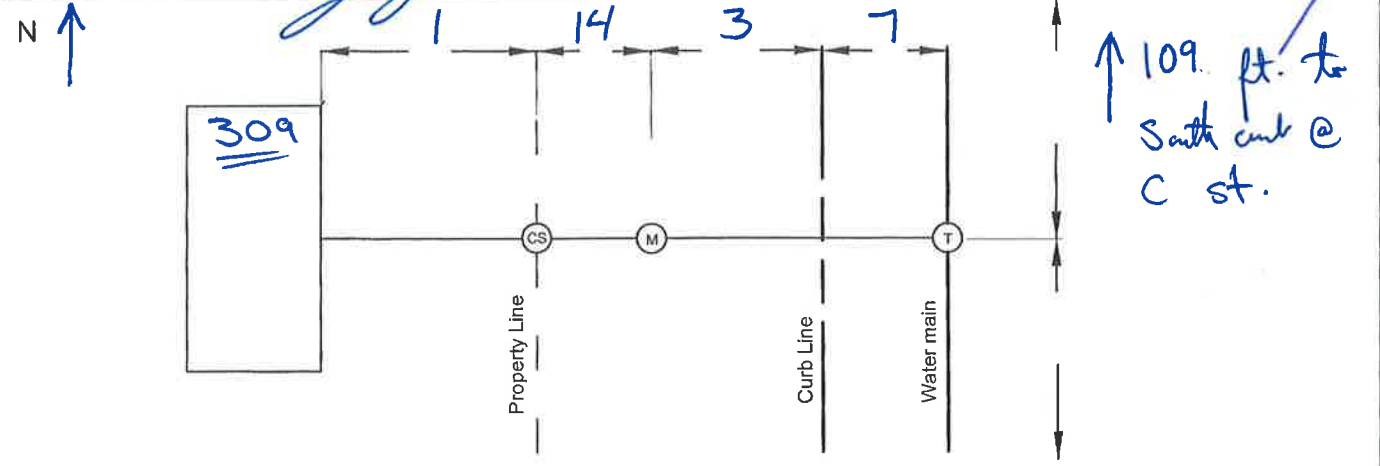

SUBMITTED BY: <i>J. Hill</i>	ADDRESS: <i>309 11th St. SE DC.</i>	(M) Water Meter	DEPT. OF WATER SERVICES Tap-Card	
REVIEWED BY: <i>R.V.</i>	<i>new meter # 15006319</i>	(CS) Curb Stop		
DATE SUBMITTED:		(T) TAP		
INSTALL. DATE: <i>June 9 2015</i>	 15006319	CHK'D	DWG	POSTG



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY
REGION III
1650 Arch Street
Philadelphia, Pennsylvania 19103-2029

JAN 08 2016

Ms. Jessica Edwards-Brandt
Manager, Drinking Water Division
District of Columbia Water and Sewer Authority
3900 Donaldson Place
Washington, DC 20016

Dear Ms. Edwards-Brandt:

On December 28, 2015, you advised EPA Region III that the District of Columbia Water and Sewer Authority (DC Water) had determined that there was an issue with one of the sites in the District (3xx 11th Street, SE) used during the July – December 2015 monitoring period for one of the tap samples required by the Lead and Copper Rule (LCR). At the time the sample was collected on August 25, 2015, DC Water believed that the site had a full lead service line which qualified it as a Tier 1 site under the LCR criteria. The sample from this site was analyzed and the results for the first draw (compliance) sample were Non Detect for lead and 0.043 mg/L for copper. These results were to be included in the 90th percentile calculation in DC Water's LCR monitoring report which would be submitted to EPA in January 2016.

However, DC Water subsequently determined that this site had a full copper service line when it received a report of the water main repairs which were made on 11th Street, SE on June 9, 2015. When the sample was collected in August 2015, this site was actually a Tier 3 site, not Tier 1. Therefore, DC Water has requested that the sample results be invalidated and should not be included in DC Water's 90th percentile lead and copper calculations for this monitoring period.

After reviewing the information regarding this request that was provided by DC Water, EPA Region III has decided to invalidate the analytical results for the sample collected at this location on August 25, 2015 as provided by 40 CFR 141.86(f)(1)(ii), as the site no longer met the criteria listed in 40 CFR 141.86(a)(3). DC Water should include the sample results for 3xx 11th Street, SE in its LCR monitoring report, but should not include the sample results in the 90th percentile calculations for the July – December 2015 monitoring period. DC Water should also remove this site from its future LCR monitoring plans.

EPA Region III also reviewed DC Water's previous LCR reports for each of their six-month monitoring periods from 2004 through 2015 to determine if this site had been previously included. EPA Region III found that it had been used twice before, in February 2014 and February 2015. On both occasions, the site was listed as having a full lead service line. The first draw sample results for lead were 0.0002 mg/L in 2014, and <0.0005 mg/L in 2015. Although EPA Region III could not determine when the original service line, which was probably lead, was replaced with copper, it was most likely before this site was first used in 2014. Thus, the results for the 2014 and 2015 samples should not have been included in the 90th percentile calculations for the respective monitoring periods of January - June 2014 and January - June 2015.

Therefore, EPA Region III has decided to invalidate the analytical results for the samples collected in the previous monitoring periods at 3xx 11th Street, SE on February 26, 2014 and February 24, 2015 as provided by 40 CFR 141.86(f)(1)(ii) as the site did not meet the criteria listed in 40 CFR 141.86(a)(3). EPA Region III has also verified that the invalidation of these samples will not affect the previous calculations of the 90th percentile lead and copper levels and that DC Water continued to satisfy the requirement to collect a minimum of 100 valid lead and copper samples during each of the monitoring periods.

EPA will document the invalidations in its copies of DC Water's LCR reports for the previous monitoring periods. EPA recommends that DC Water revise the LCR sample results as listed on its website for these monitoring periods to reflect the sample invalidations. This action will allow the website data to correspond with the compliance data.

Thank you for bringing this issue to our attention. If you have any questions regarding the above, please contact George Rizzo, Region III Lead and Copper Rule Manager at 215-814-5781 or rizzo.george@epa.gov.

Sincerely,



Karen Crumlish, Chief
Drinking Water Branch

cc: Wendy Gray
George Rizzo

Attachment 1

Washington Aqueduct Test Results For 1st and 2nd Draw

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-001


SAMPLE INFORMATION

Sample Number: 1508021-001 Customer Sample Number: 3028244 Project: LCR
Location: 1st draw 1428 VARNUM ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.045 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.034 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0015 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-002

SAMPLE INFORMATION

Sample Number: 1508021-002 Customer Sample Number: 3028244 Project: LCR
Location: 2nd draw 1428 VARNUM ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.048 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.027 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0018 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-003

SAMPLE INFORMATION

Sample Number: 1508021-003 Customer Sample Number: 3007212 Project: LCR
Location: 1st draw 1529 27TH ST NW Type: Dist.

Collection Date: 7/30/2015 Collection Time: 8:11 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.027 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.018 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0038 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-004


SAMPLE INFORMATION

Sample Number: 1508021-004 Customer Sample Number: 3007212 Project: LCR
Location: 2nd draw 1529 27TH ST NW Type: Dist.

Collection Date: 7/30/2015 Collection Time: 8:13 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.021 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.016 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0030 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-005

SAMPLE INFORMATION

Sample Number: 1508021-005 Customer Sample Number: 3007205 Project: LCR
Location: 1st draw 1513 27TH ST NW Type: Dist.

Collection Date: 7/28/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.026 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.037 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0039 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-006


SAMPLE INFORMATION

Sample Number: 1508021-006 Customer Sample Number: 3007205 Project: LCR
Location: 2nd draw 1513 27TH ST NW Type: Dist.

Collection Date: 7/28/2015 Collection Time: 8:05 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.019 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.008 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0102 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-007

SAMPLE INFORMATION

Sample Number: 1508021-007 Customer Sample Number: 3100684 Project: LCR
Location: 1st draw 1346 F ST NE Type: Dist.

Collection Date: 7/27/2015 Collection Time: 21:05 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.014 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.017 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0022 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-008

SAMPLE INFORMATION

Sample Number: 1508021-008 Customer Sample Number: 3100684 Project: LCR
Location: 2nd draw 1346 F ST NE Type: Dist.

Collection Date: 7/27/2015 Collection Time: 21:09 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:00 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.012 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.007 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0068 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-009

SAMPLE INFORMATION

Sample Number: 1508021-009 Customer Sample Number: 3029191 Project: LCR
Location: 1st draw 1620 WEBSTER ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:10 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.013 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.027 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0008 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-010

SAMPLE INFORMATION

Sample Number: 1508021-010 Customer Sample Number: 3029191 Project: LCR
Location: 2nd draw 1620 WEBSTER ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:23 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.020 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.006 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0011 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-011


SAMPLE INFORMATION

Sample Number: 1508021-011 Customer Sample Number: 3034000 Project: LCR
Location: 1st draw 1649 HARVARD ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:10 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.099 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.035 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0024 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-012

SAMPLE INFORMATION

Sample Number: 1508021-012 Customer Sample Number: 3034000 Project: LCR
Location: 2nd draw 1649 HARVARD ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:10 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.091 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.023 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0018 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-013

SAMPLE INFORMATION

Sample Number: 1508021-013 Customer Sample Number: 3073669 Project: LCR
Location: 1st draw 1020 INDEPENDENCE AVE SE Type: Dist.

Collection Date: 7/27/2015 Collection Time: 18:00 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.014 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.028 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0060 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-014

SAMPLE INFORMATION

Sample Number: 1508021-014 Customer Sample Number: 3073669 Project: LCR
Location: 2nd draw 1020 INDEPENDENCE AVE SE Type: Dist.

Collection Date: 7/27/2015 Collection Time: 18:05 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.011 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.008 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0070 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-015


SAMPLE INFORMATION

Sample Number: 1508021-015 Customer Sample Number: 3025494 Project: LCR
Location: 1st draw 125 MADISON ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 5:45 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.170 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.022 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0061 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-016


SAMPLE INFORMATION

Sample Number: 1508021-016 Customer Sample Number: 3025494 Project: LCR
Location: 2nd draw 125 MADISON ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 5:50 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.141 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.006 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0017 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-017


SAMPLE INFORMATION

Sample Number: 1508021-017 Customer Sample Number: 3029182 Project: LCR
Location: 1st draw 1635 WEBSTER ST NW Type: Dist.

Collection Date: 7/30/2015 Collection Time: 7:02 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.150 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.014 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0006 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-018

SAMPLE INFORMATION

Sample Number: 1508021-018 Customer Sample Number: 3029182 Project: LCR
Location: 2nd draw 1635 WEBSTER ST NW Type: Dist.

Collection Date: 7/30/2015 Collection Time: 7:11 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.011 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.010 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0023 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-019


SAMPLE INFORMATION

Sample Number: 1508021-019 Customer Sample Number: 3026174 Project: LCR
Location: 1st draw 15 MILMARSON PL NW Type: Dist.

Collection Date: 7/30/2015 Collection Time: 6:07 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.029 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.072 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0005 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-020


SAMPLE INFORMATION

Sample Number: 1508021-020 Customer Sample Number: 3026174 Project: LCR
Location: 2nd draw 15 MILMARSON PL NW Type: Dist.

Collection Date: 7/30/2015 Collection Time: 6:09 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.030 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.038 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0014 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-021

SAMPLE INFORMATION

Sample Number: 1508021-021 Customer Sample Number: 3111360 Project: LCR
Location: 1st draw 1519 OLIVE ST NE Type: Dist.

Collection Date: 7/29/2015 Collection Time: 9:00 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.228 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.006 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0025 mg/L	8/13/2015	Rhoffa

Comment: 2X dilution for Iron only


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-022


SAMPLE INFORMATION

Sample Number: 1508021-022 Customer Sample Number: 3111360 Project: LCR
Location: 2nd draw 1519 OLIVE ST NE Type: Dist.

Collection Date: 7/29/2015 Collection Time: 9:07 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.221 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.008 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0048 mg/L	8/13/2015	Rhoffa

Comment: 2X dilution for Iron only
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-023


SAMPLE INFORMATION

Sample Number: 1508021-023 Customer Sample Number: 3006211 Project: LCR
Location: 1st draw 1706 NEW JERSEY AVE NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.026 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0004 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-024

SAMPLE INFORMATION

Sample Number: 1508021-024 Customer Sample Number: 3006211 Project: LCR
Location: 2nd draw 1706 NEW JERSEY AVE NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 7:13 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.034 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.010 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0025 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-025


SAMPLE INFORMATION

Sample Number: 1508021-025 Customer Sample Number: 3101219 Project: LCR
Location: 1st draw 1627 GALES ST NE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 17:00 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.039 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.042 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0014 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-026


SAMPLE INFORMATION

Sample Number: 1508021-026 Customer Sample Number: 3101219 Project: LCR
Location: 2nd draw 1627 GALES ST NE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 17:01 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.019 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.014 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0040 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-027

SAMPLE INFORMATION

Sample Number: 1508021-027 Customer Sample Number: 3111849 Project: LCR
Location: 1st draw 119 16TH ST NE Type: Dist.

Collection Date: 7/29/2015 Collection Time: 7:15 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.052 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0018 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-028


SAMPLE INFORMATION

Sample Number: 1508021-028 Customer Sample Number: 3111849 Project: LCR
Location: 2nd draw 119 16TH ST NE Type: Dist.

Collection Date: 7/29/2015 Collection Time: 7:19 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.029 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.010 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0021 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-029


SAMPLE INFORMATION

Sample Number: 1508021-029 Customer Sample Number: 3009928 Project: LCR
Location: 1st draw 2032 37TH ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:20 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.025 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.067 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0012 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-030

SAMPLE INFORMATION

Sample Number: 1508021-030 Customer Sample Number: 3009928 Project: LCR
Location: 2nd draw 2032 37TH ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:21 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.101 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.007 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0056 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-031

SAMPLE INFORMATION


Sample Number: 1508021-031 Customer Sample Number: 3029133 Project: LCR
Location: 1st draw 1738 ALLISON ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.022 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.053 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0014 mg/L	8/13/2015	Rhoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-032

SAMPLE INFORMATION

Sample Number: 1508021-032 Customer Sample Number: 3029133 Project: LCR
Location: 2nd draw 1738 ALLISON ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 7:13 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.032 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.018 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0018 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-033

SAMPLE INFORMATION

Sample Number: 1508021-033 Customer Sample Number: 3105267 Project: LCR
Location: 1st draw 1715 IRVING ST NE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 14:17 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.192 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.027 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0016 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508021-034

SAMPLE INFORMATION

Sample Number: 1508021-034 Customer Sample Number: 3105267 Project: LCR
Location: 2nd draw 1715 IRVING ST NE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 14:19 Sampler: HOME OWNER Received Date and Time: 8/4/2015 1:53:08 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.038 mg/L	8/13/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.022 mg/L	8/13/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0012 mg/L	8/13/2015	Rhoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508090-001


SAMPLE INFORMATION

Sample Number: 1508090-001 Customer Sample Number: 3049437 Project: LCR
Location: 1st draw 1420 INGRAHAM ST NW Type: Dist.

Collection Date: 7/29/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:11:01 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	8/13/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.020 mg/L	8/13/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0008 mg/L	8/13/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: LC-W1508049-001

SAMPLE INFORMATION

Sample Number: 1508049-001 Customer Sample Number: 3028198 Project: LCR
Location: 1st draw 1410 ALLISON ST NW Type: Dist.


Collection Date: 8/3/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:34:19 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.035 mg/L	8/13/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.010 mg/L	8/13/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0022 mg/L	8/13/2015	RHoffa

Comment:

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: LC-W1508049-002

SAMPLE INFORMATION

Sample Number: 1508049-002 Customer Sample Number: 3028198 Project: LCR
Location: 2nd draw 1410 ALLISON ST NW Type: Dist.

Collection Date: 8/3/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:34:19 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.017 mg/L	8/13/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.024 mg/L	8/13/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0014 mg/L	8/13/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/19/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508148-001

SAMPLE INFORMATION

Sample Number: 1508148-001 Customer Sample Number: 3029171 Project: LCR
Location: 1st draw 1613 WEBSTER ST. NW Type: Dist.

Collection Date: 8/14/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:04:37 AM Received By: JCross


Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	8/25/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.066 mg/L	8/25/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508148-002

SAMPLE INFORMATION

Sample Number: 1508148-002 Customer Sample Number: 3029171 Project: LCR
Location: 2nd draw 1613 WEBSTER ST. NW Type: Dist.

Collection Date: 8/14/2015 Collection Time: 7:12 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:04:37 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.017 mg/L	8/25/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.030 mg/L	8/25/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	8/25/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508197-001

SAMPLE INFORMATION


Sample Number: 1508197-001 Customer Sample Number: 3056809 Project: LCR
Location: 1st draw 4214 8TH ST NW Type: Dist.

Collection Date: 8/24/2015 Collection Time: 21:50 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.057 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.011 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  9/22/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508197-002 Customer Sample Number: 3056809 Project: LCR
Location: 2nd draw 4214 8TH ST NW Type: Dist.

Collection Date: 8/24/2015 Collection Time: 21:51 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.054 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.007 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-003

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-003 Customer Sample Number: 3036642 Project: LCR
Location: 1st draw 3625 ALBEMARLE ST NW Type: Dist.


Collection Date: 8/26/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.039 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0012 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508197-004

SAMPLE INFORMATION

Sample Number: 1508197-004 Customer Sample Number: 3036642 Project: LCR
Location: 2nd draw 3625 ALBEMARLE ST NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:02 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.005 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0013 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-005

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-005 Customer Sample Number: 3040552 Project: LCR
Location: 1st draw 3710 HUNTINGTON ST NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:04 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.016 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0011 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-006

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508197-006 Customer Sample Number: 3040552 Project: LCR
Location: 2nd draw 3710 HUNTINGTON ST NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:07 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0026 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  9/22/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-007

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-007 Customer Sample Number: 3041754 Project: LCR
Location: 1st draw 3309 35TH ST NW Type: Dist.


Collection Date: 8/25/2015 Collection Time: 5:50 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.049 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.059 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0022 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-008

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-008 Customer Sample Number: 3041754 Project: LCR
Location: 2nd draw 3309 35TH ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 5:52 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.052 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.007 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0029 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-009

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-009 Customer Sample Number: 3073397 Project: LCR
Location: 1st draw 309 11TH ST SE Type: Dist.


Collection Date: 8/26/2015 Collection Time: 6:18 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.530 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.043 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	9/10/2015	TPasquale

Comment: 2 X Dilution
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-010

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-010 Customer Sample Number: 3073397 Project: LCR
Location: 2nd draw 309 11TH ST SE Type: Dist.


Collection Date: 8/26/2015 Collection Time: 6:19 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.059 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.029 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-011

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-011 Customer Sample Number: 3107442 Project: LCR
Location: 1st draw 3211 CENTRAL AVE NE Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:42 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.031 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.057 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0023 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-012

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-012 Customer Sample Number: 3107442 Project: LCR
Location: 2nd draw 3211 CENTRAL AVE NE Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:44 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.027 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.009 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0101 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-013

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-013 Customer Sample Number: 3029605 Project: LCR
Location: 1st draw 3636 13TH ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0014 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-014

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508197-014 Customer Sample Number: 3029605 Project: LCR
Location: 2nd draw 3636 13TH ST NW Type: Dist.


Collection Date: 8/25/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0031 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508197-015

SAMPLE INFORMATION

Sample Number: 1508197-015 Customer Sample Number: 3111675 Project: LCR
Location: 1st draw 307 7TH ST NE Type: Dist.


Collection Date: 8/26/2015 Collection Time: 9:10 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.017 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.040 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508197-016

SAMPLE INFORMATION


Sample Number: 1508197-016 Customer Sample Number: 3111675 Project: LCR
Location: 2nd draw 307 7TH ST NE Type: Dist.

Collection Date: 8/26/2015 Collection Time: 9:12 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.030 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.011 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-017

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508197-017 Customer Sample Number: 3023353 Project: LCR
Location: 1st draw 421 HAMILTON ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 20:15 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.642 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.045 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0014 mg/L	9/10/2015	TPasquale

Comment: 2 X dilution
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508197-018

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508197-018 Customer Sample Number: 3023353 Project: LCR
Location: 2nd draw 421 HAMILTON ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 20:15 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:38:40 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.161 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.020 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0079 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 9/22/2015
Report Number: LC-W1508201-001

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508201-001 Customer Sample Number: 3038787 Project: LCR
Location: 1st draw 3510 QUESADA ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 7:16 Sampler: HOME OWNER Received Date and Time: 8/31/2015 8:32:35 AM Received By: TPasquale

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.036 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

9/22/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508201-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508201-002 Customer Sample Number: 3038787 Project: LCR
Location: 2nd draw 3510 QUESADA ST NW Type: Dist.


Collection Date: 8/25/2015 Collection Time: 7:18 Sampler: HOME OWNER Received Date and Time: 8/31/2015 8:32:35 AM Received By: TPasquale



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.006 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-001

SAMPLE INFORMATION


Sample Number: 1508211-001 Customer Sample Number: 3103275 Project: LCR
Location: 1st draw 2804 6TH ST NE Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.111 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.037 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0019 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-002

SAMPLE INFORMATION


Sample Number: 1508211-002 Customer Sample Number: 3080372 Project: LCR
Location: 1st draw 2435 33RD ST SE Type: Dist.

Collection Date: 8/25/2015 Collection Time: 19:10 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.758 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.041 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0035 mg/L	9/10/2015	TPasquale

Comment: 2 X Dilution
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-003


SAMPLE INFORMATION

Sample Number: 1508211-003 Customer Sample Number: 3035196 Project: LCR
Location: 1st draw 3206 38TH ST NW Type: Dist.

Collection Date: 8/27/2015 Collection Time: 8:45 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.262 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.020 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  9/22/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-004

SAMPLE INFORMATION

Sample Number: 1508211-004 Customer Sample Number: 3035196 Project: LCR
Location: 2nd draw 3206 38TH ST NW Type: Dist.

Collection Date: 8/27/2015 Collection Time: 8:52 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.058 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.005 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0013 mg/L	9/10/2015	TPasquale

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-005

SAMPLE INFORMATION


Sample Number: 1508211-005 Customer Sample Number: 3007249 Project: LCR
Location: 1st draw 2719 O ST NW Type: Dist.

Collection Date: 8/27/2015 Collection Time: 6:52 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.011 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.040 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0054 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-006

SAMPLE INFORMATION


Sample Number: 1508211-006 Customer Sample Number: 3007249 Project: LCR
Location: 2nd draw 2719 O ST NW Type: Dist.

Collection Date: 8/27/2015 Collection Time: 6:53 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.036 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0040 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-007

SAMPLE INFORMATION


Sample Number: 1508211-007 Customer Sample Number: 3021220 Project: LCR
Location: 1st draw 314 VARNUM ST NW Type: Dist.

Collection Date: 8/27/2015 Collection Time: 7:12 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.015 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0066 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-008

SAMPLE INFORMATION


Sample Number: 1508211-008 Customer Sample Number: 3021220 Project: LCR
Location: 2nd draw 314 VARNUM ST NW Type: Dist.

Collection Date: 8/27/2015 Collection Time: 7:13 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.005 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0102 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-009

SAMPLE INFORMATION

Sample Number: 1508211-009 Customer Sample Number: 3040894 Project: LCR
Location: 1st draw 3724 CHESAPEAKE ST NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.015 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.052 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	9/10/2015	TPasquale

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-010

SAMPLE INFORMATION

Sample Number: 1508211-010 Customer Sample Number: 3040894 Project: LCR
Location: 2nd draw 3724 CHESAPEAKE ST NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.010 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.050 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0002 mg/L	9/10/2015	TPasquale

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-011

SAMPLE INFORMATION


Sample Number: 1508211-011 Customer Sample Number: 3121346 Project: LCR
Location: 1st draw 313 5TH ST NE Type: Dist.

Collection Date: 8/27/2015 Collection Time: 7:12 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.031 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.009 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0007 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-012

SAMPLE INFORMATION

Sample Number: 1508211-012 Customer Sample Number: 3121346 Project: LCR
Location: 2nd draw 313 5TH ST NE Type: Dist.


Collection Date: 8/27/2015 Collection Time: 7:14 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.012 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.023 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0153 mg/L	9/10/2015	TPasquale

Comment:

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-013

SAMPLE INFORMATION

Sample Number: 1508211-013 Customer Sample Number: 3029819 Project: LCR
Location: 1st draw 3405 HOLMEAD PL NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 6:02 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.033 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	9/10/2015	TPasquale

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-014

SAMPLE INFORMATION


Sample Number: 1508211-014 Customer Sample Number: 3029819 Project: LCR
Location: 2nd draw 3405 HOLMEAD PL NW Type: Dist.

Collection Date: 8/26/2015 Collection Time: 6:05 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.015 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.012 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-015

SAMPLE INFORMATION


Sample Number: 1508211-015 Customer Sample Number: 3028753 Project: LCR
Location: 1st draw 3908 13TH ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 17:45 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.056 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0010 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-016

SAMPLE INFORMATION

Sample Number: 1508211-016 Customer Sample Number: 3028753 Project: LCR
Location: 2nd draw 3908 13TH ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 17:47 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.029 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.047 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0007 mg/L	9/10/2015	TPasquale

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-017

SAMPLE INFORMATION


Sample Number: 1508211-017 Customer Sample Number: 3127684 Project: LCR
Location: 1st draw 414 G ST NE Type: Dist.

Collection Date: 8/27/2015 Collection Time: 6:53 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.362 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.018 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-018

SAMPLE INFORMATION


Sample Number: 1508211-018 Customer Sample Number: 3127684 Project: LCR
Location: 2nd draw 414 G ST NE Type: Dist.

Collection Date: 8/27/2015 Collection Time: 6:55 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.129 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508211-019

SAMPLE INFORMATION


Sample Number: 1508211-019 Customer Sample Number: 3082792 Project: LCR
Location: 1st draw 412 BRANDYWINE ST SE Type: Dist.

Collection Date: 8/25/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:55:06 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.058 mg/L	9/10/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	9/10/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-001

SAMPLE INFORMATION

Sample Number: 1510024-001 Customer Sample Number: 3038936 Project: LCR
Location: 1st draw 5923 33RD ST NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.109 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-002


SAMPLE INFORMATION

Sample Number: 1510024-002 Customer Sample Number: 3038936 Project: LCR
Location: 2nd draw 5923 33RD ST NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:35 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.015 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0031 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-003

SAMPLE INFORMATION

Sample Number: 1510024-003 Customer Sample Number: 3099778 Project: LCR
Location: 1st draw 619 12TH ST NE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 2:30 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.041 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-005


SAMPLE INFORMATION

Sample Number: 1510024-005 Customer Sample Number: 3022216 Project: LCR
Location: 1st draw 4719 9TH ST NW Type: Dist.

Collection Date: 9/29/2015 Collection Time: 15:24 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.061 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.030 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0007 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-006

SAMPLE INFORMATION

Sample Number: 1510024-006 Customer Sample Number: 3022216 Project: LCR
Location: 2nd draw 4719 9TH ST NW Type: Dist.

Collection Date: 9/29/2015 Collection Time: 15:25 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	1.26 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.022 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0062 mg/L	10/16/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-007

SAMPLE INFORMATION

Sample Number: 1510024-007 Customer Sample Number: 3024404 Project: LCR
Location: 1st draw 816 MADISON ST NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 9:01 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.065 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0012 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-008

SAMPLE INFORMATION

Sample Number: 1510024-008 Customer Sample Number: 3024404 Project: LCR
Location: 2nd draw 816 MADISON ST NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 9:03 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.044 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.006 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-009


SAMPLE INFORMATION

Sample Number: 1510024-009 Customer Sample Number: 3045865 Project: LCR
Location: 1st draw 4926 GLENBROOK RD NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.033 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-010

SAMPLE INFORMATION

Sample Number: 1510024-010 Customer Sample Number: 3045865 Project: LCR
Location: 2nd draw 4926 GLENBROOK RD NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 6:04 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.034 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-011

SAMPLE INFORMATION

Sample Number: 1510024-011 Customer Sample Number: 3055284 Project: LCR
Location: 1st draw 4703 MACARTHUR BLVD NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.031 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.136 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0065 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-012

SAMPLE INFORMATION

Sample Number: 1510024-012 Customer Sample Number: 3055284 Project: LCR
Location: 2nd draw 4703 MACARTHUR BLVD NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.019 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0052 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-013

SAMPLE INFORMATION

Sample Number: 1510024-013 Customer Sample Number: 3092217 Project: LCR
Location: 1st draw 8 N ST SW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 16:35 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.065 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0038 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-015


SAMPLE INFORMATION

Sample Number: 1510024-015 Customer Sample Number: 3027236 Project: LCR
Location: 1st draw 6516 8TH ST NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.039 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.027 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0018 mg/L	10/16/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-016

SAMPLE INFORMATION

Sample Number: 1510024-016 Customer Sample Number: 3027236 Project: LCR
Location: 2nd draw 6516 8TH ST NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.041 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.007 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0051 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-017


SAMPLE INFORMATION

Sample Number: 1510024-017 Customer Sample Number: 3114988 Project: LCR
Location: 1st draw 4425 14TH ST NE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 5:33 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.147 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.050 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-018

SAMPLE INFORMATION

Sample Number: 1510024-018 Customer Sample Number: 3114988 Project: LCR
Location: 2nd draw 4425 14TH ST NE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 5:35 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.026 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.029 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-019

SAMPLE INFORMATION


Sample Number: 1510024-019 Customer Sample Number: 3058437 Project: LCR
Location: 1st draw 4806 KANSAS AVE NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:27 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross



Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.136 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	10/16/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-020


SAMPLE INFORMATION

Sample Number: 1510024-020 Customer Sample Number: 3058437 Project: LCR
Location: 2nd draw 4806 KANSAS AVE NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:29 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.014 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.107 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0011 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-023

SAMPLE INFORMATION

Sample Number: 1510024-023 Customer Sample Number: 3075175 Project: LCR
Location: 1st draw 12 14TH ST SE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0017 mg/L	10/16/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-024

SAMPLE INFORMATION

Sample Number: 1510024-024 Customer Sample Number: 3075175 Project: LCR
Location: 2nd draw 12 14TH ST SE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 6:46 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.032 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-025


SAMPLE INFORMATION

Sample Number: 1510024-025 Customer Sample Number: 3051648 Project: LCR
Location: 1st draw 5223 KANSAS AVE NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.103 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.075 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0014 mg/L	10/16/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-026


SAMPLE INFORMATION

Sample Number: 1510024-026 Customer Sample Number: 3051648 Project: LCR
Location: 2nd draw 5223 KANSAS AVE NW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 7:15 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.422 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-027

SAMPLE INFORMATION

Sample Number: 1510024-027 Customer Sample Number: 3026885 Project: LCR
Location: 1st draw 6308 8TH ST NW Type: Dist.

Collection Date: 10/1/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.058 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.049 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0018 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-028


SAMPLE INFORMATION

Sample Number: 1510024-028 Customer Sample Number: 3026885 Project: LCR
Location: 2nd draw 6308 8TH ST NW Type: Dist.

Collection Date: 10/1/2015 Collection Time: 6:47 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.062 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.045 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0015 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-029


SAMPLE INFORMATION

Sample Number: 1510024-029 Customer Sample Number: 3022524 Project: LCR
Location: 1st draw 912 EMERSON ST NW Type: Dist.

Collection Date: 10/1/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.034 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.006 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0020 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-030

SAMPLE INFORMATION

Sample Number: 1510024-030 Customer Sample Number: 3022524 Project: LCR
Location: 2nd draw 912 EMERSON ST NW Type: Dist.

Collection Date: 10/1/2015 Collection Time: 7:02 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.035 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.006 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0061 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-033

SAMPLE INFORMATION

Sample Number: 1510024-033 Customer Sample Number: 3058525 Project: LCR
Location: 1st draw 4811 ILLINOIS AVE NW Type: Dist.

Collection Date: 10/1/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.050 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.079 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	10/16/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-035

SAMPLE INFORMATION

Sample Number: 1510024-035 Customer Sample Number: 3086628 Project: LCR
Location: 1st draw 502 A ST SE Type: Dist.

Collection Date: 9/29/2015 Collection Time: 3:13 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.057 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.053 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0012 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-036


SAMPLE INFORMATION

Sample Number: 1510024-036 Customer Sample Number: 3086628 Project: LCR
Location: 2nd draw 502 A ST SE Type: Dist.

Collection Date: 9/29/2015 Collection Time: 3:14 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.117 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.028 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0018 mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-037

SAMPLE INFORMATION

Sample Number: 1510024-037 Customer Sample Number: 3073488 Project: LCR
Location: 1st draw 702 9TH ST SE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.019 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.036 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0085 mg/L	11/9/2015	TPasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-038


SAMPLE INFORMATION

Sample Number: 1510024-038 Customer Sample Number: 3073488 Project: LCR
Location: 2nd draw 702 9TH ST SE Type: Dist.

Collection Date: 9/30/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.014 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.009 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0164 mg/L	11/9/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-041


SAMPLE INFORMATION

Sample Number: 1510024-041 Customer Sample Number: 3092716 Project: LCR
Location: 1st draw 1211 CARROLLSBURG PL SW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 8:24 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.026 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.086 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0015 mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-042


SAMPLE INFORMATION

Sample Number: 1510024-042 Customer Sample Number: 3092716 Project: LCR
Location: 2nd draw 1211 CARROLLSBURG PL SW Type: Dist.

Collection Date: 9/30/2015 Collection Time: 8:25 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.038 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.047 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0086 mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-043


SAMPLE INFORMATION

Sample Number: 1510024-043 Customer Sample Number: 3011592 Project: LCR
Location: 1st draw 75 BATES ST NW Type: Dist.

Collection Date: 9/29/2015 Collection Time: 17:24 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.021 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/9/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510024-044


SAMPLE INFORMATION

Sample Number: 1510024-044 Customer Sample Number: 3011592 Project: LCR
Location: 2nd draw 75 BATES ST NW Type: Dist.

Collection Date: 9/29/2015 Collection Time: 17:25 Sampler: HOME OWNER Received Date and Time: 10/5/2015 1:08:30 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.069 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/9/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510060-002

SAMPLE INFORMATION

Sample Number: 1510060-002 Customer Sample Number: 3024835 Project: LCR
Location: 2nd Draw 5731 3RD PL NW Type: Dist.

Collection Date: 10/2/2015 Collection Time: 9:29 Sampler: HOME OWNER Received Date and Time: 10/9/2015 11:21:22 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.301 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.009 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0087 mg/L	10/16/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510060-003

SAMPLE INFORMATION


Sample Number: 1510060-003 Customer Sample Number: 3051579 Project: LCR
Location: 1st Draw 5234 ILLINOIS AVE NW Type: Dist.

Collection Date: 10/5/2015 Collection Time: 22:56 Sampler: HOME OWNER Received Date and Time: 10/9/2015 11:21:22 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.021 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.023 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0037 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510060-004


SAMPLE INFORMATION

Sample Number: 1510060-004 Customer Sample Number: 3051579 Project: LCR
Location: 2nd Draw 5234 ILLINOIS AVE NW Type: Dist.

Collection Date: 10/5/2015 Collection Time: 22:58 Sampler: HOME OWNER Received Date and Time: 10/9/2015 11:21:22 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.036 mg/L	10/16/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.019 mg/L	10/16/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0041 mg/L	10/16/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510089-001


SAMPLE INFORMATION

Sample Number: 1510089-001 Customer Sample Number: 3052487 Project: LCR
Location: 1st draw 450 NEWTON PL NW Type: Dist.

Collection Date: 10/4/2015 Collection Time: 23:45 Sampler: HOME OWNER Received Date and Time: 10/14/2015 3:07:39 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.040 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0023 mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  11/16/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510089-002

SAMPLE INFORMATION

Sample Number: 1510089-002 Customer Sample Number: 3052487 Project: LCR
Location: 2nd draw 450 NEWTON PL NW Type: Dist.

Collection Date: 10/4/2015 Collection Time: 23:45 Sampler: HOME OWNER Received Date and Time: 10/14/2015 3:07:39 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.023 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0055 mg/L	11/9/2015	TPasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-001

SAMPLE INFORMATION

Sample Number: 1511027-001 Customer Sample Number: 3023321 Project: LCR
Location: 1st draw 423 GALLATIN ST NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 7:24 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross


Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.073 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.015 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-002

SAMPLE INFORMATION

Sample Number: 1511027-002 Customer Sample Number: 3023321 Project: LCR
Location: 2nd draw 423 GALLATIN ST NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 7:26 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.214 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.032 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-003

SAMPLE INFORMATION

Sample Number: 1511027-003 Customer Sample Number: 3073506 Project: LCR
Location: 1s tdraw 744 9TH ST SE Type: Dist.

Collection Date: 10/29/2015 Collection Time: 6:15 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.015 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.015 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-004


SAMPLE INFORMATION

Sample Number: 1511027-004 Customer Sample Number: 3073506 Project: LCR
Location: 2nd draw 744 9TH ST SE Type: Dist.

Collection Date: 10/29/2015 Collection Time: 6:16 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.015 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-005


SAMPLE INFORMATION

Sample Number: 1511027-005 Customer Sample Number: 3122904 Project: LCR
Location: 1st draw 543 TENNESSEE AVE NE Type: Dist.

Collection Date: 10/29/2015 Collection Time: 15:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.013 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.015 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-006


SAMPLE INFORMATION

Sample Number: 1511027-006 Customer Sample Number: 3122904 Project: LCR
Location: 2nd draw 543 TENNESSEE AVE NE Type: Dist.

Collection Date: 10/29/2015 Collection Time: 15:05 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.013 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-007


SAMPLE INFORMATION

Sample Number: 1511027-007 Customer Sample Number: 3041124 Project: LCR
Location: 1st draw 4215 39TH ST NW Type: Dist.

Collection Date: 10/26/2015 Collection Time: 16:30 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.054 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-008


SAMPLE INFORMATION

Sample Number: 1511027-008 Customer Sample Number: 3041124 Project: LCR
Location: 2nd draw 4215 39TH ST NW Type: Dist.

Collection Date: 10/26/2015 Collection Time: 16:32 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.020 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0011 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-010


SAMPLE INFORMATION

Sample Number: 1511027-010 Customer Sample Number: 3002494 Project: LCR
Location: 2nd draw 1412 S ST NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.017 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.152 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-011


SAMPLE INFORMATION

Sample Number: 1511027-011 Customer Sample Number: 3058439 Project: LCR
Location: 1st draw 4810 KANSAS AVE NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 7:03 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.060 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0007 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-012

SAMPLE INFORMATION

Sample Number: 1511027-012 Customer Sample Number: 3058439 Project: LCR
Location: 2nd draw 4810 KANSAS AVE NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 7:03 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.023 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-013


SAMPLE INFORMATION

Sample Number: 1511027-013 Customer Sample Number: 3049333 Project: LCR
Location: 1st draw 1353 JEFFERSON ST NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 7:41 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.043 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-014


SAMPLE INFORMATION

Sample Number: 1511027-014 Customer Sample Number: 3049333 Project: LCR
Location: 2nd draw 1353 JEFFERSON ST NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 7:42 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.032 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-015

SAMPLE INFORMATION

Sample Number: 1511027-015 Customer Sample Number: 3075111 Project: LCR
Location: 1st draw 1517 C ST SE Type: Dist.

Collection Date: 10/27/2015 Collection Time: 5:41 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.043 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.086 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-016


SAMPLE INFORMATION

Sample Number: 1511027-016 Customer Sample Number: 3030694 Project: LCR
Location: 1st draw 3301 BROWN ST NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 6:03 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.014 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0012 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-017


SAMPLE INFORMATION

Sample Number: 1511027-017 Customer Sample Number: 3030694 Project: LCR
Location: 2nd draw 3301 BROWN ST NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 6:04 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.014 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0011 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-018


SAMPLE INFORMATION

Sample Number: 1511027-018 Customer Sample Number: 3008069 Project: LCR
Location: 1st draw 3036 P ST NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.052 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-019


SAMPLE INFORMATION

Sample Number: 1511027-019 Customer Sample Number: 3008069 Project: LCR
Location: 2nd draw 3036 P ST NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.007 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-021

SAMPLE INFORMATION

Sample Number: 1511027-021 Customer Sample Number: 3002478 Project: LCR
Location: 2nd draw 1436 S ST NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 6:20 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-022


SAMPLE INFORMATION

Sample Number: 1511027-022 Customer Sample Number: 3029267 Project: LCR
Location: 1st draw 3907 13TH ST NW Type: Dist.

Collection Date: 10/26/2015 Collection Time: 20:16 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.021 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.111 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-023

SAMPLE INFORMATION

Sample Number: 1511027-023 Customer Sample Number: 3029267 Project: LCR
Location: 2nd draw 3907 13TH ST NW Type: Dist.

Collection Date: 10/26/2015 Collection Time: 20:17 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.027 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.088 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-025


SAMPLE INFORMATION

Sample Number: 1511027-025 Customer Sample Number: 3103161 Project: LCR
Location: 2nd draw 2408 2ND ST NE Type: Dist.

Collection Date: 10/28/2015 Collection Time: 0:55 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.026 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0071 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-026


SAMPLE INFORMATION

Sample Number: 1511027-026 Customer Sample Number: 3097777 Project: LCR
Location: 1st draw 231 K ST NE Type: Dist.

Collection Date: 10/29/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.081 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-027


SAMPLE INFORMATION

Sample Number: 1511027-027 Customer Sample Number: 3097777 Project: LCR
Location: 2nd draw 231 K ST NE Type: Dist.

Collection Date: 10/29/2015 Collection Time: 7:22 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.064 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-028

SAMPLE INFORMATION

Sample Number: 1511027-028 Customer Sample Number: 3041213 Project: LCR
Location: 1st draw 3809 ALTON PL NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 6:40 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.028 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-029


SAMPLE INFORMATION

Sample Number: 1511027-029 Customer Sample Number: 3041213 Project: LCR
Location: 2nd draw 3809 ALTON PL NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 6:42 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.018 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0015 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-030

SAMPLE INFORMATION

Sample Number: 1511027-030 Customer Sample Number: 3026522 Project: LCR
Location: 1st draw 6213 7TH ST NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.024 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.006 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-031


SAMPLE INFORMATION

Sample Number: 1511027-031 Customer Sample Number: 3026522 Project: LCR
Location: 2nd draw 6213 7TH ST NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 6:01 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.028 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.006 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-032


SAMPLE INFORMATION

Sample Number: 1511027-032 Customer Sample Number: 3073239 Project: LCR
Location: 1st draw 313 10TH ST SE Type: Dist.

Collection Date: 10/27/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.037 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-033


SAMPLE INFORMATION

Sample Number: 1511027-033 Customer Sample Number: 3073239 Project: LCR
Location: 2nd draw 313 10TH ST SE Type: Dist.

Collection Date: 10/27/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-034


SAMPLE INFORMATION

Sample Number: 1511027-034 Customer Sample Number: 3106057 Project: LCR
Location: 1st draw 1808 KEARNY ST NE Type: Dist.

Collection Date: 10/28/2015 Collection Time: 9:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.022 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.050 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-035


SAMPLE INFORMATION

Sample Number: 1511027-035 Customer Sample Number: 3106057 Project: LCR
Location: 2nd draw 1808 KEARNY ST NE Type: Dist.

Collection Date: 10/28/2015 Collection Time: 9:10 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.023 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.032 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-036


SAMPLE INFORMATION

Sample Number: 1511027-036 Customer Sample Number: 3022580 Project: LCR
Location: 1st draw 4818 8TH ST NW Type: Dist.

Collection Date: 10/26/2015 Collection Time: 18:24 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.012 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.022 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-037


SAMPLE INFORMATION

Sample Number: 1511027-037 Customer Sample Number: 3022580 Project: LCR
Location: 2nd draw 4818 8TH ST NW Type: Dist.

Collection Date: 10/26/2015 Collection Time: 18:26 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.015 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-038


SAMPLE INFORMATION

Sample Number: 1511027-038 Customer Sample Number: 3055102 Project: LCR
Location: 1st draw 3030 44TH ST NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 6:49 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.023 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0007 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-039


SAMPLE INFORMATION

Sample Number: 1511027-039 Customer Sample Number: 3055102 Project: LCR
Location: 2nd draw 3030 44TH ST NW Type: Dist.

Collection Date: 10/27/2015 Collection Time: 6:53 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.053 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-042


SAMPLE INFORMATION

Sample Number: 1511027-042 Customer Sample Number: 3010272 Project: LCR
Location: 1st draw 3838 BEECHER ST NW Type: Dist.

Collection Date: 10/30/2015 Collection Time: 4:35 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.033 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.102 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-043


SAMPLE INFORMATION

Sample Number: 1511027-043 Customer Sample Number: 3010272 Project: LCR
Location: 2nd draw 3838 BEECHER ST NW Type: Dist.

Collection Date: 10/30/2015 Collection Time: 4:40 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.030 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.050 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-044

SAMPLE INFORMATION

Sample Number: 1511027-044 Customer Sample Number: 3039291 Project: LCR
Location: 1st draw 3722 MCKINLEY ST NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 5:45 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.080 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-045


SAMPLE INFORMATION

Sample Number: 1511027-045 Customer Sample Number: 3039291 Project: LCR
Location: 2nd draw 3722 MCKINLEY ST NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 5:45 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.019 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-046


SAMPLE INFORMATION

Sample Number: 1511027-046 Customer Sample Number: 3072261 Project: LCR
Location: 1st draw 413 4TH ST SE Type: Dist.

Collection Date: 10/28/2015 Collection Time: 8:18 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.024 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0002 mg/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-047


SAMPLE INFORMATION

Sample Number: 1511027-047 Customer Sample Number: 3072261 Project: LCR
Location: 2nd draw 413 4TH ST SE Type: Dist.

Collection Date: 10/28/2015 Collection Time: 8:20 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.012 mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.012 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-048


SAMPLE INFORMATION

Sample Number: 1511027-048 Customer Sample Number: 3075964 Project: LCR
Location: 1st draw 1600 POTOMAC AVE SE Type: Dist.

Collection Date: 10/27/2015 Collection Time: 1:07 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511027-049

SAMPLE INFORMATION

Sample Number: 1511027-049 Customer Sample Number: 3075964 Project: LCR
Location: 2nd draw 1600 POTOMAC AVE SE Type: Dist.

Collection Date: 10/27/2015 Collection Time: 1:10 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	Tpasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	11/18/2015	Tpasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	11/18/2015	Tpasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511069-001


SAMPLE INFORMATION

Sample Number: 1511069-001 Customer Sample Number: 3006813 Project: LCR
Location: 1st draw 36 FLORIDA AVE NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.142 mg/L	11/18/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511069-002


SAMPLE INFORMATION

Sample Number: 1511069-002 Customer Sample Number: 3006813 Project: LCR
Location: 2nd draw 36 FLORIDA AVE NW Type: Dist.

Collection Date: 10/28/2015 Collection Time: 6:10 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/18/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.022 mg/L	11/18/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/18/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/14/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511069-003


SAMPLE INFORMATION

Sample Number: 1511069-003 Customer Sample Number: 3049889 Project: LCR
Location: 1st draw 1222 HAMILTON ST NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 8:45 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.023 mg/L	11/18/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.031 mg/L	11/18/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0010 mg/L	11/18/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/14/2015
Report Number: LC-W1511069-004


SAMPLE INFORMATION

Sample Number: 1511069-004 Customer Sample Number: 3049889 Project: LCR
Location: 2nd draw 1222 HAMILTON ST NW Type: Dist.

Collection Date: 10/29/2015 Collection Time: 8:47 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.018 mg/L	11/18/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.032 mg/L	11/18/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	11/18/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/14/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-001

SAMPLE INFORMATION

Sample Number: 1511169-001 Customer Sample Number: 3037644 Project: LCR
Location: 1st draw 5600 NEBRASKA AVE NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.010 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.068 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-002

SAMPLE INFORMATION

Sample Number: 1511169-002 Customer Sample Number: 3037644 Project: LCR
Location: 2nd draw 5600 NEBRASKA AVE NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.013 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0024 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-003

SAMPLE INFORMATION

Sample Number: 1511169-003 Customer Sample Number: 3040108 Project: LCR
Location: 1st draw 5328 41ST ST NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 6:35 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.050 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.020 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0014 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-004


SAMPLE INFORMATION

Sample Number: 1511169-004 Customer Sample Number: 3040108 Project: LCR
Location: 2nd draw 5328 41ST ST NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 6:36 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0018 mg/L	12/14/2015	Rhoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-005

SAMPLE INFORMATION

Sample Number: 1511169-005 Customer Sample Number: 3103505 Project: LCR
Location: 1st draw 1000 DOUGLAS ST NE Type: Dist.

Collection Date: 11/17/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.022 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.012 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-006


SAMPLE INFORMATION

Sample Number: 1511169-006 Customer Sample Number: 3103505 Project: LCR
Location: 2nd draw 1000 DOUGLAS ST NE Type: Dist.

Collection Date: 11/17/2015 Collection Time: 7:35 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.022 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.017 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0053 mg/L	12/14/2015	Rhoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-007

SAMPLE INFORMATION

Sample Number: 1511169-007 Customer Sample Number: 3050303 Project: LCR
Location: 1st draw 4413 IOWA AVE NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 5:20 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.024 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.074 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0025 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-008


SAMPLE INFORMATION

Sample Number: 1511169-008 Customer Sample Number: 3050303 Project: LCR
Location: 2nd draw 4413 IOWA AVE NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 5:22 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.362 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.188 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0013 mg/L	12/14/2015	Rhoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-009


SAMPLE INFORMATION

Sample Number: 1511169-009 Customer Sample Number: 3103499 Project: LCR
Location: 1st draw 1012 DOUGLAS ST NE Type: Dist.

Collection Date: 11/18/2015 Collection Time: 6:03 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.023 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.019 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-010

SAMPLE INFORMATION

Sample Number: 1511169-010 Customer Sample Number: 3103499 Project: LCR
Location: 2nd draw 1012 DOUGLAS ST NE Type: Dist.

Collection Date: 11/18/2015 Collection Time: 6:04 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.026 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.017 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-011


SAMPLE INFORMATION

Sample Number: 1511169-011 Customer Sample Number: 3021655 Project: LCR
Location: 1st draw 905 WEBSTER ST NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 23:00 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.160 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	12/14/2015	Rhoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-012

SAMPLE INFORMATION

Sample Number: 1511169-012 Customer Sample Number: 3021655 Project: LCR
Location: 2nd draw 905 WEBSTER ST NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 23:00 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.062 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0006 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-014


SAMPLE INFORMATION

Sample Number: 1511169-014 Customer Sample Number: 3053170 Project: LCR
Location: 2nd draw 5337 BROAD BRANCH RD NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 5:20 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.024 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.048 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0014 mg/L	12/14/2015	Rhoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

12/15/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-015


SAMPLE INFORMATION

Sample Number: 1511169-015 Customer Sample Number: 3107833 Project: LCR
Location: 1st draw 2825 27TH ST NE Type: Dist.

Collection Date: 11/17/2015 Collection Time: 5:20 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.013 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.048 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0004 mg/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-016


SAMPLE INFORMATION

Sample Number: 1511169-016 Customer Sample Number: 3107833 Project: LCR
Location: 2nd draw 2825 27TH ST NE Type: Dist.

Collection Date: 11/17/2015 Collection Time: 5:22 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.021 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.019 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0025 mg/L	12/14/2015	Rhoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-017

SAMPLE INFORMATION

Sample Number: 1511169-017 Customer Sample Number: 3099415 Project: LCR
Location: 1st draw 1119 C ST NE Type: Dist.

Collection Date: 11/18/2015 Collection Time: 5:50 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.023 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.017 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-018

SAMPLE INFORMATION

Sample Number: 1511169-018 Customer Sample Number: 3099415 Project: LCR
Location: 2nd draw 1119 C ST NE Type: Dist.

Collection Date: 11/18/2015 Collection Time: 5:54 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.158 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.013 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-019

SAMPLE INFORMATION

Sample Number: 1511169-019 Customer Sample Number: 3035200 Project: LCR
Location: 1st draw 3205 38TH ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.011 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.014 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0030 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-020

SAMPLE INFORMATION

Sample Number: 1511169-020 Customer Sample Number: 3035200 Project: LCR
Location: 2nd draw 3205 38TH ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 7:49 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.011 mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0042 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511169-022

SAMPLE INFORMATION

Sample Number: 1511169-022 Customer Sample Number: 3078672 Project: LCR
Location: 2nd draw 1632 T ST SE Type: Dist.

Collection Date: 11/18/2015 Collection Time: 19:06 Sampler: HOME OWNER Received Date and Time: 11/23/2015 9:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	Rhoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.011 mg/L	12/14/2015	Rhoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0008 mg/L	12/14/2015	Rhoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-001

SAMPLE INFORMATION

Sample Number: 1511180-001 Customer Sample Number: 3047670 Project: LCR
Location: 1st draw 7755 16TH ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.134 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.031 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0017 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-002

SAMPLE INFORMATION

Sample Number: 1511180-002 Customer Sample Number: 3047670 Project: LCR
Location: 2nd draw 7755 16TH ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 7:12 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.099 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.009 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-003

SAMPLE INFORMATION

Sample Number: 1511180-003 Customer Sample Number: 3020802 Project: LCR
Location: 1st draw 3920 5TH ST NW Type: Dist.

Collection Date: 11/19/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.017 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.016 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-004

SAMPLE INFORMATION

Sample Number: 1511180-004 Customer Sample Number: 3020802 Project: LCR
Location: 2nd draw 3920 5TH ST NW Type: Dist.

Collection Date: 11/19/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.015 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.008 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-005

SAMPLE INFORMATION

Sample Number: 1511180-005 Customer Sample Number: 3027337 Project: LCR
Location: 1st draw 6409 7TH ST NW Type: Dist.

Collection Date: 11/17/2015 Collection Time: 5:28 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.079 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-007

SAMPLE INFORMATION

Sample Number: 1511180-007 Customer Sample Number: 3028083 Project: LCR
Location: 1st draw 1425 VARNUM ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.040 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0020 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-008


SAMPLE INFORMATION

Sample Number: 1511180-008 Customer Sample Number: 3028083 Project: LCR
Location: 2nd draw 1425 VARNUM ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.039 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.010 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0023 mg/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-009


SAMPLE INFORMATION

Sample Number: 1511180-009 Customer Sample Number: 3027584 Project: LCR
Location: 1st draw 1505 CRITTENDEN ST NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 23:00 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.018 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.079 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0011 mg/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-010


SAMPLE INFORMATION

Sample Number: 1511180-010 Customer Sample Number: 3103637 Project: LCR
Location: 1st draw 1018 JACKSON ST NE Type: Dist.

Collection Date: 11/23/2015 Collection Time: 6:05 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.069 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:  12/15/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-011

SAMPLE INFORMATION

Sample Number: 1511180-011 Customer Sample Number: 3103637 Project: LCR
Location: 2nd draw 1018 JACKSON ST NE Type: Dist.

Collection Date: 11/23/2015 Collection Time: 6:05 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.022 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0005 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511180-013

SAMPLE INFORMATION

Sample Number: 1511180-013 Customer Sample Number: 3018343 Project: LCR
Location: 2nd draw 14 CHANNING ST. NW Type: Dist.

Collection Date: 11/18/2015 Collection Time: 18:53 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:38 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.025 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0012 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512041-001

SAMPLE INFORMATION

Sample Number: 1512041-001 Customer Sample Number: 3035968 Project: LCR
Location: 1st draw 3414 LOWELL ST NW Type: Dist.

Collection Date: 11/23/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.171 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512041-002

SAMPLE INFORMATION

Sample Number: 1512041-002 Customer Sample Number: 3035968 Project: LCR
Location: 2nd draw 3414 LOWELL ST NW Type: Dist.

Collection Date: 11/23/2015 Collection Time: 7:25 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.075 mg/L	12/14/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.023 mg/L	12/14/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0009 mg/L	12/14/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

Attachment 2

Other Additional Non-Regulated Monitoring Data

Customer Service Samples

DC Water operates a program where customers request a lead sampling kit on an annual basis. The kit comes with bottles and instructions on how to take first and second draw samples. Customers collect their own samples and contact DC Water to deliver the bottles to the Washington Aqueduct. Results are then reported back to the customer through DC Water's Customer Service Program.

This attached sample analysis data contains personal information of DC Water's customers, such as names and home addresses, the disclosure of which would constitute a violation of D.C. Code § 2-534(a)(2) and 5 U.S.C. § 552(b)(6). If EPA is requested to produce the sampling analysis data in whole or in part, in order to maintain confidentiality, the personal information must be redacted from the documents produced.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-001

SAMPLE INFORMATION

Sample Number: 1506171-001 Customer Sample Number: 3049356 Program: DS
Location: 1st Draw 1309 KENNEDY ST NW Type: Dist.


Collection Date: 6/8/2015 Collection Time: 18:30 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.2 ug/L	7/17/2015	RHoffa

Comment: Sample was received at the laboratory beyond the 14-day preservation holding time as specified in the method.

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-002

SAMPLE INFORMATION

Sample Number: 1506171-002 Customer Sample Number: 3049356 Program: DS
Location: 2nd Draw 1309 KENNEDY ST NW Type: Dist.


Collection Date: 6/8/2015 Collection Time: 18:30 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.7 ug/L	7/17/2015	RHoffa

Comment: Sample was received at the laboratory beyond the 14-day preservation holding time as specified in the method.

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-007

SAMPLE INFORMATION

Sample Number: 1506171-007 Customer Sample Number: 3037675 Program: DS
Location: 1st Draw 3128 PATTERSON PL NW Type: Dist.

Collection Date: 6/16/2015 Collection Time: 7:12 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.8 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-008

SAMPLE INFORMATION


Sample Number: 1506171-008 Customer Sample Number: 3037675 Program: DS
Location: 2nd Draw 3128 PATTERSON PL NW Type: Dist.

Collection Date: 6/16/2015 Collection Time: 7:15 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-009

SAMPLE INFORMATION


Sample Number: 1506171-009 Customer Sample Number: 3072610 Program: DS
Location: 1st Draw 612 C ST, SE Type: Dist.

Collection Date: 6/16/2015 Collection Time: 8:15 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-010

SAMPLE INFORMATION


Sample Number: 1506171-010 Customer Sample Number: 3072610 Program: DS
Location: 2nd Draw 612 C ST, SE Type: Dist.

Collection Date: 6/16/2015 Collection Time: 8:22 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-014

SAMPLE INFORMATION


Sample Number: 1506171-014 Customer Sample Number: 3112563 Program: DS
Location: 1st Draw 1627 LYMAN PL NE Type: Dist.

Collection Date: 6/18/2015 Collection Time: 18:19 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-015

SAMPLE INFORMATION

Sample Number: 1506171-015 Customer Sample Number: 3112563 Program: DS
Location: 2nd Draw 1627 LYMAN PL NE Type: Dist.

Collection Date: 6/18/2015 Collection Time: 18:20 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-016


SAMPLE INFORMATION

Sample Number: 1506171-016 Customer Sample Number: 3063390 Program: DS
Location: 1st Draw 1508 MISSOURI AVE NW Type: Dist.
Collection Date: 6/19/2015 Collection Time: 6:33 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.2 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-017

SAMPLE INFORMATION

Sample Number: 1506171-017 Customer Sample Number: 3063390 Program: DS
Location: 2nd Draw 1508 MISSOURI AVE NW Type: Dist.
Collection Date: 6/19/2015 Collection Time: 6:36 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506181-003

SAMPLE INFORMATION


Sample Number: 1506181-003 Customer Sample Number: 3074185 Program: DS
Location: 1st draw 307 13TH ST SE Type: Dist.

Collection Date: 6/22/2015 Collection Time: 6:15 Sampler: HOME OWNER Received Date and Time: 6/25/2015 1:59:13 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506181-004

SAMPLE INFORMATION

Sample Number: 1506181-004 Customer Sample Number: 3074185 Program: DS
Location: 2nd draw 307 13TH ST SE Type: Dist.

Collection Date: 6/22/2015 Collection Time: 6:18 Sampler: HOME OWNER Received Date and Time: 6/25/2015 1:59:13 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506181-005

SAMPLE INFORMATION


Sample Number: 1506181-005 Customer Sample Number: 3114977 Program: DS
Location: 1st draw 1515 MICHIGAN AVE NE Type: Dist.

Collection Date: 6/23/2015 Collection Time: 13:45 Sampler: HOME OWNER Received Date and Time: 6/25/2015 1:59:13 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506181-006

SAMPLE INFORMATION


Sample Number: 1506181-006 Customer Sample Number: 3114977 Program: DS
Location: 2nd draw 1515 MICHIGAN AVE NE Type: Dist.

Collection Date: 6/23/2015 Collection Time: 13:48 Sampler: HOME OWNER Received Date and Time: 6/25/2015 1:59:13 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-001

SAMPLE INFORMATION

Sample Number: 1506203-001 Customer Sample Number: 3000257 Program: DS
Location: 1st draw 949 25TH ST NW Type: Dist.

Collection Date: 6/22/2015 Collection Time: 13:10 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-002

SAMPLE INFORMATION


Sample Number: 1506203-002 Customer Sample Number: 3000257 Program: DS
Location: 2nd draw 949 25TH ST NW Type: Dist.

Collection Date: 6/22/2015 Collection Time: 13:20 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-003

SAMPLE INFORMATION


Sample Number: 1506203-003 Customer Sample Number: 3072152 Program: DS
Location: 1st draw 921 5TH ST SE Type: Dist.

Collection Date: 6/22/2015 Collection Time: 17:18 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	2.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-004

SAMPLE INFORMATION

Sample Number: 1506203-004 Customer Sample Number: 3072152 Program: DS
Location: 2nd draw 921 5TH ST SE Type: Dist.

Collection Date: 6/22/2015 Collection Time: 17:21 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-005

SAMPLE INFORMATION


Sample Number: 1506203-005 Customer Sample Number: 3028349 Program: DS
Location: 1st draw 1407 SHEPHERD ST NW Type: Dist.

Collection Date: 6/25/2015 Collection Time: 7:15 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	2.4 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-006

SAMPLE INFORMATION


Sample Number: 1506203-006 Customer Sample Number: 3028349 Program: DS
Location: 2nd draw 1407 SHEPHERD ST NW Type: Dist.

Collection Date: 6/25/2015 Collection Time: 7:18 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.3 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-003

SAMPLE INFORMATION


Sample Number: 1507013-003 Customer Sample Number: 3049717 Program: DS
Location: 1st Draw 1327 INGRAHAM ST NW Type: Dist.

Collection Date: 6/24/2015 Collection Time: 6:18 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-004


SAMPLE INFORMATION

Sample Number: 1507013-004 Customer Sample Number: 3049717 Program: DS
Location: 2nd Draw 1327 INGRAHAM ST NW Type: Dist.
Collection Date: 6/24/2015 Collection Time: 6:21 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-005

SAMPLE INFORMATION


Sample Number: 1507013-005 Customer Sample Number: 3088439 Program: DS
Location: 1st Draw 3217 11TH PLACE SE Type: Dist.

Collection Date: 6/26/2015 Collection Time: 15:30 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-006

SAMPLE INFORMATION


Sample Number: 1507013-006 Customer Sample Number: 3088439 Program: DS
Location: 2nd Draw 3217 11TH PLACE SE Type: Dist.

Collection Date: 6/26/2015 Collection Time: 15:31 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-011

SAMPLE INFORMATION


Sample Number: 1507013-011 Customer Sample Number: 3050722 Program: DS
Location: 1st Draw 1333 JONQUIL ST NW Type: Dist.

Collection Date: 6/30/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	41.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-012

SAMPLE INFORMATION


Sample Number: 1507013-012 Customer Sample Number: 3050722 Program: DS
Location: 2nd Draw 1333 JONQUIL ST NW Type: Dist.

Collection Date: 6/30/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	2.0 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-013

SAMPLE INFORMATION


Sample Number: 1507013-013 Customer Sample Number: 3028532 Program: DS
Location: 1st Draw 1334 RANDOLPH ST NW Type: Dist.

Collection Date: 6/30/2015 Collection Time: 7:05 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.9 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-014

SAMPLE INFORMATION


Sample Number: 1507013-014 Customer Sample Number: 3028532 Program: DS
Location: 2nd Drwa 1334 RANDOLPH ST NW Type: Dist.

Collection Date: 6/30/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-015

SAMPLE INFORMATION

Sample Number: 1507013-015 Customer Sample Number: 3031327 Program: DS
Location: 1st Draw 2016 PIERCE MILL RD. NW Type: Dist.

Collection Date: 6/30/2015 Collection Time: 9:15 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-016

SAMPLE INFORMATION


Sample Number: 1507013-016 Customer Sample Number: 3031327 Program: DS
Location: 2nd Draw 2016 PIERCE MILL RD. NW Type: Dist.

Collection Date: 6/30/2015 Collection Time: 9:18 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	3.8 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-017

SAMPLE INFORMATION


Sample Number: 1507013-017 Customer Sample Number: 3072102 Program: DS
Location: 1st Draw 537 6TH ST SE Type: Dist.

Collection Date: 7/2/2015 Collection Time: 7:15 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-018

SAMPLE INFORMATION


Sample Number: 1507013-018 Customer Sample Number: 3072102 Program: DS
Location: 2nd Draw 537 6TH ST SE Type: Dist.

Collection Date: 7/2/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507065-001

SAMPLE INFORMATION


Sample Number: 1507065-001 Customer Sample Number: 3055603 Program: DS
Location: 1st Draw 5409 CATHEDRAL AVE., NW Type: Dist.

Collection Date: 7/6/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 7/10/2015 8:22:48 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	10.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507065-002

SAMPLE INFORMATION


Sample Number: 1507065-002 Customer Sample Number: 3055603 Program: DS
Location: 2nd Draw 5409 CATHEDRAL AVE., NW Type: Dist.

Collection Date: 7/6/2015 Collection Time: 6:31 Sampler: HOME OWNER Received Date and Time: 7/10/2015 8:22:48 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	5.1 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507065-003

SAMPLE INFORMATION


Sample Number: 1507065-003 Customer Sample Number: 3010155 Program: DS
Location: 1st Draw 2222 38TH ST., NW Type: Dist.

Collection Date: 7/7/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 7/10/2015 8:22:48 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507065-004

SAMPLE INFORMATION


Sample Number: 1507065-004 Customer Sample Number: 3010155 Program: DS
Location: 2nd Draw 2222 38TH ST., NW Type: Dist.

Collection Date: 7/7/2015 Collection Time: 7:03 Sampler: HOME OWNER Received Date and Time: 7/10/2015 8:22:48 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-003

SAMPLE INFORMATION


Sample Number: 1507086-003 Customer Sample Number: 3029614 Program: DS
Location: 1st draw 3661 13TH ST., NW Type: Dist.

Collection Date: 7/5/2015 Collection Time: 7:50 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-004

SAMPLE INFORMATION


Sample Number: 1507086-004 Customer Sample Number: 3029614 Program: DS
Location: 2nd draw 3661 13TH ST., NW Type: Dist.

Collection Date: 7/5/2015 Collection Time: 7:54 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-005


SAMPLE INFORMATION

Sample Number: 1507086-005 Customer Sample Number: 3056804 Program: DS
Location: 1st draw 413 QUINCY ST., NW Type: Dist.
Collection Date: 7/8/2015 Collection Time: 7:53 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	2.6 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-006

SAMPLE INFORMATION


Sample Number: 1507086-006 Customer Sample Number: 3056804 Program: DS
Location: 2nd draw 413 QUINCY ST., NW Type: Dist.

Collection Date: 7/8/2015 Collection Time: 7:56 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.9 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-009

SAMPLE INFORMATION


Sample Number: 1507086-009 Customer Sample Number: 3042114 Program: DS
Location: 1st draw 4410 DAVENPORT ST., NW Type: Dist.

Collection Date: 7/9/2015 Collection Time: 17:00 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-010

SAMPLE INFORMATION


Sample Number: 1507086-010 Customer Sample Number: 3042114 Program: DS
Location: 2nd draw 4410 DAVENPORT ST., NW Type: Dist.

Collection Date: 7/9/2015 Collection Time: 17:04 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-001

SAMPLE INFORMATION


Sample Number: 1507117-001 Customer Sample Number: 3029967 Program: DS
Location: 1st draw 905 MONROE ST. Type: Dist.

Collection Date: 7/15/2015 Collection Time: 6:40 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-002

SAMPLE INFORMATION


Sample Number: 1507117-002 Customer Sample Number: 3029967 Program: DS
Location: 2nd draw 905 MONROE ST. Type: Dist.

Collection Date: 7/15/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-003

SAMPLE INFORMATION


Sample Number: 1507117-003 Customer Sample Number: 3020470 Program: DS
Location: 1st draw 443 QUINCY ST., NW Type: Dist.

Collection Date: 7/10/2015 Collection Time: 18:17 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-004

SAMPLE INFORMATION


Sample Number: 1507117-004 Customer Sample Number: 3020470 Program: DS
Location: 2nd draw 443 QUINCY ST., NW Type: Dist.

Collection Date: 7/10/2015 Collection Time: 18:18 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	3.8 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-005

SAMPLE INFORMATION


Sample Number: 1507117-005 Customer Sample Number: 3031689 Program: DS
Location: 1st draw 1706 KILBOURNE PL Type: Dist.

Collection Date: 7/12/2015 Collection Time: 16:20 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-006


SAMPLE INFORMATION

Sample Number: 1507117-006 Customer Sample Number: 3031689 Program: DS
Location: 2nd draw 1706 KILBOURNE PL Type: Dist.

Collection Date: 7/12/2015 Collection Time: 16:25 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-007

SAMPLE INFORMATION


Sample Number: 1507117-007 Customer Sample Number: 3103049 Program: DS
Location: 1st draw 1705 2ND ST NE Type: Dist.

Collection Date: 7/14/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507117-008


SAMPLE INFORMATION

Sample Number: 1507117-008 Customer Sample Number: 3103049 Program: DS
Location: 2nd dfaw 1705 2ND ST NE Type: Dist.

Collection Date: 7/14/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 7/17/2015 9:31:37 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	2.2 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-003

SAMPLE INFORMATION


Sample Number: 1507166-003 Customer Sample Number: 3039610 Program: DS
Location: 1st draw 3427 OLIVER ST NW Type: Dist.

Collection Date: 7/22/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-004

SAMPLE INFORMATION


Sample Number: 1507166-004 Customer Sample Number: 3039610 Program: DS
Location: 2nd draw 3427 OLIVER ST NW Type: Dist.

Collection Date: 7/22/2015 Collection Time: 6:48 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	5.0 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-005

SAMPLE INFORMATION


Sample Number: 1507166-005 Customer Sample Number: 3108232 Program: DS
Location: 1st draw 227 ANACOSTIA AVE, NE Type: Dist.

Collection Date: 7/21/2015 Collection Time: 8:09 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-006

SAMPLE INFORMATION


Sample Number: 1507166-006 Customer Sample Number: 3108232 Program: DS
Location: 2nd draw 227 ANACOSTIA AVE, NE Type: Dist.

Collection Date: 7/21/2015 Collection Time: 8:12 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-007

SAMPLE INFORMATION


Sample Number: 1507166-007 Customer Sample Number: 3073803 Program: DS
Location: 1st draw 224 12TH ST SE Type: Dist.

Collection Date: 7/16/2015 Collection Time: 8:14 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-008


SAMPLE INFORMATION

Sample Number: 1507166-008 Customer Sample Number: 3073803 Program: DS
Location: 2nd draw 224 12TH ST SE Type: Dist.

Collection Date: 7/16/2015 Collection Time: 8:15 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-009

SAMPLE INFORMATION


Sample Number: 1507166-009 Customer Sample Number: 3104603 Program: DS
Location: 1st draw 4005 13TH ST NE Type: Dist.

Collection Date: 7/16/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	3.7 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-010

SAMPLE INFORMATION

Sample Number: 1507166-010 Customer Sample Number: 3104603 Program: DS
Location: 2nd draw 4005 13TH ST NE Type: Dist.

Collection Date: 7/16/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	2.8 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-015

SAMPLE INFORMATION


Sample Number: 1507166-015 Customer Sample Number: 3099549 Program: DS
Location: 1st draw 1243 E ST NE Type: Dist.

Collection Date: 7/17/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-016

SAMPLE INFORMATION


Sample Number: 1507166-016 Customer Sample Number: 3099549 Program: DS
Location: 2nd draw 1243 E ST NE Type: Dist.

Collection Date: 7/17/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507173-005

SAMPLE INFORMATION


Sample Number: 1507173-005 Customer Sample Number: 3036570 Program: DS
Location: 1st draw 3507 ALTON PL NW Type: Dist.

Collection Date: 7/21/2015 Collection Time: 5:44 Sampler: HOME OWNER Received Date and Time: 7/24/2015 12:36:25 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507173-006


SAMPLE INFORMATION

Sample Number: 1507173-006 Customer Sample Number: 3036570 Program: DS
Location: 2nd draw 3507 ALTON PL NW Type: Dist.

Collection Date: 7/21/2015 Collection Time: 5:47 Sampler: HOME OWNER Received Date and Time: 7/24/2015 12:36:25 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/13/2015
Report Number: LC-W1507209-005

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507209-005 Customer Sample Number: 3075190 Program: DS
Location: 1st draw 1435 A ST SE Type: Dist.
Collection Date: 7/28/2015 Collection Time: 6:20 Sampler: HOME OWNER Received Date and Time: 7/31/2015 10:04:11 AM Received By: MMoore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/13/2015
Report Number: LC-W1507209-006

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507209-006 Customer Sample Number: 3075190 Program: DS
Location: 2nd draw 1435 A ST SE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 6:25 Sampler: HOME OWNER Received Date and Time: 7/31/2015 10:04:11 AM Received By: MMoore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-001

SAMPLE INFORMATION

Sample Number: 1508048-001 Customer Sample Number: 3042327 Program: DS
Location: 1st draw 4204 YUMA ST NW Type: Dist.

Collection Date: 8/3/2015 Collection Time: 12:00 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-002

SAMPLE INFORMATION


Sample Number: 1508048-002 Customer Sample Number: 3042327 Program: DS
Location: 2nd draw 4204 YUMA ST NW Type: Dist.

Collection Date: 8/3/2015 Collection Time: 12:00 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-003

SAMPLE INFORMATION


Sample Number: 1508048-003 Customer Sample Number: 3099455 Program: DS
Location: 1st draw 1101 E STREET NE Type: Dist.

Collection Date: 8/3/2015 Collection Time: 6:10 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-004

SAMPLE INFORMATION


Sample Number: 1508048-004 Customer Sample Number: 3099455 Program: DS
Location: 2nd draw 1101 E STREET NE Type: Dist.

Collection Date: 8/3/2015 Collection Time: 6:12 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-005

SAMPLE INFORMATION


Sample Number: 1508048-005 Customer Sample Number: 3125628 Program: DS
Location: 1st draw 49 GIRARD ST NE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 19:19 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-006

SAMPLE INFORMATION


Sample Number: 1508048-006 Customer Sample Number: 3125628 Program: DS
Location: 2nd draw 49 GIRARD ST NE Type: Dist.

Collection Date: 7/28/2015 Collection Time: 19:21 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-007

SAMPLE INFORMATION

Sample Number: 1508048-007 Customer Sample Number: 3026730 Program: DS
Location: 1st draw 421 PEABODY ST NW Type: Dist.
Collection Date: 8/1/2015 Collection Time: 6:24 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508048-008

SAMPLE INFORMATION

Sample Number: 1508048-008 Customer Sample Number: 3026730 Program: DS
Location: 2nd draw 421 PEABODY ST NW Type: Dist.

Collection Date: 8/1/2015 Collection Time: 6:26 Sampler: HOME OWNER Received Date and Time: 8/7/2015 11:28:12 AM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-001

SAMPLE INFORMATION

Sample Number: 1508091-001 Customer Sample Number: Program: DS
Location: 1st draw 3508 WOODLEY RD NW Type: Dist.
Collection Date: 8/6/2015 Collection Time: 5:55 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-002

SAMPLE INFORMATION


Sample Number: 1508091-002 Customer Sample Number: Program: DS
Location: 2nd draw 3508 WOODLEY RD NW Type: Dist.

Collection Date: 8/6/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-003

SAMPLE INFORMATION


Sample Number: 1508091-003 Customer Sample Number: 3072695 Program: DS
Location: 1st draw 638 A ST SE Type: Dist.

Collection Date: 7/30/2015 Collection Time: 9:30 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-004

SAMPLE INFORMATION


Sample Number: 1508091-004 Customer Sample Number: 3072695 Program: DS
Location: 2nd draw 638 A ST SE Type: Dist.

Collection Date: 7/30/2015 Collection Time: 9:35 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-007

SAMPLE INFORMATION


Sample Number: 1508091-007 Customer Sample Number: 3126435 Program: DS
Location: 1st draw 425 20TH ST NE Type: Dist.

Collection Date: 8/5/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-008

SAMPLE INFORMATION


Sample Number: 1508091-008 Customer Sample Number: 3126435 Program: DS
Location: 2nd draw 425 20TH ST NE Type: Dist.

Collection Date: 8/5/2015 Collection Time: 7:48 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-009


SAMPLE INFORMATION

Sample Number: 1508091-009 Customer Sample Number: 3077340 Program: DS
Location: 1st draw 1727 41ST PL SE Type: Dist.
Collection Date: 8/5/2015 Collection Time: 18:47 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	3.8 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-010

SAMPLE INFORMATION


Sample Number: 1508091-010 Customer Sample Number: 3077340 Program: DS
Location: 2nd draw 1727 41ST PL SE Type: Dist.

Collection Date: 8/5/2015 Collection Time: 18:49 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-001

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508102-001 Customer Sample Number: 3112206 Program: DS
Location: 1st draw 1732 E ST NE Type: Dist.

Collection Date: 8/6/2015 Collection Time: 17:56 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/18/2018	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508102-002 Customer Sample Number: 3112206 Program: DS
Location: 2nd draw 1732 E ST NE Type: Dist.

Collection Date: 8/6/2015 Collection Time: 18:00 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-005

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508102-005 Customer Sample Number: 3004817 Program: DS
Location: 1st draw 1804 8TH ST NW Type: Dist.
Collection Date: 8/10/2015 Collection Time: 20:30 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/18/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-006

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508102-006 Customer Sample Number: 3004817 Program: DS
Location: 2nd draw 1804 8TH ST NW Type: Dist.

Collection Date: 8/10/2015 Collection Time: 20:35 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

8/19/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-009

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508102-009 Customer Sample Number: 3100578 Program: DS
Location: 1st draw 430 15TH ST NE Type: Dist.
Collection Date: 8/12/2015 Collection Time: 7:04 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/18/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-010

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508102-010 Customer Sample Number: 3100578 Program: DS
Location: 2nd draw 430 15TH ST NE Type: Dist.

Collection Date: 8/12/2015 Collection Time: 7:05 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-011

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508102-011 Customer Sample Number: 3131612 Program: DS
Location: 1st draw 903 BUTTERNUT ST NW Type: Dist.
Collection Date: 8/10/2015 Collection Time: 7:52 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-012

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508102-012 Customer Sample Number: 3131612 Program: DS
Location: 2nd draw 903 BUTTERNUT ST NW Type: Dist.
Collection Date: 8/10/2015 Collection Time: 7:57 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-017

SAMPLE INFORMATION

Sample Number: 1508149-017 Customer Sample Number: 3062882 Program: DS250
Location: 1st draw 1435 SHERIDAN ST. NW #203 Type: Dist.


Collection Date: 8/20/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-018

SAMPLE INFORMATION

Sample Number: 1508149-018 Customer Sample Number: 3062882 Program: DS250
Location: 2nd draw 1435 SHERIDAN ST. NW #203 Type: Dist.


Collection Date: 8/20/2015 Collection Time: 7:33 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-001

SAMPLE INFORMATION

Sample Number: 1508149-001 Customer Sample Number: 3043705 Program: DS
Location: 1st draw 4930 BUTTERWORTH PL NW Type: Dist.


Collection Date: 8/16/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-002

SAMPLE INFORMATION

Sample Number: 1508149-002 Customer Sample Number: 3043705 Program: DS
Location: 2nd draw 4930 BUTTERWORTH PL NW Type: Dist.


Collection Date: 8/16/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-003

SAMPLE INFORMATION

Sample Number: 1508149-003 Customer Sample Number: 3026840 Program: DS
Location: 1st draw 805 RITTENHOUSE ST NW Type: Dist.


Collection Date: 8/18/2015 Collection Time: 6:48 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-004

SAMPLE INFORMATION

Sample Number: 1508149-004 Customer Sample Number: 3026840 Program: DS
Location: 2nd draw 805 RITTENHOUSE ST NW Type: Dist.


Collection Date: 8/18/2015 Collection Time: 6:51 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-005

SAMPLE INFORMATION

Sample Number: 1508149-005 Customer Sample Number: 3057095 Program: DS
Location: 1st draw 5359 29TH ST NW Type: Dist.


Collection Date: 8/18/2015 Collection Time: 19:00 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.9 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-006

SAMPLE INFORMATION

Sample Number: 1508149-006 Customer Sample Number: 3057095 Program: DS
Location: 2nd draw 5359 29TH ST NW Type: Dist.


Collection Date: 8/18/2015 Collection Time: 19:05 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.0 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-007

SAMPLE INFORMATION

Sample Number: 1508149-007 Customer Sample Number: 3114884 Program: DS
Location: 1st draw 2315 13TH PL NE Type: Dist.


Collection Date: 8/13/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-008

SAMPLE INFORMATION

Sample Number: 1508149-008 Customer Sample Number: 3114884 Program: DS
Location: 2nd draw 2315 13TH PL NE Type: Dist.


Collection Date: 8/13/2015 Collection Time: 6:31 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-009

SAMPLE INFORMATION

Sample Number: 1508149-009 Customer Sample Number: 3000219 Program: DS
Location: 1st draw 2431 I ST NW Type: Dist.


Collection Date: 8/17/2015 Collection Time: 10:25 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-010

SAMPLE INFORMATION

Sample Number: 1508149-010 Customer Sample Number: 3000219 Program: DS
Location: 2nd draw 2431 I ST NW Type: Dist.


Collection Date: 8/17/2015 Collection Time: 10:35 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-011

SAMPLE INFORMATION

Sample Number: 1508149-011 Customer Sample Number: 3104977 Program: DS
Location: 1st draw 1509 IRVING ST NE Type: Dist.


Collection Date: 8/17/2015 Collection Time: 6:24 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.5 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-012

SAMPLE INFORMATION

Sample Number: 1508149-012 Customer Sample Number: 3104977 Program: DS
Location: 2nd draw 1509 IRVING ST NE Type: Dist.


Collection Date: 8/17/2015 Collection Time: 6:26 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	8.7 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-013

SAMPLE INFORMATION


Sample Number: 1508149-013 Customer Sample Number: 3056869 Program: DS
Location: 1st draw 4220 7TH ST NW Type: Dist.
Collection Date: 8/13/2015 Collection Time: 19:34 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.4 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-014

SAMPLE INFORMATION

Sample Number: 1508149-014 Customer Sample Number: 3056869 Program: DS
Location: 2nd draw 4220 7TH ST NW Type: Dist.


Collection Date: 8/13/2015 Collection Time: 19:37 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.6 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-015

SAMPLE INFORMATION

Sample Number: 1508149-015 Customer Sample Number: 3024526 Program: DS
Location: 1st draw 713 ONEIDA PL NW Type: Dist.


Collection Date: 8/17/2015 Collection Time: 9:01 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	4.2 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/27/2015
Report Number: LC-W1508149-016

SAMPLE INFORMATION

Sample Number: 1508149-016 Customer Sample Number: 3024526 Program: DS
Location: 2nd draw 713 ONEIDA PL NW Type: Dist.


Collection Date: 8/17/2015 Collection Time: 9:04 Sampler: HOME OWNER Received Date and Time: 8/21/2015 9:07:12 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	8/25/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/27/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-001

SAMPLE INFORMATION

Sample Number: 1508180-001 Customer Sample Number: 3126310 Program: DS
Location: 1st draw 530 8TH ST NE Type: Dist.

Collection Date: 8/16/2015 Collection Time: 9:03 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross


Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-002

SAMPLE INFORMATION


Sample Number: 1508180-002 Customer Sample Number: 3126310 Program: DS
Location: 2nd draw 530 8TH ST NE Type: Dist.

Collection Date: 8/16/2015 Collection Time: 9:04 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-003

SAMPLE INFORMATION


Sample Number: 1508180-003 Customer Sample Number: 3076327 Program: DS
Location: 1st draw 7706 D ST SE Type: Dist.

Collection Date: 8/19/2015 Collection Time: 5:45 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-004

SAMPLE INFORMATION


Sample Number: 1508180-004 Customer Sample Number: 3076327 Program: DS
Location: 2nd draw 7706 D ST SE Type: Dist.

Collection Date: 8/19/2015 Collection Time: 5:45 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-009

SAMPLE INFORMATION


Sample Number: 1508180-009 Customer Sample Number: 3099441 Program: DS
Location: 1st draw 1103 D ST NE Type: Dist.

Collection Date: 8/20/2015 Collection Time: 7:43 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-010

SAMPLE INFORMATION


Sample Number: 1508180-010 Customer Sample Number: 3099441 Program: DS
Location: 2nd draw 1103 D ST NE Type: Dist.

Collection Date: 8/20/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-001

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508196-001 Customer Sample Number: 3049356 Program: DS
Location: 1st draw 1309 KENNEDY ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 17:41 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.4 ug/L	9/10/2015	Tpasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508196-002 Customer Sample Number: 3049356 Program: DS
Location: 2nd draw 1309 KENNEDY ST NW Type: Dist.

Collection Date: 8/25/2015 Collection Time: 17:42 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.5 ug/L	9/10/2015	Tpasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-005

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508196-005 Customer Sample Number: 3020385 Program: DS
Location: 1st draw 729 QUEBEC PL NW Type: Dist.
Collection Date: 8/21/2015 Collection Time: 16:30 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	9/10/2015	Tpasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-006

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508196-006 Customer Sample Number: 3020385 Program: DS
Location: 2nd draw 729 QUEBEC PL NW Type: Dist.

Collection Date: 8/21/2015 Collection Time: 16:30 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	9/10/2015	Tpasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1509032-001

SAMPLE INFORMATION


Sample Number: 1509032-001 Customer Sample Number: 3009752 Program: DS
Location: 1st draw 2231 HALL PL NW Type: Dist.

Collection Date: 8/31/2015 Collection Time: 6:14 Sampler: HOME OWNER Received Date and Time: 9/4/2015 12:26:43 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	9/10/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1509032-002

SAMPLE INFORMATION


Sample Number: 1509032-002 Customer Sample Number: 3009752 Program: DS
Location: 2nd draw 2231 HALL PL NW Type: Dist.

Collection Date: 8/31/2015 Collection Time: 6:16 Sampler: HOME OWNER Received Date and Time: 9/4/2015 12:26:43 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.8 ug/L	9/10/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1509032-003

SAMPLE INFORMATION


Sample Number: 1509032-003 Customer Sample Number: 3075732 Program: DS
Location: 1st draw 1608 D ST SE Type: Dist.

Collection Date: 8/31/2015 Collection Time: 6:17 Sampler: HOME OWNER Received Date and Time: 9/4/2015 12:26:43 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	9/10/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1509032-004

SAMPLE INFORMATION


Sample Number: 1509032-004 Customer Sample Number: 3075732 Program: DS
Location: 2nd draw 1608 D ST SE Type: Dist.

Collection Date: 8/31/2015 Collection Time: 6:19 Sampler: HOME OWNER Received Date and Time: 9/4/2015 12:26:43 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.2 ug/L	9/10/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509076-001

SAMPLE INFORMATION

Sample Number: 1509076-001 Customer Sample Number: 3028118 Program: DS
Location: 1st draw 1510 WEBSTER ST NW Type: Dist.


Collection Date: 9/4/2015 Collection Time: 7:49 Sampler: HOME OWNER Received Date and Time: 9/10/2015 2:48:16 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	4.2 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509076-002

SAMPLE INFORMATION

Sample Number: 1509076-002 Customer Sample Number: 3028118 Program: DS
Location: 2nd draw 1510 WEBSTER ST NW Type: Dist.


Collection Date: 9/4/2015 Collection Time: 7:51 Sampler: HOME OWNER Received Date and Time: 9/10/2015 2:48:16 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	10.7 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509076-003

SAMPLE INFORMATION

Sample Number: 1509076-003 Customer Sample Number: 3104841 Program: DS
Location: 1st draw 3615 14TH ST NE Type: Dist.


Collection Date: 9/7/2015 Collection Time: 6:44 Sampler: HOME OWNER Received Date and Time: 9/10/2015 2:48:16 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509076-004

SAMPLE INFORMATION

Sample Number: 1509076-004 Customer Sample Number: 3104841 Program: DS
Location: 2nd draw 3615 14TH ST NE Type: Dist.


Collection Date: 9/7/2015 Collection Time: 6:46 Sampler: HOME OWNER Received Date and Time: 9/10/2015 2:48:16 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509076-005

SAMPLE INFORMATION

Sample Number: 1509076-005 Customer Sample Number: 3041578 Program: DS
Location: 1st draw 3608 35TH ST NW Type: Dist.


Collection Date: 9/8/2015 Collection Time: 19:37 Sampler: HOME OWNER Received Date and Time: 9/10/2015 2:48:16 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509076-006

SAMPLE INFORMATION

Sample Number: 1509076-006 Customer Sample Number: 3041578 Program: DS
Location: 2nd draw 3608 35TH ST NW Type: Dist.


Collection Date: 9/8/2015 Collection Time: 19:38 Sampler: HOME OWNER Received Date and Time: 9/10/2015 2:48:16 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-003

SAMPLE INFORMATION


Sample Number: 1509099-003 Customer Sample Number: 3031406 Program: DS
Location: 1st draw 1810 KILBOURNE PL NW Type: Dist.
Collection Date: 9/9/2015 Collection Time: 6:26 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-004

SAMPLE INFORMATION

Sample Number: 1509099-004 Customer Sample Number: 3031406 Program: DS
Location: 2nd draw 1810 KILBOURNE PL NW Type: Dist.


Collection Date: 9/9/2015 Collection Time: 6:29 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-005

SAMPLE INFORMATION

Sample Number: 1509099-005 Customer Sample Number: 3071700 Program: DS
Location: 1st draw 14 4TH ST SE Type: Dist.


Collection Date: 9/9/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-006

SAMPLE INFORMATION

Sample Number: 1509099-006 Customer Sample Number: 3071700 Program: DS
Location: 2nd draw 14 4TH ST SE Type: Dist.


Collection Date: 9/9/2015 Collection Time: 7:02 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-001

SAMPLE INFORMATION

Sample Number: 1509125-001 Customer Sample Number: 3057176 Program: DS
Location: 1st draw 303 TAYLOR ST NW Type: Dist.


Collection Date: 9/13/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.8 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-002

SAMPLE INFORMATION

Sample Number: 1509125-002 Customer Sample Number: 3057176 Program: DS
Location: 2nd draw 303 TAYLOR ST NW Type: Dist.


Collection Date: 9/13/2015 Collection Time: 7:03 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.9 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-003

SAMPLE INFORMATION


Sample Number: 1509125-003 Customer Sample Number: 3025771 Program: DS
Location: 1st draw 212 JEFFERSON ST NW Type: Dist.
Collection Date: 9/6/2015 Collection Time: 12:50 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.6 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-004

SAMPLE INFORMATION

Sample Number: 1509125-004 Customer Sample Number: 3025771 Program: DS
Location: 2nd draw 212 JEFFERSON ST NW Type: Dist.


Collection Date: 9/6/2015 Collection Time: 12:55 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-005

SAMPLE INFORMATION

Sample Number: 1509125-005 Customer Sample Number: 3102164 Program: DS
Location: 1st draw 1226 ORREN ST NE Type: Dist.


Collection Date: 9/13/2015 Collection Time: 5:13 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-006

SAMPLE INFORMATION

Sample Number: 1509125-006 Customer Sample Number: 3102164 Program: DS
Location: 2nd draw 1226 ORREN ST NE Type: Dist.


Collection Date: 9/13/2015 Collection Time: 5:27 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-007

SAMPLE INFORMATION

Sample Number: 1509125-007 Customer Sample Number: 3053727 Program: DS
Location: 1st draw 5222 NEBRASKA AVE NW Type: Dist.


Collection Date: 9/16/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-008

SAMPLE INFORMATION

Sample Number: 1509125-008 Customer Sample Number: 3053727 Program: DS
Location: 2nd draw 5222 NEBRASKA AVE NW Type: Dist.


Collection Date: 9/16/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-009

SAMPLE INFORMATION

Sample Number: 1509125-009 Customer Sample Number: 3055427 Program: DS
Location: 1st draw 4447 GREENWICH PKY NW Type: Dist.


Collection Date: 9/13/2015 Collection Time: 6:02 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.8 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-010

SAMPLE INFORMATION

Sample Number: 1509125-010 Customer Sample Number: 3055427 Program: DS
Location: 2nd draw 4447 GREENWICH PKY NW Type: Dist.


Collection Date: 9/13/2015 Collection Time: 6:05 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-011

SAMPLE INFORMATION

Sample Number: 1509125-011 Customer Sample Number: 3040808 Program: DS
Location: 1st draw 5032 41ST ST NW Type: Dist.


Collection Date: 9/8/2015 Collection Time: 5:33 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.0 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-012

SAMPLE INFORMATION

Sample Number: 1509125-012 Customer Sample Number: 3040808 Program: DS
Location: 2nd draw 5032 41ST ST NW Type: Dist.


Collection Date: 9/8/2015 Collection Time: 5:34 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	11.5 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-013

SAMPLE INFORMATION

Sample Number: 1509125-013 Customer Sample Number: 3071603 Program: DS
Location: 1st draw 207 C ST SE Type: Dist.


Collection Date: 9/13/2015 Collection Time: 10:45 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-014

SAMPLE INFORMATION

Sample Number: 1509125-014 Customer Sample Number: 3071603 Program: DS
Location: 2nd draw 207 C ST SE Type: Dist.


Collection Date: 9/13/2015 Collection Time: 10:48 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-015

SAMPLE INFORMATION

Sample Number: 1509125-015 Customer Sample Number: 3056003 Program: DS
Location: 1st draw 5100 KLINGLE ST NW Type: Dist.


Collection Date: 9/11/2015 Collection Time: 18:25 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-016

SAMPLE INFORMATION

Sample Number: 1509125-016 Customer Sample Number: 3056003 Program: DS
Location: 2nd draw 5100 KLINGLE ST NW Type: Dist.


Collection Date: 9/11/2015 Collection Time: 18:27 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-017

SAMPLE INFORMATION

Sample Number: 1509125-017 Customer Sample Number: 3009943 Program: DS
Location: 1st draw 2108 37TH ST NW Type: Dist.


Collection Date: 9/15/2015 Collection Time: 7:21 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.1 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509125-018

SAMPLE INFORMATION

Sample Number: 1509125-018 Customer Sample Number: 3009943 Program: DS
Location: 2nd draw 2108 37TH ST NW Type: Dist.


Collection Date: 9/15/2015 Collection Time: 7:24 Sampler: HOME OWNER Received Date and Time: 9/17/2015 1:48:12 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509180-001

SAMPLE INFORMATION

Sample Number: 1509180-001 Customer Sample Number: 3078774 Program: DS
Location: 1st Draw 1927 "S" ST S.E. Type: Dist.


Collection Date: 9/22/2015 Collection Time: 8:30 Sampler: HOME OWNER Received Date and Time: 9/25/2015 1:36:46 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509180-002

SAMPLE INFORMATION

Sample Number: 1509180-002 Customer Sample Number: 3078774 Program: DS
Location: 2nd Draw 1927 "S" ST S.E. Type: Dist.


Collection Date: 9/22/2015 Collection Time: 8:33 Sampler: HOME OWNER Received Date and Time: 9/25/2015 1:36:46 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.2 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509180-005

SAMPLE INFORMATION


Sample Number: 1509180-005 Customer Sample Number: 3007821 Program: DS
Location: 1st Draw 1650 29TH ST, NW Type: Dist.
Collection Date: 9/23/2015 Collection Time: 5:00 Sampler: HOME OWNER Received Date and Time: 9/25/2015 1:36:46 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.8 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509180-006

SAMPLE INFORMATION

Sample Number: 1509180-006 Customer Sample Number: 3007821 Program: DS
Location: 2nd Draw 1650 29TH ST, NW Type: Dist.


Collection Date: 9/23/2015 Collection Time: 5:02 Sampler: HOME OWNER Received Date and Time: 9/25/2015 1:36:46 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	8.0 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1510011-003

SAMPLE INFORMATION

Sample Number: 1510011-003 Customer Sample Number: 3097850 Program: DS
Location: 1st draw 212 A ST NE Type: Dist.


Collection Date: 9/28/2015 Collection Time: 5:55 Sampler: HOME OWNER Received Date and Time: 10/2/2015 10:56:56 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1510011-004

SAMPLE INFORMATION

Sample Number: 1510011-004 Customer Sample Number: 3097850 Program: DS
Location: 2nd draw 212 A ST NE Type: Dist.


Collection Date: 9/28/2015 Collection Time: 5:59 Sampler: HOME OWNER Received Date and Time: 10/2/2015 10:56:56 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-003 Customer Sample Number: 3021804
 Location: 1st Draw 4604 4th St NW Program: DS
 Collection Date: 9/30/2015 Sampler: HOME OWNER Received Date: 10/5/2015 Received by: MChicoine
 Collection Time: 8:00:00 AM Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.8 µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-004 Customer Sample Number: 3021804
 Location: 2nd Draw 4604 4th St NW Program: DS
 Collection Date: 9/30/2015 Sampler: HOME OWNER Received Date: 10/5/2015 Received by: MChicoine
 Collection Time: 8:00:00 AM Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.2 µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-005 Customer Sample Number: 3075523
 Location: 1st draw 833 Kentucky Ave SE Program: DS
 Collection Date: 9/30/2015 Sampler: HOME OWNER Received Date: 10/5/2015 Received by: MChicoine
 Collection Time: 9:03:00 PM Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-006 Customer Sample Number: 3075523
 Location: 2nd draw 833 Kentucky Ave SE Program: DS
 Collection Date: 9/30/2015 Sampler: HOME OWNER Received Date: 10/5/2015 Received by: MChicoine
 Collection Time: 9:05:00 PM Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-001 Customer Sample Number: 3121499
 Location: 1st Draw 220 Tennessee Ave NE Program: DS
 Collection Date: 9/30/2015 Sampler: HOME OWNER Received Date: 10/9/2015 Received by: MChicoine
 Collection Time: 6:30:00 PM Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.2 µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-002 Customer Sample Number: 3121499
 Location: 2nd Draw 220 Tennessee Ave NE Program: DS
 Collection Date: 9/30/2015 Sampler: HOME OWNER Received Date: 10/9/2015 Received by: MChicoine
 Collection Time: 6:31:00 PM Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.8 µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-005 Customer Sample Number: 3086632
 Location: 1st Draw 507 East Capitol ST. SE Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/9/2015 Received by: MChicoine
 Collection Time: 6:27:00 AM Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-006 Customer Sample Number: 3086632
 Location: 2nd Draw 507 East Capitol ST. SE Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/9/2015 Received by: MChicoine
 Collection Time: 6:33:00 AM Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-007 Customer Sample Number: 3022202
 Location: 1st Draw 4708 9TH ST. NW Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/9/2015 Received by: MChicoine
 Collection Time: 8:30:00 AM Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	2.3 µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-008 Customer Sample Number: 3022202
 Location: 2nd Draw 4708 9TH ST. NW Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/9/2015 Received by: MChicoine
 Collection Time: 8:30:00 AM Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	3.6 µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510088

Sample Number: 1510088-001 Customer Sample Number: 3104438
 Location: 1st draw 1303 Quincy St NE Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/14/2015 Received by: JCross
 Collection Time: 6:45:00 AM Received Time: 3:03:05 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.2 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510088

Sample Number: 1510088-002 Customer Sample Number: 3104438
 Location: 2nd draw 1303 Quincy St NE Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/14/2015 Received by: JCross
 Collection Time: 6:52:00 AM Received Time: 3:03:05 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.4 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510088

Sample Number: 1510088-003 Customer Sample Number: 3004934
 Location: 1st Draw 706 Rhode Island Ave NW Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/14/2015 Received by: JCross
 Collection Time: 6:00:00 AM Received Time: 3:03:05 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.4 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510088

Sample Number: 1510088-004 Customer Sample Number: 3004934
 Location: 2nd Draw 706 Rhode Island Ave NW Program: DS
 Collection Date: 10/5/2015 Sampler: HOME OWNER Received Date: 10/14/2015 Received by: JCross
 Collection Time: 6:00:00 AM Received Time: 3:03:05 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.5 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510088

Sample Number: 1510088-005 Customer Sample Number: 3076043
 Location: 1st Draw 1745 D St SE Program: DS
 Collection Date: 10/9/2015 Sampler: HOME OWNER Received Date: 10/14/2015 Received by: JCross
 Collection Time: 7:00:00 AM Received Time: 3:03:05 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510088

Sample Number: 1510088-006 Customer Sample Number: 3076043
 Location: 2nd Draw 1745 D St SE Program: DS
 Collection Date: 10/9/2015 Sampler: HOME OWNER Received Date: 10/14/2015 Received by: JCross
 Collection Time: 7:02:00 AM Received Time: 3:03:05 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-001 Customer Sample Number: 3122809
 Location: 1st draw 614 9th St. NE Program: DS
 Collection Date: 10/14/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 5:15:00 PM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	3.7 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-002 Customer Sample Number: 3122809
 Location: 2nd draw 614 9th St. NE Program: DS
 Collection Date: 10/14/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 5:18:00 PM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.7 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-003 Customer Sample Number: 3049781
 Location: 1st Draw 1318 Ingraham St. NW Program: DS
 Collection Date: 10/11/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 8:00:00 AM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.4 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-004 Customer Sample Number: 3049781
 Location: 2nd Draw 1318 Ingraham St. NW Program: DS
 Collection Date: 10/11/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 8:05:00 AM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.8 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-005 Customer Sample Number: 3001883
 Location: 1st Draw 1612 V St. NW Program: DS
 Collection Date: 10/13/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 6:49:00 AM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-006 Customer Sample Number: 3001883
 Location: 2nd Draw 1612 V St. NW Program: DS
 Collection Date: 10/13/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 6:51:00 AM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-011 Customer Sample Number: 3125449
 Location: 1st Draw 161 V St, NE Program: DS
 Collection Date: 10/13/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 7:11:00 AM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.0 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-012 Customer Sample Number: 3125449
 Location: 2nd Draw 161 V St, NE Program: DS
 Collection Date: 10/13/2015 Sampler: HOME OWNER Received Date: 10/16/2015 Received by: BSmith
 Collection Time: 7:13:00 AM Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	2.0 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-001 Customer Sample Number: 3042875
 Location: 1st Draw 4920 47th St NW Program: DS
 Collection Date: 10/9/2015 Sampler: HOME OWNER Received Date: 10/23/2015 Received by: MDillard
 Collection Time: 4:20:00 PM Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.4 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-002 Customer Sample Number: 3042875
 Location: 2nd Draw 4920 47th St NW Program: DS
 Collection Date: 10/9/2015 Sampler: HOME OWNER Received Date: 10/23/2015 Received by: MDillard
 Collection Time: 4:24:00 PM Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-003 Customer Sample Number: 3035816
 Location: 1st Draw 2721 Woodley PI NW Program: DS
 Collection Date: 10/16/2015 Sampler: HOME OWNER Received Date: 10/23/2015 Received by: MDillard
 Collection Time: 5:50:00 AM Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.4 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-004 Customer Sample Number: 3035816
 Location: 2nd Draw 2721 Woodley PI NW Program: DS
 Collection Date: 10/16/2015 Sampler: HOME OWNER Received Date: 10/23/2015 Received by: MDillard
 Collection Time: 5:52:00 AM Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-007 Customer Sample Number: 3145448
 Location: 1st Draw 1811 Varnum St NW Program: DS
 Collection Date: 10/19/2015 Sampler: HOME OWNER Received Date: 10/23/2015 Received by: MDillard
 Collection Time: 1:30:00 PM Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-008 Customer Sample Number: 3145448
 Location: 2nd Draw 1811 Varnum St NW Program: DS
 Collection Date: 10/19/2015 Sampler: HOME OWNER Received Date: 10/23/2015 Received by: MDillard
 Collection Time: 1:32:00 PM Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-001 Customer Sample Number: 3126390
 Location: 1st draw 521 7th St NE Program: DS
 Collection Date: 10/25/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 8:32:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.7 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-002 Customer Sample Number: 3126390
 Location: 2nd draw 521 7th St NE Program: DS
 Collection Date: 10/25/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 8:34:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-011 Customer Sample Number: 3028626
 Location: 1st Draw 1314 Shepherd St NW Program: DS
 Collection Date: 10/22/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 7:00:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.7 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-012 Customer Sample Number: 3028626
 Location: 2nd Draw 1314 Shepherd St NW Program: DS
 Collection Date: 10/22/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 7:03:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	8.1 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-015 Customer Sample Number: 3106842
 Location: 1st Draw 3302 24th St NE Program: DS
 Collection Date: 10/21/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 7:00:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.2 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-016 Customer Sample Number: 3106842
 Location: 2nd Draw 3302 24th St NE Program: DS
 Collection Date: 10/21/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 7:00:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.7 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-017 Customer Sample Number: 3099454
 Location: 1st Draw 437 11th St NE Program: DS
 Collection Date: 10/26/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 5:30:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	2.1 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-018 Customer Sample Number: 3099454
 Location: 2nd Draw 437 11th St NE Program: DS
 Collection Date: 10/26/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 5:30:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	3.7 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-019 Customer Sample Number: 3108396
 Location: 1st draw 3442 Baxter St NE Program: DS
 Collection Date: 10/26/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 6:30:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-020 Customer Sample Number: 3108396
 Location: 2nd draw 3442 Baxter St NE Program: DS
 Collection Date: 10/26/2015 Sampler: HOME OWNER Received Date: 10/29/2015 Received by: JCross
 Collection Time: 6:30:00 AM Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-001

SAMPLE INFORMATION

Sample Number: 1511028-001 Customer Sample Number: 3007477 Program: DS
Location: 1st draw 2818 P ST NW Type: Dist.


Collection Date: 10/29/2015 Collection Time: 6:50 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-002

SAMPLE INFORMATION

Sample Number: 1511028-002 Customer Sample Number: 3007477 Program: DS
Location: 2nd draw 2818 P ST NW Type: Dist.


Collection Date: 10/29/2015 Collection Time: 6:53 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-003

SAMPLE INFORMATION

Sample Number: 1511028-003 Customer Sample Number: 3051245 Program: DS
Location: 1st draw 27 ROCK CREEK CH RD NW Type: Dist.


Collection Date: 10/30/2015 Collection Time: 7:11 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.2 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-004

SAMPLE INFORMATION

Sample Number: 1511028-004 Customer Sample Number: 3051245 Program: DS
Location: 2nd draw 27 ROCK CREEK CH RD NW Type: Dist.


Collection Date: 10/30/2015 Collection Time: 7:15 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-007

SAMPLE INFORMATION

Sample Number: 1511028-007 Customer Sample Number: 3049783 Program: DS
Location: 1st draw 5305 14TH ST NW Type: Dist.


Collection Date: 11/1/2015 Collection Time: 8:19 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-008

SAMPLE INFORMATION

Sample Number: 1511028-008 Customer Sample Number: 3049783 Program: DS
Location: 2nd draw 5305 14TH ST NW Type: Dist.


Collection Date: 11/1/2015 Collection Time: 8:20 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.2 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-009

SAMPLE INFORMATION

Sample Number: 1511028-009 Customer Sample Number: 3127688 Program: DS
Location: 1st draw 400 G ST NE Type: Dist.


Collection Date: 11/1/2015 Collection Time: 16:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-010

SAMPLE INFORMATION

Sample Number: 1511028-010 Customer Sample Number: 3127688 Program: DS
Location: 2nd draw 400 G ST NE Type: Dist.


Collection Date: 11/1/2015 Collection Time: 16:05 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-011

SAMPLE INFORMATION

Sample Number: 1511028-011 Customer Sample Number: 3041220 Program: DS
Location: 1st draw 3820 ALBEMARLE ST NW Type: Dist.


Collection Date: 11/1/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.4 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-012

SAMPLE INFORMATION

Sample Number: 1511028-012 Customer Sample Number: 3041220 Program: DS
Location: 2nd draw 3820 ALBEMARLE ST NW Type: Dist.


Collection Date: 11/1/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	7.3 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-013

SAMPLE INFORMATION

Sample Number: 1511028-013 Customer Sample Number: 3075910 Program: DS
Location: 1st draw 1827 A ST SE Type: Dist.


Collection Date: 10/28/2015 Collection Time: 11:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-014

SAMPLE INFORMATION

Sample Number: 1511028-014 Customer Sample Number: 3075910 Program: DS
Location: 2nd draw 1827 A ST SE Type: Dist.


Collection Date: 10/28/2015 Collection Time: 11:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-015

SAMPLE INFORMATION

Sample Number: 1511028-015 Customer Sample Number: 3005891 Program: DS
Location: 1st draw 432 RIDGE ST NW Type: Dist.


Collection Date: 11/2/2015 Collection Time: 7:42 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.2 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-016

SAMPLE INFORMATION

Sample Number: 1511028-016 Customer Sample Number: 3005891 Program: DS
Location: 2nd draw 432 RIDGE ST NW Type: Dist.


Collection Date: 11/2/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-017

SAMPLE INFORMATION

Sample Number: 1511028-017 Customer Sample Number: 3030925 Program: DS
Location: 1st draw 1741 PARK RD NW Type: Dist.


Collection Date: 11/2/2015 Collection Time: 6:05 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.0 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-018

SAMPLE INFORMATION

Sample Number: 1511028-018 Customer Sample Number: 3030925 Program: DS
Location: 2nd draw 1741 PARK RD NW Type: Dist.


Collection Date: 11/2/2015 Collection Time: 6:08 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.7 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-007

SAMPLE INFORMATION


Sample Number: 1511070-007 Customer Sample Number: 3114118 Program: DS
Location: 1st draw 4603 N. CAPITOL ST NE Type: Dist.
Collection Date: 11/4/2015 Collection Time: 5:03 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.2 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-008


SAMPLE INFORMATION

Sample Number: 1511070-008 Customer Sample Number: 3114118 Program: DS
Location: 2nd draw 4603 N. CAPITOL ST NE Type: Dist.
Collection Date: 11/4/2015 Collection Time: 5:04 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-009

SAMPLE INFORMATION


Sample Number: 1511070-009 Customer Sample Number: 3001637 Program: DS
Location: 1st draw 1728 Q ST NW Type: Dist.
Collection Date: 11/2/2015 Collection Time: 18:35 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.7 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-010

SAMPLE INFORMATION

Sample Number: 1511070-010 Customer Sample Number: 3001637 Program: DS
Location: 2nd draw 1728 Q ST NW Type: Dist.


Collection Date: 11/2/2015 Collection Time: 18:40 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	4.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-011

SAMPLE INFORMATION


Sample Number: 1511070-011 Customer Sample Number: 3027206 Program: DS
Location: 1st draw 809 TEWKESBURY PL NW Type: Dist.
Collection Date: 11/1/2015 Collection Time: 6:15 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	15.5 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-012

SAMPLE INFORMATION

Sample Number: 1511070-012 Customer Sample Number: 3027206 Program: DS
Location: 2nd draw 809 TEWKESBURY PL NW Type: Dist.


Collection Date: 11/1/2015 Collection Time: 6:16 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-001

SAMPLE INFORMATION


Sample Number: 1511099-001 Customer Sample Number: 3074430 Program: DS
Location: 1st draw 242 KENTUCKY AVE SE Type: Dist.
Collection Date: 11/6/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.8 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-002

SAMPLE INFORMATION

Sample Number: 1511099-002 Customer Sample Number: 3074430 Program: DS
Location: 2nd draw 242 KENTUCKY AVE SE Type: Dist.


Collection Date: 11/6/2015 Collection Time: 17:32 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.2 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-003

SAMPLE INFORMATION

Sample Number: 1511099-003 Customer Sample Number: 3035724 Program: DS
Location: 1st draw 2813 28TH ST NW Type: Dist.


Collection Date: 11/6/2015 Collection Time: 17:59 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-004

SAMPLE INFORMATION

Sample Number: 1511099-004 Customer Sample Number: 3035724 Program: DS
Location: 2nd draw 2813 28TH ST NW Type: Dist.


Collection Date: 11/6/2015 Collection Time: 18:02 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	8.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-005

SAMPLE INFORMATION


Sample Number: 1511099-005 Customer Sample Number: 3076003 Program: DS
Location: 1st draw 1603 E ST SE Type: Dist.
Collection Date: 11/9/2015 Collection Time: 6:18 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.7 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-006

SAMPLE INFORMATION


Sample Number: 1511099-006 Customer Sample Number: 3076003 Program: DS
Location: 2nd draw 1603 E ST SE Type: Dist.
Collection Date: 11/9/2015 Collection Time: 6:20 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-009

SAMPLE INFORMATION


Sample Number: 1511099-009 Customer Sample Number: 3055488 Program: DS
Location: 1st draw 4217 1/2 RIVER RD NW Type: Dist.
Collection Date: 11/9/2015 Collection Time: 7:03 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-010

SAMPLE INFORMATION


Sample Number: 1511099-010 Customer Sample Number: 3055488 Program: DS
Location: 2nd draw 4217 1/2 RIVER RD NW Type: Dist.
Collection Date: 11/9/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511129-001

SAMPLE INFORMATION


Sample Number: 1511129-001 Customer Sample Number: 3059786 Program: DS
Location: 1st draw 3547 13TH ST NW Type: Dist.
Collection Date: 11/9/2015 Collection Time: 5:20 Sampler: HOME OWNER Received Date and Time: 11/17/2015 11:49:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.5 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511129-002

SAMPLE INFORMATION

Sample Number: 1511129-002 Customer Sample Number: 3059786 Program: DS
Location: 2nd draw 3547 13TH ST NW Type: Dist.


Collection Date: 11/9/2015 Collection Time: 5:25 Sampler: HOME OWNER Received Date and Time: 11/17/2015 11:49:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-001

SAMPLE INFORMATION


Sample Number: 1511149-001 Customer Sample Number: 3031175 Program: DS
Location: 1st draw 3232 19TH ST NW Type: Dist.
Collection Date: 11/16/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-002

SAMPLE INFORMATION

Sample Number: 1511149-002 Customer Sample Number: 3031175 Program: DS
Location: 2nd draw 3232 19TH ST NW Type: Dist.


Collection Date: 11/16/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-003

SAMPLE INFORMATION


Sample Number: 1511149-003 Customer Sample Number: 3022948 Program: DS
Location: 1st draw 624 GALLATIN ST NW Type: Dist.
Collection Date: 11/13/2015 Collection Time: 19:00 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-004

SAMPLE INFORMATION

Sample Number: 1511149-004 Customer Sample Number: 3022948 Program: DS
Location: 2nd draw 624 GALLATIN ST NW Type: Dist.


Collection Date: 11/13/2015 Collection Time: 19:10 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.7 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-003

SAMPLE INFORMATION


Sample Number: 1511184-003 Customer Sample Number: 3087211 Program: DS
Location: 1st draw 1311 K ST SE #4 Type: Dist.
Collection Date: 11/16/2015 Collection Time: 15:38 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-004

SAMPLE INFORMATION

Sample Number: 1511184-004 Customer Sample Number: 3087211 Program: DS
Location: 2nd draw 1311 K ST SE #4 Type: Dist.


Collection Date: 11/16/2015 Collection Time: 15:40 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-005

SAMPLE INFORMATION


Sample Number: 1511184-005 Customer Sample Number: 3041657 Program: DS
Location: 1st draw 3525 SPRINGFIELD LANE NW Type: Dist.
Collection Date: 11/23/2015 Collection Time: 9:40 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-006

SAMPLE INFORMATION


Sample Number: 1511184-006 Customer Sample Number: 3041657 Program: DS
Location: 2nd draw 3525 SPRINGFIELD LANE NW Type: Dist.
Collection Date: 11/23/2015 Collection Time: 9:42 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-007

SAMPLE INFORMATION


Sample Number: 1511184-007 Customer Sample Number: 3001270 Program: DS
Location: 1st draw 1753 U ST NW Type: Dist.
Collection Date: 11/23/2015 Collection Time: 6:40 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-008

SAMPLE INFORMATION

Sample Number: 1511184-008 Customer Sample Number: 3001270 Program: DS
Location: 2nd draw 1753 U ST NW Type: Dist.


Collection Date: 11/23/2015 Collection Time: 6:42 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-001

SAMPLE INFORMATION


Sample Number: 1512042-001 Customer Sample Number: 303713 Program: DS
Location: 1st draw 253 11 ST SE Type: Dist.
Collection Date: 11/29/2015 Collection Time: 7:42 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-002

SAMPLE INFORMATION

Sample Number: 1512042-002 Customer Sample Number: 303713 Program: DS
Location: 2nd draw 253 11 ST SE Type: Dist.


Collection Date: 11/29/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-009

SAMPLE INFORMATION

Sample Number: 1512042-009 Customer Sample Number: 3074936 Program: DS
Location: 1st draw 1429 IVES PI SE Type: Dist.


Collection Date: 12/1/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.4 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-010

SAMPLE INFORMATION

Sample Number: 1512042-010 Customer Sample Number: 3074936 Program: DS
Location: 2nd draw 1429 IVES PI SE Type: Dist.


Collection Date: 12/1/2015 Collection Time: 17:35 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-011

SAMPLE INFORMATION


Sample Number: 1512042-011 Customer Sample Number: 3031051 Program: DS
Location: 1st draw 1891 INGLESIDE TERR NW Type: Dist.
Collection Date: 12/1/2015 Collection Time: 18:20 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-012

SAMPLE INFORMATION

Sample Number: 1512042-012 Customer Sample Number: 3031051 Program: DS
Location: 2nd draw 1891 INGLESIDE TERR NW Type: Dist.


Collection Date: 12/1/2015 Collection Time: 18:22 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.0 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512084-001

SAMPLE INFORMATION

Sample Number: 1512084-001 Customer Sample Number: 3120100 Program: DS
Location: 1st draw 645 14TH PL NE Type: Dist.


Collection Date: 12/1/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 12/11/2015 8:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512084-002

SAMPLE INFORMATION

Sample Number: 1512084-002 Customer Sample Number: 3120100 Program: DS
Location: 2nd draw 645 14TH PL NE Type: Dist.


Collection Date: 12/1/2015 Collection Time: 5:35 Sampler: HOME OWNER Received Date and Time: 12/11/2015 8:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512084-003

SAMPLE INFORMATION


Sample Number: 1512084-003 Customer Sample Number: 3024665 Program: DS
Location: 1st draw 5817 6TH ST NW Type: Dist.
Collection Date: 12/2/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 12/11/2015 8:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512084-004

SAMPLE INFORMATION

Sample Number: 1512084-004 Customer Sample Number: 3024665 Program: DS
Location: 2nd draw 5817 6TH ST NW Type: Dist.


Collection Date: 12/2/2015 Collection Time: 7:30 Sampler: HOME OWNER Received Date and Time: 12/11/2015 8:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-007

SAMPLE INFORMATION

Sample Number: 1512109-007 Customer Sample Number: 3010325 Program: DS
Location: 1st draw 3813 BENTON ST NW Type: Dist.


Collection Date: 12/14/2015 Collection Time: 7:08 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-008

SAMPLE INFORMATION

Sample Number: 1512109-008 Customer Sample Number: 3010325 Program: DS
Location: 2nd draw 3813 BENTON ST NW Type: Dist.


Collection Date: 12/14/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.1 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512126-003

SAMPLE INFORMATION

Sample Number: 1512126-003 Customer Sample Number: 3075160 Program: DS
Location: 1st draw 245 16TH ST SE Type: Dist.


Collection Date: 12/10/2015 Collection Time: 19:30 Sampler: HOME OWNER Received Date and Time: 12/16/2015 8:39:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.0 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512126-004

SAMPLE INFORMATION

Sample Number: 1512126-004 Customer Sample Number: 3075160 Program: DS
Location: 2nd draw 245 16TH ST SE Type: Dist.


Collection Date: 12/10/2015 Collection Time: 19:33 Sampler: HOME OWNER Received Date and Time: 12/16/2015 8:39:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	16.7 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512146-003

SAMPLE INFORMATION


Sample Number: 1512146-003 Customer Sample Number: 3030534 Program: DS
Location: 1st Draw 1425 MERIDIAN PL NW Type: Dist.
Collection Date: 12/14/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 12/18/2015 11:50:00 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.9 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512146-004

SAMPLE INFORMATION


Sample Number: 1512146-004 Customer Sample Number: 3030534 Program: DS
Location: 2nd Draw 1425 MERIDIAN PL NW Type: Dist.
Collection Date: 12/14/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 12/18/2015 11:50:00 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.8 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

Post Lead Service Line Replacement Samples

DC Water operates a program where lead sampling kits are dropped off to customers that have had a partial or full lead service line replacement. Samples are typically dropped off 4.5 months after the replacement to determine if it is necessary for customers to continue filtering their water. The kit comes with bottles and instructions on how to take first and second draw samples. Customers collect their own samples and contact DC Water to deliver the bottles to the Washington Aqueduct. Results are then reported back to the customer through DC Water's Customer Service Program.

This attached sample analysis data contains personal information of DC Water's customers, such as names and home addresses, the disclosure of which would constitute a violation of D.C. Code § 2-534(a)(2) and 5 U.S.C. § 552(b)(6). If EPA is requested to produce the sampling analysis data in whole or in part, in order to maintain confidentiality, the personal information must be redacted from the documents produced.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-003

SAMPLE INFORMATION

Sample Number: 1506171-003 Customer Sample Number: 3113162 Program: Post-LSR
Location: 1st Draw 2513 N. CAPITOL ST NE Type: Dist.

Collection Date: 6/10/2015 Collection Time: 17:12 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-004

SAMPLE INFORMATION

Sample Number: 1506171-004 Customer Sample Number: 3113162 Program: Post-LSR
Location: 2nd Draw 2513 N. CAPITOL ST NE Type: Dist.

Collection Date: 6/10/2015 Collection Time: 17:14 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-005


SAMPLE INFORMATION

Sample Number: 1506171-005 Customer Sample Number: 3021218 Program: Post-LSR
Location: 1st Draw 318 VARNUM ST NW Type: Dist.
Collection Date: 6/15/2015 Collection Time: 17:27 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.6 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-006

SAMPLE INFORMATION


Sample Number: 1506171-006 Customer Sample Number: 3021218 Program: Post-LSR
Location: 2nd Draw 318 VARNUM ST NW Type: Dist.

Collection Date: 6/15/2015 Collection Time: 17:28 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-011

SAMPLE INFORMATION


Sample Number: 1506171-011 Customer Sample Number: 3001182 Program: Post-LSR
Location: 1st Draw 1704 FLORIDA AVE N.W. Type: Dist.

Collection Date: 6/16/2015 Collection Time: 14:20 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-012

SAMPLE INFORMATION


Sample Number: 1506171-012 Customer Sample Number: 3001182 Program: Post-LSR
Location: 2nd Draw 1704 FLORIDA AVE N.W. Type: Dist.

Collection Date: 6/16/2015 Collection Time: 14:20 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506171-013

SAMPLE INFORMATION

Sample Number: 1506171-013 Customer Sample Number: 3125210 Program: Post-LSR
Location: 1st Draw 12 RHODE ISLAND NE. Type: Dist.

Collection Date: 6/17/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 6/23/2015 3:54:57 PM Received By: LGallimore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506181-001


SAMPLE INFORMATION

Sample Number: 1506181-001 Customer Sample Number: 3000563 Program: Post-LSR
Location: 1st draw 2126 NEWPORT PL NW Type: Dist.
Collection Date: 6/11/2015 Collection Time: 17:50 Sampler: HOME OWNER Received Date and Time: 6/25/2015 1:59:13 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	6.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506181-002

SAMPLE INFORMATION

Sample Number: 1506181-002 Customer Sample Number: 3000563 Program: Post-LSR
Location: 2nd draw 2126 NEWPORT PL NW Type: Dist.

Collection Date: 6/11/2015 Collection Time: 17:51 Sampler: HOME OWNER Received Date and Time: 6/25/2015 1:59:13 PM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-007


SAMPLE INFORMATION

Sample Number: 1506203-007 Customer Sample Number: 3004702 Program: Post-LSR
Location: 1st draw 1527 9TH ST NW Type: Dist.
Collection Date: 6/25/2015 Collection Time: 9:00 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.3 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1506203-008


SAMPLE INFORMATION

Sample Number: 1506203-008 Customer Sample Number: 3004702 Program: Post-LSR
Location: 2nd draw 1527 9TH ST NW Type: Dist.
Collection Date: 6/25/2015 Collection Time: 9:05 Sampler: HOME OWNER Received Date and Time: 6/30/2015 2:07:07 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	20.3 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-001


SAMPLE INFORMATION

Sample Number: 1507013-001 Customer Sample Number: 3121899 Program: Post-LSR
Location: 1st Draw 133 TENNESSEE AVE NE Type: Dist.
Collection Date: 6/21/2015 Collection Time: 18:03 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.8 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-002

SAMPLE INFORMATION


Sample Number: 1507013-002 Customer Sample Number: 3121899 Program: Post-LSR
Location: 2nd Draw 133 TENNESSEE AVE NE Type: Dist.

Collection Date: 6/21/2015 Collection Time: 18:05 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:


Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-007


SAMPLE INFORMATION

Sample Number: 1507013-007 Customer Sample Number: 3036085 Program: Post-LSR
Location: 1st Draw 3025 NEWARK STREET NW Type: Dist.
Collection Date: 6/28/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-008

SAMPLE INFORMATION


Sample Number: 1507013-008 Customer Sample Number: 3036085 Program: Post-LSR
Location: 2nd Draw 3025 NEWARK STREET NW Type: Dist.

Collection Date: 6/28/2015 Collection Time: 6:05 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-009

SAMPLE INFORMATION

Sample Number: 1507013-009 Customer Sample Number: 3000568 Program: Post-LSR
Location: 1st Draw 2136 NW PORT PL NW Type: Dist.
Collection Date: 6/29/2015 Collection Time: 6:50 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	8.7 ug/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507013-010


SAMPLE INFORMATION

Sample Number: 1507013-010 Customer Sample Number: 3000568 Program: Post-LSR
Location: 2nd Draw 2136 NW PORT PL NW Type: Dist.
Collection Date: 6/29/2015 Collection Time: 6:52 Sampler: HOME OWNER Received Date and Time: 7/2/2015 12:13:24 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	10.6 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-001

SAMPLE INFORMATION


Sample Number: 1507086-001 Customer Sample Number: 3074108 Program: Post-LSR
Location: 1st draw 326 12TH ST SE Type: Dist.

Collection Date: 7/9/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507086-002

SAMPLE INFORMATION


Sample Number: 1507086-002 Customer Sample Number: 3074108 Program: Post-LSR
Location: 2nd draw 326 12TH ST SE Type: Dist.

Collection Date: 7/9/2015 Collection Time: 7:10 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507086-007

SAMPLE INFORMATION


Sample Number: 1507086-007 Customer Sample Number: 3046825 Program: Post-LSR
Location: 1st draw 613 FERN PLACE, NW Type: Dist.

Collection Date: 7/9/2015 Collection Time: 19:15 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.1 ug/L	8/5/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507086-008

SAMPLE INFORMATION


Sample Number: 1507086-008 Customer Sample Number: 3046825 Program: Post-LSR
Location: 2nd draw 613 FERN PLACE, NW Type: Dist.

Collection Date: 7/9/2015 Collection Time: 19:16 Sampler: HOME OWNER Received Date and Time: 7/14/2015 8:19:35 AM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	7/17/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-001

SAMPLE INFORMATION

Sample Number: 1507166-001 Customer Sample Number: 3028101 Program: Post-LSR
Location: 1st draw 1501 VARNUM ST NW Type: Dist.
Collection Date: 7/20/2015 Collection Time: 5:55 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-002

SAMPLE INFORMATION


Sample Number: 1507166-002 Customer Sample Number: 3028101 Program: Post-LSR
Location: 2nd draw 1501 VARNUM ST NW Type: Dist.

Collection Date: 7/20/2015 Collection Time: 5:59 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-011


SAMPLE INFORMATION

Sample Number: 1507166-011 Customer Sample Number: Program: Post-LSR
Location: 1st draw 614 LAMONT ST NW Type: Dist.
Collection Date: 7/16/2015 Collection Time: 7:20 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-012

SAMPLE INFORMATION


Sample Number: 1507166-012 Customer Sample Number: Program: Post-LSR
Location: 2nd draw 614 LAMONT ST NW Type: Dist.

Collection Date: 7/16/2015 Collection Time: 7:23 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-013


SAMPLE INFORMATION

Sample Number: 1507166-013 Customer Sample Number: 3021961 Program: Post-LSR
Location: 1st draw 712 DECATUR ST NW Type: Dist.
Collection Date: 7/9/2015 Collection Time: 6:46 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-014


SAMPLE INFORMATION

Sample Number: 1507166-014 Customer Sample Number: 3021961 Program: Post-LSR
Location: 2nd draw 712 DECATUR ST NW Type: Dist.
Collection Date: 7/9/2015 Collection Time: 6:47 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507166-017


SAMPLE INFORMATION

Sample Number: 1507166-017 Customer Sample Number: 3028526 Program: Post-LSR
Location: 1st draw 1346 RANDOLPH ST NW Type: Dist.
Collection Date: 7/16/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/13/2015
Report Number: LC-W1507166-018

SAMPLE INFORMATION

Sample Number: 1507166-018 Customer Sample Number: 3028526 Program: Post-LSR
Location: 2nd draw 1346 RANDOLPH ST NW Type: Dist.
Collection Date: 7/16/2015 Collection Time: 7:02 Sampler: HOME OWNER Received Date and Time: 7/23/2015 11:09:02 AM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:  8/13/2015
Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507173-001

SAMPLE INFORMATION


Sample Number: 1507173-001 Customer Sample Number: 3070423 Program: Post-LSR
Location: 1st draw 336 RALEIGH ST SE Type: Dist.

Collection Date: 7/20/2015 Collection Time: 18:45 Sampler: HOME OWNER Received Date and Time: 7/24/2015 12:36:25 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/13/2015
Report Number: LC-W1507173-002

SAMPLE INFORMATION

Sample Number: 1507173-002 Customer Sample Number: 3070423 Program: Post-LSR
Location: 2nd draw 336 RALEIGH ST SE Type: Dist.
Collection Date: 7/20/2015 Collection Time: 18:46 Sampler: HOME OWNER Received Date and Time: 7/24/2015 12:36:25 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.4 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507173-003

SAMPLE INFORMATION

Sample Number: 1507173-003 Customer Sample Number: 3010163 Program: Post-LSR
Location: 1st draw 2218 HALL PLACE NW Type: Dist.

Collection Date: 7/21/2015 Collection Time: 6:28 Sampler: HOME OWNER Received Date and Time: 7/24/2015 12:36:25 PM Received By: JCross


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507173-004

SAMPLE INFORMATION


Sample Number: 1507173-004 Customer Sample Number: 3010163 Program: Post-LSR
Location: 2nd draw 2218 HALL PLACE NW Type: Dist.

Collection Date: 7/21/2015 Collection Time: 6:31 Sampler: HOME OWNER Received Date and Time: 7/24/2015 12:36:25 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507174-001


SAMPLE INFORMATION

Sample Number: 1507174-001 Customer Sample Number: 3041736 Program: Post-LSR
Location: 1st draw 3453 NEWARK ST., NW Type: Dist.
Collection Date: 7/23/2015 Collection Time: 8:09 Sampler: HOMEOWNER Received Date and Time: 7/24/2015 2:37:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	1.2 ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/13/2015
Report Number: LC-W1507174-002


SAMPLE INFORMATION

Sample Number: 1507174-002 Customer Sample Number: 3041736 Program: Post-LSR
Location: 2nd draw 3453 NEWARK ST., NW Type: Dist.

Collection Date: 7/23/2015 Collection Time: 8:11 Sampler: HOMEOWNER Received Date and Time: 7/24/2015 2:37:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/13/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/13/2015
Report Number: LC-W1507209-001

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1507209-001 Customer Sample Number: 3070425 Program: Post-LSR
Location: 1st draw 340 RALEIGH ST SE Type: Dist.
Collection Date: 7/20/2015 Collection Time: 20:11 Sampler: HOME OWNER Received Date and Time: 7/31/2015 10:04:11 AM Received By: MMoore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/13/2015
Report Number: LC-W1507209-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1507209-002 Customer Sample Number: 3070425 Program: Post-LSR
Location: 2nd draw 340 RALEIGH ST SE Type: Dist.
Collection Date: 7/20/2015 Collection Time: 20:15 Sampler: HOME OWNER Received Date and Time: 7/31/2015 10:04:11 AM Received By: MMoore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/13/2015
Report Number: LC-W1507209-003

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507209-003 Customer Sample Number: 3072304 Program: Post-LSR
Location: 1st draw 405 6TH ST SE Type: Dist.
Collection Date: 7/27/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 7/31/2015 10:04:11 AM Received By: MMoore


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/13/2015
Report Number: LC-W1507209-004

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507209-004 Customer Sample Number: 3072304 Program: Post-LSR
Location: 2nd draw 405 6TH ST SE Type: Dist.

Collection Date: 7/27/2015 Collection Time: 6:33 Sampler: HOME OWNER Received Date and Time: 7/31/2015 10:04:11 AM Received By: MMoore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/13/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-005

SAMPLE INFORMATION


Sample Number: 1508091-005 Customer Sample Number: 3000591 Program: Post-LSR
Location: 1st draw 2131 N ST NW Type: Dist.

Collection Date: 8/6/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: LC-W1508091-006

SAMPLE INFORMATION


Sample Number: 1508091-006 Customer Sample Number: 3000591 Program: Post-LSR
Location: 2nd draw 2131 N ST NW Type: Dist.

Collection Date: 8/6/2015 Collection Time: 8:05 Sampler: HOME OWNER Received Date and Time: 8/12/2015 3:14:26 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-003

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508102-003 Customer Sample Number: 3072318 Program: Post-LSR
Location: 1st draw 402 6TH ST SE #1 Type: Dist.
Collection Date: 8/11/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2018	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-004

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1508102-004 Customer Sample Number: 3072318 Program: Post-LSR
Location: 2nd draw 402 6TH ST SE #1 Type: Dist.

Collection Date: 8/11/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	ND ug/L	8/18/2015	RHoffa

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-007

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508102-007 Customer Sample Number: 3040316 Program: Post-LSR
Location: 1st draw 4001 HARRISON ST NW Type: Dist.
Collection Date: 8/12/2015 Collection Time: 6:08 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/18/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/19/2015
Report Number: LC-W1508102-008

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1508102-008 Customer Sample Number: 3040316 Program: Post-LSR
Location: 2nd draw 4001 HARRISON ST NW Type: Dist.
Collection Date: 8/12/2015 Collection Time: 6:09 Sampler: HOME OWNER Received Date and Time: 8/14/2015 10:06:27 AM Received By: MChicoine


Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/18/2015	RHoffa

Comment:
ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-005

SAMPLE INFORMATION


Sample Number: 1508180-005 Customer Sample Number: 3071875 Program: Post-LSR
Location: 1st draw 231 SIXTH ST SE Type: Dist.

Collection Date: 8/19/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-006

SAMPLE INFORMATION


Sample Number: 1508180-006 Customer Sample Number: 3071875 Program: Post-LSR
Location: 2nd draw 231 SIXTH ST SE Type: Dist.

Collection Date: 8/19/2015 Collection Time: 8:06 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-007


SAMPLE INFORMATION

Sample Number: 1508180-007 Customer Sample Number: 3012272 Program: Post-LSR
Location: 1st draw 3122 N ST NW Type: Dist.
Collection Date: 8/19/2015 Collection Time: 8:14 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-008

SAMPLE INFORMATION


Sample Number: 1508180-008 Customer Sample Number: 3012272 Program: Post-LSR
Location: 2nd draw 3122 N ST NW Type: Dist.

Collection Date: 8/19/2015 Collection Time: 8:15 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-011


SAMPLE INFORMATION

Sample Number: 1508180-011 Customer Sample Number: 3000600 Program: Post-LSR
Location: 1st draw 2109 N ST NW Type: Dist.
Collection Date: 8/21/2015 Collection Time: 6:35 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	9/3/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: LC-W1508180-012

SAMPLE INFORMATION


Sample Number: 1508180-012 Customer Sample Number: 3000600 Program: Post-LSR
Location: 2nd draw 2109 N ST NW Type: Dist.

Collection Date: 8/21/2015 Collection Time: 6:38 Sampler: HOME OWNER Received Date and Time: 8/25/2015 3:09:01 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/3/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-003

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508196-003 Customer Sample Number: 3046563 Program: Post-LSR
Location: 1st draw 6621 1ST ST NW Type: Dist.
Collection Date: 8/23/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	9/10/2015	Tpasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-004

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508196-004 Customer Sample Number: 3046563 Program: Post-LSR
Location: 2nd draw 6621 1ST ST NW Type: Dist.
Collection Date: 8/23/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/10/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-007

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508196-007 Customer Sample Number: 3009775 Program: Post-LSR
Location: 1st draw 2214 HALL PLACE NW Type: Dist.
Collection Date: 8/23/2015 Collection Time: 20:50 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	9/10/2015	Tpasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority

Report Date: 9/22/2015
Report Number: LC-W1508196-008

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


SAMPLE INFORMATION

Sample Number: 1508196-008 Customer Sample Number: 3009775 Program: Post-LSR
Location: 2nd draw 2214 HALL PLACE NW Type: Dist.
Collection Date: 8/23/2015 Collection Time: 21:07 Sampler: HOME OWNER Received Date and Time: 8/28/2015 9:12:51 AM Received By: MChicoine

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508212-001


SAMPLE INFORMATION

Sample Number: 1508212-001 Customer Sample Number: 3107494 Program: Post-LSR
Location: 1st draw 2706 BRENTWOOD RD NE Type: Dist.
Collection Date: 8/18/2015 Collection Time: 18:04 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:58:09 PM Received By: BSmith

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/10/2015	TPasquale

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/22/2015
Report Number: LC-W1508212-002

SAMPLE INFORMATION


Sample Number: 1508212-002 Customer Sample Number: 3107494 Program: Post-LSR
Location: 2nd draw 2706 BRENTWOOD RD NE Type: Dist.

Collection Date: 8/18/2015 Collection Time: 18:08 Sampler: HOME OWNER Received Date and Time: 8/31/2015 2:58:09 PM Received By: BSmith

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/10/2015	TPasquale

Comment: ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/22/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-001

SAMPLE INFORMATION


Sample Number: 1509099-001 Customer Sample Number: 3072581 Program: Post-LSR
Location: 1st draw 216 6TH ST SE Type: Dist.
Collection Date: 9/7/2015 Collection Time: 16:15 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-002

SAMPLE INFORMATION


Sample Number: 1509099-002 Customer Sample Number: 3072581 Program: Post-LSR
Location: 2nd draw 216 6TH ST SE Type: Dist.
Collection Date: 9/7/2015 Collection Time: 16:17 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-007

SAMPLE INFORMATION


Sample Number: 1509099-007 Customer Sample Number: 3122104 Program: Post-LSR
Location: 1st draw 327 CHANNING ST NE Type: Dist.
Collection Date: 9/10/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.9 ug/L	9/22/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: LC-W1509099-008


SAMPLE INFORMATION

Sample Number: 1509099-008 Customer Sample Number: 3122104 Program: Post-LSR
Location: 2nd draw 327 CHANNING ST NE Type: Dist.
Collection Date: 9/10/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 9/15/2015 8:42:09 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.5 ug/L	9/22/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509169-001

SAMPLE INFORMATION

Sample Number: 1509169-001 Customer Sample Number: 3072582 Program: Post-LSR
Location: 1st draw 218 6TH ST SE Type: Dist.


Collection Date: 9/14/2015 Collection Time: 6:25 Sampler: HOME OWNER Received Date and Time: 9/24/2015 10:17:02 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509169-002

SAMPLE INFORMATION


Sample Number: 1509169-002 Customer Sample Number: 3072582 Program: Post-LSR
Location: 2nd draw 218 6TH ST SE Type: Dist.
Collection Date: 9/14/2015 Collection Time: 6:27 Sampler: HOME OWNER Received Date and Time: 9/24/2015 10:17:02 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.7 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509169-003

SAMPLE INFORMATION


Sample Number: 1509169-003 Customer Sample Number: 3073970 Program: Post-LSR
Location: 1st draw 404 11TH ST SE Type: Dist.
Collection Date: 9/21/2015 Collection Time: 18:35 Sampler: HOME OWNER Received Date and Time: 9/24/2015 10:17:02 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.9 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509169-004

SAMPLE INFORMATION


Sample Number: 1509169-004 Customer Sample Number: 3073970 Program: Post-LSR
Location: 2nd draw 404 11TH ST SE Type: Dist.
Collection Date: 9/21/2015 Collection Time: 18:37 Sampler: HOME OWNER Received Date and Time: 9/24/2015 10:17:02 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	14.6 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509169-005

SAMPLE INFORMATION


Sample Number: 1509169-005 Customer Sample Number: 3124210 Program: Post-LSR
Location: 1st draw 414 7TH ST NE Type: Dist.
Collection Date: 9/22/2015 Collection Time: 17:40 Sampler: HOME OWNER Received Date and Time: 9/24/2015 10:17:02 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.2 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509169-006

SAMPLE INFORMATION


Sample Number: 1509169-006 Customer Sample Number: 3124210 Program: Post-LSR
Location: 2nd draw 414 7TH ST NE Type: Dist.
Collection Date: 9/22/2015 Collection Time: 17:42 Sampler: HOME OWNER Received Date and Time: 9/24/2015 10:17:02 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509180-003

SAMPLE INFORMATION


Sample Number: 1509180-003 Customer Sample Number: 3020512 Program: Post-LSR
Location: 1st Draw 622 RANDOLPH ST NW Type: Dist.
Collection Date: 9/22/2015 Collection Time: 21:20 Sampler: HOME OWNER Received Date and Time: 9/25/2015 1:36:46 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509180-004

SAMPLE INFORMATION


Sample Number: 1509180-004 Customer Sample Number: 3020512 Program: Post-LSR
Location: 2nd Draw 622 RANDOLPH ST NW Type: Dist.
Collection Date: 9/22/2015 Collection Time: 21:22 Sampler: HOME OWNER Received Date and Time: 9/25/2015 1:36:46 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1510011-001

SAMPLE INFORMATION


Sample Number: 1510011-001 Customer Sample Number: 3120538 Program: Post-LSR
Location: 1st draw 2632 10TH ST NE Type: Dist.
Collection Date: 9/25/2015 Collection Time: 16:45 Sampler: HOME OWNER Received Date and Time: 10/2/2015 10:56:56 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.9 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1510011-002

SAMPLE INFORMATION


Sample Number: 1510011-002 Customer Sample Number: 3120538 Program: Post-LSR
Location: 2nd draw 2632 10TH ST NE Type: Dist.
Collection Date: 9/25/2015 Collection Time: 16:45 Sampler: HOME OWNER Received Date and Time: 10/2/2015 10:56:56 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	7.3 ug/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-001	Customer Sample Number: 3087023
Location: 1st Draw 406 11th St SE	Program: Post-LSR
Collection Date: 10/1/2015	Sampler: HOME OWNER Received Date: 10/5/2015
Collection Time: 7:15:00 PM	Received by: MChicoine Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-002	Customer Sample Number: 3087023
Location: 2nd Draw 406 11th St SE	Program: Post-LSR
Collection Date: 10/1/2015	Sampler: HOME OWNER Received Date: 10/5/2015
Collection Time: 7:17:00 PM	Received by: MChicoine Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015

Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-007	Customer Sample Number: 3127401
Location: 1st Draw 604 7th ST NE	Program: Post-LSR
Collection Date: 10/2/2015	Sampler: HOME OWNER Received Date: 10/5/2015
Collection Time: 4:25:00 AM	Received by: MChicoine Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510025

Sample Number: 1510025-008	Customer Sample Number: 3127401
Location: 2nd Draw 604 7th ST NE	Program: Post-LSR
Collection Date: 10/2/2015	Sampler: HOME OWNER Received Date: 10/5/2015
Collection Time: 4:27:00 AM	Received by: MChicoine Received Time: 1:31:38 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.2 µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015

Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-003	Customer Sample Number: 3073987
Location: 1st draw 350 11th St SE	Program: Post-LSR
Collection Date: 10/4/2015	Sampler: HOME OWNER Received Date: 10/9/2015
Collection Time: 8:45:00 AM	Received by: MChicoine Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.2 µg/L	10/16/2015	RHoffa

SAMPLE INFORMATION

Report No: LC-W 1510061

Sample Number: 1510061-004	Customer Sample Number: 3073987
Location: 2nd draw 350 11th St SE	Program: Post-LSR
Collection Date: 10/4/2015	Sampler: HOME OWNER Received Date: 10/9/2015
Collection Time: 8:50:00 AM	Received by: MChicoine Received Time: 11:26:04 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-007	Customer Sample Number: 3126387
Location: 1st draw 609 7th St NE	Program: Post-LSR
Collection Date: 10/14/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 6:09:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.0 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-008	Customer Sample Number: 3126387
Location: 2nd draw 609 7th St NE	Program: Post-LSR
Collection Date: 10/14/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 6:09:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-009	Customer Sample Number: 3120854
Location: 1st Draw 326 11th St NE	Program: Post-LSR
Collection Date: 10/14/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 7:00:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.6 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-010	Customer Sample Number: 3120854
Location: 2nd Draw 326 11th St NE	Program: Post-LSR
Collection Date: 10/14/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 7:00:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	7.4 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number:	1510104-013	Customer Sample Number:	3041566
Location:	1st draw 4107 38th St. NW	Program:	Post-LSR
Collection Date:	10/15/2015	Sampler: HOME OWNER	Received Date: 10/16/2015
Collection Time:	5:05:00 AM		Received by: BSmith
		Received Time:	10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.5 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number:	1510104-014	Customer Sample Number:	3041566
Location:	2nd draw 4107 38th St. NW	Program:	Post-LSR
Collection Date:	10/15/2015	Sampler: HOME OWNER	Received Date: 10/16/2015
Collection Time:	5:17:00 AM		Received by: BSmith
		Received Time:	10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-015	Customer Sample Number: 3126382
Location: 1st Draw 619 7th St NE	Program: Post-LSR
Collection Date: 10/14/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 7:30:00 PM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.7 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-016	Customer Sample Number: 3126382
Location: 2nd Draw 619 7th St NE	Program: Post-LSR
Collection Date: 10/14/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 7:38:00 PM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-017	Customer Sample Number: 3126377
Location: 1st Draw 631 7th St NE	Program: Post-LSR
Collection Date: 10/15/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 7:50:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.4 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-018	Customer Sample Number: 3126377
Location: 2nd Draw 631 7th St NE	Program: Post-LSR
Collection Date: 10/15/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 7:52:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.2 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015

Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-019	Customer Sample Number: 3055325
Location: 1st draw 5615 Nevada Ave NW	Program: Post-LSR
Collection Date: 10/13/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 8:25:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	2.2 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510104

Sample Number: 1510104-020	Customer Sample Number: 3055325
Location: 2nd draw 5615 Nevada Ave NW	Program: Post-LSR
Collection Date: 10/13/2015	Sampler: HOME OWNER Received Date: 10/16/2015
Collection Time: 8:30:00 AM	Received by: BSmith Received Time: 10:04:59 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.2 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015

Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-005	Customer Sample Number:
Location: 1st draw 723 7th St NE	Program: Post-LSR
Collection Date: 10/16/2015	Sampler: HOME OWNER Received Date: 10/23/2015
Collection Time: 5:00:00 PM	Received by: MDillard Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-006	Customer Sample Number:
Location: 2nd draw 723 7th St NE	Program: Post-LSR
Collection Date: 10/16/2015	Sampler: HOME OWNER Received Date: 10/23/2015
Collection Time: 5:00:00 PM	Received by: MDillard Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-009	Customer Sample Number: 3075100
Location: 1st Draw 1539 C St SE	Program: Post-LSR
Collection Date: 10/20/2015	Sampler: HOME OWNER Received Date: 10/23/2015
Collection Time: 6:00:00 PM	Received by: MDillard Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510155

Sample Number: 1510155-010	Customer Sample Number: 3075100
Location: 2nd Draw 1539 C St SE	Program: Post-LSR
Collection Date: 10/20/2015	Sampler: HOME OWNER Received Date: 10/23/2015
Collection Time: 6:02:00 PM	Received by: MDillard Received Time: 12:00:00 AM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-003	Customer Sample Number: 3126385
Location: 1st Draw 613 7th St NE	Program: Post-LSR
Collection Date: 10/23/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 4:00:00 PM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.3 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-004	Customer Sample Number: 3126385
Location: 2nd Draw 613 7th St NE	Program: Post-LSR
Collection Date: 10/23/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 4:00:00 PM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015

Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-005	Customer Sample Number: 3002516
Location: 1st Draw 1431 S St NW	Program: Post-LSR
Collection Date: 10/16/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 5:00:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	3.7 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-006	Customer Sample Number: 3002516
Location: 2nd Draw 1431 S St NW	Program: Post-LSR
Collection Date: 10/16/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 5:00:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.6 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-007	Customer Sample Number: 3073989
Location: 1st draw 346 11th St SE	Program: Post-LSR
Collection Date: 10/18/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 7:23:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-008	Customer Sample Number: 3073989
Location: 2nd draw 346 11th St SE	Program: Post-LSR
Collection Date: 10/18/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 7:26:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.6 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015

Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-009	Customer Sample Number:
Location: 1st Draw 1650 Gales St NE	Program: Post-LSR
Collection Date: 10/16/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 7:57:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	2.4 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-010	Customer Sample Number:
Location: 2nd Draw 1650 Gales St NE	Program: Post-LSR
Collection Date: 10/16/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 8:09:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	0.2 µg/L	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Lead Report

Report Date: 11/19/2015

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-013	Customer Sample Number: 3106362
Location: 1st draw 2014 Otis St NE	Program: Post-LSR
Collection Date: 10/22/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 5:46:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	1.2 µg/L	11/9/2015	TPasquale

SAMPLE INFORMATION

Report No: LC-W 1510196

Sample Number: 1510196-014	Customer Sample Number: 3106362
Location: 2nd draw 2014 Otis St NE	Program: Post-LSR
Collection Date: 10/22/2015	Sampler: HOME OWNER Received Date: 10/29/2015
Collection Time: 5:46:00 AM	Received by: JCross Received Time: 4:25:45 PM

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 µg/L	0.2 µg/L	ND	11/9/2015	TPasquale

ND = Non-Detect; RDL = Reporting Detection Limit; Comments:

Reviewed By: *Robert P. Hoffa* 11/19/2015
 Robert P. Hoffa, Laboratory Manager Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-005


SAMPLE INFORMATION

Sample Number: 1511028-005 Customer Sample Number: 3040437 Program: Post-LSR
Location: 1st draw 3809 JENIFER ST, NW Type: Dist.
Collection Date: 10/28/2015 Collection Time: 6:45 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-006

SAMPLE INFORMATION

Sample Number: 1511028-006 Customer Sample Number: 3040437 Program: Post-LSR
Location: 2nd draw 3809 JENIFER ST, NW Type: Dist.


Collection Date: 10/28/2015 Collection Time: 6:48 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-019

SAMPLE INFORMATION


Sample Number: 1511028-019 Customer Sample Number: 3039377 Program: Post-LSR
Location: 1st draw 3755 MCKINLEY ST NW Type: Dist.
Collection Date: 10/27/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.8 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-020

SAMPLE INFORMATION

Sample Number: 1511028-020 Customer Sample Number: 3039377 Program: Post-LSR
Location: 2nd draw 3755 MCKINLEY ST NW Type: Dist.


Collection Date: 10/27/2015 Collection Time: 6:02 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-021

SAMPLE INFORMATION

Sample Number: 1511028-021 Customer Sample Number: 3124207 Program: Post-LSR
Location: 1st draw 420 7TH ST NE Type: Dist.


Collection Date: 11/2/2015 Collection Time: 5:10 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.2 ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511028-022

SAMPLE INFORMATION


Sample Number: 1511028-022 Customer Sample Number: 3124207 Program: Post-LSR
Location: 2nd draw 420 7TH ST NE Type: Dist.
Collection Date: 11/2/2015 Collection Time: 5:18 Sampler: HOME OWNER Received Date and Time: 11/4/2015 9:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	Tpasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-001


SAMPLE INFORMATION

Sample Number: 1511070-001 Customer Sample Number: 3106683 Program: Post-LSR
Location: 1st draw 4017 22ND ST NE Type: Dist.
Collection Date: 11/2/2015 Collection Time: 6:16 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-002


SAMPLE INFORMATION

Sample Number: 1511070-002 Customer Sample Number: 3106683 Program: Post-LSR
Location: 2nd draw 4017 22ND ST NE Type: Dist.
Collection Date: 11/2/2015 Collection Time: 6:18 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-003


SAMPLE INFORMATION

Sample Number: 1511070-003 Customer Sample Number: 3073404 Program: Post-LSR
Location: 1st draw 341 11TH ST SE Type: Dist.
Collection Date: 11/4/2015 Collection Time: 15:35 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-004


SAMPLE INFORMATION

Sample Number: 1511070-004 Customer Sample Number: 3073404 Program: Post-LSR
Location: 2nd draw 341 11TH ST SE Type: Dist.
Collection Date: 11/4/2015 Collection Time: 15:42 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-005


SAMPLE INFORMATION

Sample Number: 1511070-005 Customer Sample Number: Program: Post-LSR
Location: 1st draw 308 11TH ST SE Type: Dist.
Collection Date: 11/5/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	11/18/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511070-006

SAMPLE INFORMATION


Sample Number: 1511070-006 Customer Sample Number: Program: Post-LSR
Location: 2nd draw 308 11TH ST SE Type: Dist.
Collection Date: 11/5/2015 Collection Time: 6:04 Sampler: HOME OWNER Received Date and Time: 11/10/2015 7:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-007

SAMPLE INFORMATION


Sample Number: 1511099-007 Customer Sample Number: Program: Post-LSR
Location: 1st draw 633 EMERSON ST NW Type: Dist.
Collection Date: 11/9/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511099-008

SAMPLE INFORMATION


Sample Number: 1511099-008 Customer Sample Number: Program: Post-LSR
Location: 2nd draw 633 EMERSON ST NW Type: Dist.
Collection Date: 11/9/2015 Collection Time: 7:03 Sampler: HOME OWNER Received Date and Time: 11/13/2015 8:26:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511129-003

SAMPLE INFORMATION


Sample Number: 1511129-003 Customer Sample Number: 3071789 Program: Post-LSR
Location: 1st draw 312 4TH ST SE Type: Dist.
Collection Date: 11/9/2015 Collection Time: 6:33 Sampler: HOME OWNER Received Date and Time: 11/17/2015 11:49:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511129-004

SAMPLE INFORMATION

Sample Number: 1511129-004 Customer Sample Number: 3071789 Program: Post-LSR
Location: 2nd draw 312 4TH ST SE Type: Dist.


Collection Date: 11/9/2015 Collection Time: 6:35 Sampler: HOME OWNER Received Date and Time: 11/17/2015 11:49:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-005

SAMPLE INFORMATION


Sample Number: 1511149-005 Customer Sample Number: 3107568 Program: Post-LSR
Location: 1st draw 2900 CARLTON AVE NE Type: Dist.
Collection Date: 11/13/2015 Collection Time: 17:30 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-006

SAMPLE INFORMATION


Sample Number: 1511149-006 Customer Sample Number: 3107568 Program: Post-LSR
Location: 2nd draw 2900 CARLTON AVE NE Type: Dist.
Collection Date: 11/13/2015 Collection Time: 17:32 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-007

SAMPLE INFORMATION


Sample Number: 1511149-007 Customer Sample Number: 3098336 Program: Post-LSR
Location: 1st draw 1162 ABBEY PL NE Type: Dist.
Collection Date: 11/10/2015 Collection Time: 21:00 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-008

SAMPLE INFORMATION


Sample Number: 1511149-008 Customer Sample Number: 3098336 Program: Post-LSR
Location: 2nd draw 1162 ABBEY PL NE Type: Dist.
Collection Date: 11/10/2015 Collection Time: 21:00 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-009

SAMPLE INFORMATION


Sample Number: 1511149-009 Customer Sample Number: 3038222 Program: Post-LSR
Location: 1st draw 6314 33RD ST NW Type: Dist.
Collection Date: 11/17/2015 Collection Time: 5:51 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.8 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-010

SAMPLE INFORMATION


Sample Number: 1511149-010 Customer Sample Number: 3038222 Program: Post-LSR
Location: 2nd draw 6314 33RD ST NW Type: Dist.
Collection Date: 11/17/2015 Collection Time: 5:53 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-011

SAMPLE INFORMATION


Sample Number: 1511149-011 Customer Sample Number: 3112048 Program: Post-LSR
Location: 1st draw 1650 GALES ST NE Type: Dist.
Collection Date: 11/15/2015 Collection Time: 7:41 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-012

SAMPLE INFORMATION


Sample Number: 1511149-012 Customer Sample Number: 3112048 Program: Post-LSR
Location: 2nd draw 1650 GALES ST NE Type: Dist.
Collection Date: 11/15/2015 Collection Time: 7:44 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-013

SAMPLE INFORMATION


Sample Number: 1511149-013 Customer Sample Number: 3069641 Program: Post-LSR
Location: 1st draw 1103 C ST SE Type: Dist.
Collection Date: 11/12/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511149-014

SAMPLE INFORMATION


Sample Number: 1511149-014 Customer Sample Number: 3069641 Program: Post-LSR
Location: 2nd draw 1103 C ST SE Type: Dist.
Collection Date: 11/12/2015 Collection Time: 5:30 Sampler: HOME OWNER Received Date and Time: 11/20/2015 9:05:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-001

SAMPLE INFORMATION


Sample Number: 1511184-001 Customer Sample Number: 3027023 Program: Post-LSR
Location: 1st draw 510 TUCKERMAN ST NW Type: Dist.
Collection Date: 11/23/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511184-002

SAMPLE INFORMATION


Sample Number: 1511184-002 Customer Sample Number: 3027023 Program: Post-LSR
Location: 2nd draw 510 TUCKERMAN ST NW Type: Dist.
Collection Date: 11/23/2015 Collection Time: 6:00 Sampler: HOME OWNER Received Date and Time: 11/25/2015 1:07:00 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-003

SAMPLE INFORMATION


Sample Number: 1512042-003 Customer Sample Number: 3073954 Program: Post-LSR
Location: 1st draw 1116 E ST SE Type: Dist.
Collection Date: 12/1/2015 Collection Time: 6:50 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-004

SAMPLE INFORMATION


Sample Number: 1512042-004 Customer Sample Number: 3073954 Program: Post-LSR
Location: 2nd draw 1116 E ST SE Type: Dist.
Collection Date: 12/1/2015 Collection Time: 6:51 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-005

SAMPLE INFORMATION


Sample Number: 1512042-005 Customer Sample Number: 3057043 Program: Post-LSR
Location: 1st draw 717 UPSHUR ST NW Type: Dist.
Collection Date: 12/1/2015 Collection Time: 18:43 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.6 ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-006

SAMPLE INFORMATION

Sample Number: 1512042-006 Customer Sample Number: 3057043 Program: Post-LSR
Location: 2nd draw 717 UPSHUR ST NW Type: Dist.


Collection Date: 12/1/2015 Collection Time: 18:44 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-007

SAMPLE INFORMATION


Sample Number: 1512042-007 Customer Sample Number: 3000482 Program: Post-LSR
Location: 1st draw 2112 R ST NW Type: Dist.
Collection Date: 12/2/2015 Collection Time: 6:17 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512042-008

SAMPLE INFORMATION

Sample Number: 1512042-008 Customer Sample Number: 3000482 Program: Post-LSR
Location: 2nd draw 2112 R ST NW Type: Dist.


Collection Date: 12/2/2015 Collection Time: 6:19 Sampler: HOME OWNER Received Date and Time: 12/7/2015 8:08:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	Rhoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512084-005

SAMPLE INFORMATION


Sample Number: 1512084-005 Customer Sample Number: 3043201 Program: Post-LSR
Location: 1st draw 4911 46TH ST. NW Type: Dist.
Collection Date: 12/7/2015 Collection Time: 6:10 Sampler: HOME OWNER Received Date and Time: 12/11/2015 8:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1512084-006

SAMPLE INFORMATION


Sample Number: 1512084-006 Customer Sample Number: 3043201 Program: Post-LSR
Location: 2nd draw 4911 46TH ST. NW Type: Dist.
Collection Date: 12/7/2015 Collection Time: 6:15 Sampler: HOME OWNER Received Date and Time: 12/11/2015 8:27:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.7 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-001

SAMPLE INFORMATION

Sample Number: 1512109-001 Customer Sample Number: 3106618 Program: Post-LSR
Location: 1st draw 3707 22ND ST NE Type: Dist.


Collection Date: 12/14/2015 Collection Time: 6:50 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	3.6 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-002

SAMPLE INFORMATION


Sample Number: 1512109-002 Customer Sample Number: 3106618 Program: Post-LSR
Location: 2nd draw 3707 22ND ST NE Type: Dist.
Collection Date: 12/14/2015 Collection Time: 6:55 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-003

SAMPLE INFORMATION


Sample Number: 1512109-003 Customer Sample Number: 3042329 Program: Post-LSR
Location: 1st draw 4203 YUMA ST NW Type: Dist.
Collection Date: 12/14/2015 Collection Time: 6:41 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	2.3 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-004

SAMPLE INFORMATION


Sample Number: 1512109-004 Customer Sample Number: 3042329 Program: Post-LSR
Location: 2nd draw 4203 YUMA ST NW Type: Dist.
Collection Date: 12/14/2015 Collection Time: 6:43 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.3 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-005

SAMPLE INFORMATION


Sample Number: 1512109-005 Customer Sample Number: 3073727 Program: Post-LSR
Location: 1st draw 219 11TH ST SE Type: Dist.
Collection Date: 12/10/2015 Collection Time: 7:25 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.1 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-006

SAMPLE INFORMATION


Sample Number: 1512109-006 Customer Sample Number: 3073727 Program: Post-LSR
Location: 2nd draw 219 11TH ST SE Type: Dist.
Collection Date: 12/10/2015 Collection Time: 7:27 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-009

SAMPLE INFORMATION


Sample Number: 1512109-009 Customer Sample Number: 3072442 Program: Post-LSR
Location: 1st draw 511 7TH ST NE Type: Dist.
Collection Date: 12/2/2015 Collection Time: 6:30 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-010

SAMPLE INFORMATION


Sample Number: 1512109-010 Customer Sample Number: 3072442 Program: Post-LSR
Location: 2nd draw 511 7TH ST NE Type: Dist.
Collection Date: 12/2/2015 Collection Time: 6:35 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-011

SAMPLE INFORMATION

Sample Number: 1512109-011 Customer Sample Number: 3073731 Program: Post-LSR
Location: 1st draw 209 11TH ST SE Type: Dist.


Collection Date: 12/14/2015 Collection Time: 7:45 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.8 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512109-012

SAMPLE INFORMATION


Sample Number: 1512109-012 Customer Sample Number: 3073731 Program: Post-LSR
Location: 2nd draw 209 11TH ST SE Type: Dist.
Collection Date: 12/14/2015 Collection Time: 7:52 Sampler: HOME OWNER Received Date and Time: 12/15/2015 8:30:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.5 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512126-001

SAMPLE INFORMATION


Sample Number: 1512126-001 Customer Sample Number: 3073724 Program: Post-LSR
Location: 1st draw 231 11TH ST SE Type: Dist.
Collection Date: 12/12/2015 Collection Time: 7:00 Sampler: HOME OWNER Received Date and Time: 12/16/2015 8:39:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	0.4 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512126-002

SAMPLE INFORMATION

Sample Number: 1512126-002 Customer Sample Number: 3073724 Program: Post-LSR
Location: 2nd draw 231 11TH ST SE Type: Dist.


Collection Date: 12/12/2015 Collection Time: 7:01 Sampler: HOME OWNER Received Date and Time: 12/16/2015 8:39:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512146-001

SAMPLE INFORMATION


Sample Number: 1512146-001 Customer Sample Number: 3102602 Program: Post-LSR
Location: 1st Draw 1222 MONTELLO AVENUE NE Type: Dist.
Collection Date: 12/16/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 12/18/2015 11:50:00 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	1.6 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 1/4/2016
Report Number: LC-W1512146-002

SAMPLE INFORMATION

Sample Number: 1512146-002 Customer Sample Number: 3102602 Program: Post-LSR
Location: 2nd Draw 1222 MONTELLO AVENUE NE Type: Dist.


Collection Date: 12/16/2015 Collection Time: 8:00 Sampler: HOME OWNER Received Date and Time: 12/18/2015 11:50:00 AM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	8.3 ug/L	12/23/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

1/4/2016

Date

Lead Profile Information

DC Water surveys the plumbing of customers' homes and collects consecutive samples to identify the sources of lead. The homes are those that had elevated lead from previous samples collected for compliance monitoring or from other programs.

This attached sample analysis data contains personal information of DC Water's customers, such as names and home addresses, the disclosure of which would constitute a violation of D.C. Code § 2-534(a)(2) and 5 U.S.C. § 552(b)(6). If EPA is requested to produce the sampling analysis data in whole or in part, in order to maintain confidentiality, the personal information must be redacted from the documents produced.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-001

SAMPLE INFORMATION

Sample Number: 1506170-001
Location: 1
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015	Collection Time: 9:00	Sampler: YDT/YT	Received Date and Time: 6/23/2015 3:41:12 PM	Received By: JCross
-------------------------------	--------------------------	--------------------	---	------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	88.7 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.10 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	27.2 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	77.8 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	69.2 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.1 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-001

SAMPLE INFORMATION


Sample Number: 1506170-001
Location: 1
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-002

SAMPLE INFORMATION

Sample Number: 1506170-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	55.4 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.10 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	60.5 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	54.4 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-002

SAMPLE INFORMATION

Sample Number: 1506170-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-003

SAMPLE INFORMATION

Sample Number: 1506170-003
Location: 02
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.5 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.68 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.5 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	73.8 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.59 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	250 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-003

SAMPLE INFORMATION

Sample Number: 1506170-003
Location: 02
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-004

SAMPLE INFORMATION

Sample Number: 1506170-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-005

SAMPLE INFORMATION

Sample Number: 1506170-005
Location: 03
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-006

SAMPLE INFORMATION

Sample Number: 1506170-006
Location: 03F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-007

SAMPLE INFORMATION

Sample Number: 1506170-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.7 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.00 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.0 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	77.8 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.40 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	179 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-007

SAMPLE INFORMATION

Sample Number: 1506170-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-008

SAMPLE INFORMATION

Sample Number: 1506170-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-009

SAMPLE INFORMATION

Sample Number: 1506170-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.6 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.20 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.8 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	73.9 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.21 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	127 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-009

SAMPLE INFORMATION

Sample Number: 1506170-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-010

SAMPLE INFORMATION

Sample Number: 1506170-010
Location: 05F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	39.0 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.14 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	61.9 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.39 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.42 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-010

SAMPLE INFORMATION

Sample Number: 1506170-010 Customer Sample Number:
Location: 05F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-011

SAMPLE INFORMATION

Sample Number: 1506170-011
Location: 06
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-012

SAMPLE INFORMATION

Sample Number: 1506170-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.4 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.28 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	61.9 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.15 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.47 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-012

SAMPLE INFORMATION

Sample Number: 1506170-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-013

SAMPLE INFORMATION

Sample Number: 1506170-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	47.4 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.86 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	19.4 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	78.7 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.48 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	183 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-013

SAMPLE INFORMATION

Sample Number: 1506170-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-014

SAMPLE INFORMATION

Sample Number: 1506170-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-015

SAMPLE INFORMATION

Sample Number: 1506170-015 Customer Sample Number:
Location: 08 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	44.7 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.02 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	17.0 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	78.5 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.06 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	132 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-015

SAMPLE INFORMATION

Sample Number: 1506170-015
Location: 08
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-016

SAMPLE INFORMATION

Sample Number: 1506170-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-017

SAMPLE INFORMATION

Sample Number: 1506170-017
Location: 09
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-018

SAMPLE INFORMATION

Sample Number: 1506170-018
Location: 09F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	39.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.88 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	67.4 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	11.2 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.33 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-018

SAMPLE INFORMATION

Sample Number: 1506170-018
Location: 09F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-019

SAMPLE INFORMATION

Sample Number: 1506170-019
Location: 10
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	44.8 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.55 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	16.5 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	87.2 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.82 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	149 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-019


SAMPLE INFORMATION

Sample Number: 1506170-019
Location: 10
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-020

SAMPLE INFORMATION

Sample Number: 1506170-020
Location: 10F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-021

SAMPLE INFORMATION


Sample Number: 1506170-021
Location: 11
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-022

SAMPLE INFORMATION

Sample Number: 1506170-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-023

SAMPLE INFORMATION

Sample Number: 1506170-023
Location: 12
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
6/23/2015	9:00	YDT/YT	6/23/2015 3:41:12 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.5 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.72 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	13.9 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	113 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.40 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	98.5 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-023

SAMPLE INFORMATION

Sample Number: 1506170-023
Location: 12
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-024

SAMPLE INFORMATION

Sample Number: 1506170-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.2 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.91 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	97.3 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	11.7 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.32 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 7/23/2015
Report Number: M- W1506170-024

SAMPLE INFORMATION

Sample Number: 1506170-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-025

SAMPLE INFORMATION

Sample Number: 1506170-025
Location: 13
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015	Collection Time: 9:00	Sampler: YDT/YT	Received Date and Time: 6/23/2015 3:41:12 PM	Received By: JCross
-------------------------------	--------------------------	--------------------	---	------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	39.0 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.65 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.3 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	155 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.99 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	192 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-025

SAMPLE INFORMATION

Sample Number: 1506170-025
Location: 13
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-026

SAMPLE INFORMATION

Sample Number: 1506170-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-027

SAMPLE INFORMATION

Sample Number: 1506170-027
Location: 14
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	39.4 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.34 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	11.2 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	167 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.58 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	73.8 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-027

SAMPLE INFORMATION


Sample Number: 1506170-027
Location: 14
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-028

SAMPLE INFORMATION

Sample Number: 1506170-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.15 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	131 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	10.5 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	14.5 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-028


SAMPLE INFORMATION

Sample Number: 1506170-028
Location: 14F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-029

SAMPLE INFORMATION

Sample Number: 1506170-029
Location: 15
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 7/23/2015
Report Number: M- W1506170-030

SAMPLE INFORMATION

Sample Number: 1506170-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-031

SAMPLE INFORMATION

Sample Number: 1506170-031
Location: 16
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015	Collection Time: 9:00	Sampler: YDT/YT	Received Date and Time: 6/23/2015 3:41:12 PM	Received By: JCross
-------------------------------	--------------------------	--------------------	---	------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.2 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.27 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	11.9 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	158 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	9.44 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	59.0 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-031

SAMPLE INFORMATION

Sample Number: 1506170-031
Location: 16
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-032

SAMPLE INFORMATION

Sample Number: 1506170-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-033

SAMPLE INFORMATION

Sample Number: 1506170-033
Location: 17
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
6/23/2015	9:00	YDT/YT	6/23/2015 3:41:12 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.2 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.40 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.5 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	165 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.76 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	60.6 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-033

SAMPLE INFORMATION

Sample Number: 1506170-033
Location: 17
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-034

SAMPLE INFORMATION

Sample Number: 1506170-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-035

SAMPLE INFORMATION

Sample Number: 1506170-035
Location: 18
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.10 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.3 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	153 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.82 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.7 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-035

SAMPLE INFORMATION

Sample Number: 1506170-035
Location: 18
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-036

SAMPLE INFORMATION

Sample Number: 1506170-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-037

SAMPLE INFORMATION

Sample Number: 1506170-037 Customer Sample Number:
Location: 19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.1 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.97 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.4 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	105 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.71 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	50.8 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-037

SAMPLE INFORMATION

Sample Number: 1506170-037 Customer Sample Number:
Location: 19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-038

SAMPLE INFORMATION

Sample Number: 1506170-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-039

SAMPLE INFORMATION

Sample Number: 1506170-039
Location: 20
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.7 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.84 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	13.3 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	76.7 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.83 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	23.0 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-039

SAMPLE INFORMATION

Sample Number: 1506170-039
Location: 20
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-040

SAMPLE INFORMATION

Sample Number: 1506170-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	37.0 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.15 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	36.2 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.01 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.57 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-040

SAMPLE INFORMATION

Sample Number: 1506170-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-041

SAMPLE INFORMATION

Sample Number: 1506170-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-042

SAMPLE INFORMATION

Sample Number: 1506170-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.52 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	32.3 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	115 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	10.7 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	165 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-042

SAMPLE INFORMATION

Sample Number: 1506170-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:  7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-043

SAMPLE INFORMATION

Sample Number: 1506170-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-044

SAMPLE INFORMATION

Sample Number: 1506170-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.99 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	43.3 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	62.2 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.64 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 5 x dilution	ug/L	ug/L	0.2 ug/L	1390 ug/L	7/17/2015	RHoffa

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-044

SAMPLE INFORMATION

Sample Number: 1506170-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-045

SAMPLE INFORMATION

Sample Number: 1506170-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	59.8 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.11 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	59.7 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	75.5 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.94 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	404 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-045

SAMPLE INFORMATION

Sample Number: 1506170-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:  7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-046

SAMPLE INFORMATION

Sample Number: 1506170-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-047

SAMPLE INFORMATION

Sample Number: 1506170-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.4 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.66 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	41.0 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	56.8 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.70 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 2 x dilution	ug/L	ug/L	0.2 ug/L	807 ug/L	7/17/2015	RHoffa

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-047

SAMPLE INFORMATION

Sample Number: 1506170-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-048

SAMPLE INFORMATION

Sample Number: 1506170-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	52.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	5.27 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	53.7 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	57.5 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.88 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 5 x dilution	ug/L	ug/L	0.2 ug/L	942 ug/L	7/17/2015	RHoffa

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-048

SAMPLE INFORMATION

Sample Number: 1506170-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-049

SAMPLE INFORMATION

Sample Number: 1506170-049
Location: H9
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.7 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.48 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	47.6 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	52.7 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.87 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 2 x dilution	ug/L	ug/L	0.2 ug/L	586 ug/L	7/17/2015	RHoffa

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-049

SAMPLE INFORMATION

Sample Number: 1506170-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-050

SAMPLE INFORMATION

Sample Number: 1506170-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-051

SAMPLE INFORMATION

Sample Number: 1506170-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	51.0 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	5.49 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	41.8 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	51.9 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.66 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 5 x dilution	ug/L	ug/L	0.2 ug/L	965 ug/L	7/17/2015	RHoffa

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-051

SAMPLE INFORMATION

Sample Number: 1506170-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-052

SAMPLE INFORMATION

Sample Number: 1506170-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:  7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-053

SAMPLE INFORMATION

Sample Number: 1506170-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	55.3 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	8.94 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	45.3 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	61.3 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.43 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 2 x dilution	ug/L	ug/L	0.2 ug/L	884 ug/L	7/17/2015	RHoffa

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-053

SAMPLE INFORMATION

Sample Number: 1506170-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 6/23/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:41:12 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-054

SAMPLE INFORMATION

Sample Number: 1506170-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 5 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-055

SAMPLE INFORMATION

Sample Number: 1506170-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.7 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.82 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	32.7 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	144 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.64 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 2 x dilution	ug/L	ug/L	0.2 ug/L	847 ug/L	7/17/2015	RHoffa

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-055

SAMPLE INFORMATION

Sample Number: 1506170-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:  7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-056

SAMPLE INFORMATION

Sample Number: 1506170-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	51.1 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.16 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	38.5 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	197 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	10.4 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8 2 x dilution	ug/L	ug/L	0.2 ug/L	755 ug/L	7/17/2015	RHoffa

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-056

SAMPLE INFORMATION

Sample Number: 1506170-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:  7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-057

SAMPLE INFORMATION

Sample Number: 1506170-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment: 2 x dilution

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-058

SAMPLE INFORMATION

Sample Number: 1506170-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.6 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.41 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	33.7 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	175 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.34 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	369 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-058

SAMPLE INFORMATION

Sample Number: 1506170-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-059

SAMPLE INFORMATION

Sample Number: 1506170-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	49.0 ug/L	7/17/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.08 ug/L	7/17/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	30.9 ug/L	7/17/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	228 ug/L	7/17/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.64 ug/L	7/17/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	399 ug/L	7/17/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-059

SAMPLE INFORMATION

Sample Number: 1506170-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: M- W1506170-060

SAMPLE INFORMATION

Sample Number: 1506170-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/23/2015 9:00 YDT/YT 6/23/2015 3:41:12 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 7/23/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-001

SAMPLE INFORMATION

Sample Number: 1506169-001
Location: 1
LPR 3111 MLK AVE SE UNFILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 6/19/2015
Collection Time: 9:00
Sampler: YDT/YT
Received Date and Time: 6/23/2015 3:29:59 PM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.40 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.5 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	121 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	32.5 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.99 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-002

SAMPLE INFORMATION

Sample Number: 1506169-002
Location: 1F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	27.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	108 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	39.1 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-002

SAMPLE INFORMATION


Sample Number: 1506169-002
Location: 1F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-003

SAMPLE INFORMATION

Sample Number: 1506169-003
Location: 02
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.8 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.49 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	104 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.51 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.83 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-003

SAMPLE INFORMATION

Sample Number: 1506169-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-004

SAMPLE INFORMATION

Sample Number: 1506169-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	29.8 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	95.9 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	9.72 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-004

SAMPLE INFORMATION

Sample Number: 1506169-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-005

SAMPLE INFORMATION

Sample Number: 1506169-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-006

SAMPLE INFORMATION

Sample Number: 1506169-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-007

SAMPLE INFORMATION

Sample Number: 1506169-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-008

SAMPLE INFORMATION


Sample Number: 1506169-008
Location: 04F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-009

SAMPLE INFORMATION

Sample Number: 1506169-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.2 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.86 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	13.8 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.7 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.35 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-009

SAMPLE INFORMATION

Sample Number: 1506169-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-010

SAMPLE INFORMATION

Sample Number: 1506169-010
Location: 05F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	39.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.04 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.4 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.93 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-010

SAMPLE INFORMATION


Sample Number: 1506169-010
Location: 05F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-011

SAMPLE INFORMATION


Sample Number: 1506169-011
Location: 06
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-012

SAMPLE INFORMATION

Sample Number: 1506169-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-013

SAMPLE INFORMATION

Sample Number: 1506169-013
Location: 07
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	47.8 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.03 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	16.2 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.7 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.24 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.45 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-013

SAMPLE INFORMATION

Sample Number: 1506169-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-014

SAMPLE INFORMATION

Sample Number: 1506169-014
Location: 07F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.1 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.5 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.24 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-014

SAMPLE INFORMATION

Sample Number: 1506169-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-015

SAMPLE INFORMATION

Sample Number: 1506169-015
Location: 08
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.8 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.70 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	11.7 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.0 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.07 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.23 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-016

SAMPLE INFORMATION


Sample Number: 1506169-016
Location: 08F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-017

SAMPLE INFORMATION

Sample Number: 1506169-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	52.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.60 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	23.2 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.5 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.91 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.42 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-017

SAMPLE INFORMATION

Sample Number: 1506169-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-018

SAMPLE INFORMATION

Sample Number: 1506169-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.8 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.4 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.99 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-018

SAMPLE INFORMATION

Sample Number: 1506169-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-019

SAMPLE INFORMATION

Sample Number: 1506169-019
Location: 10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	49.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.16 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	17.6 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.2 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.79 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	44.3 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-019

SAMPLE INFORMATION


Sample Number: 1506169-019
Location: 10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-020

SAMPLE INFORMATION

Sample Number: 1506169-020
Location: 10F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015	Collection Time: 9:00	Sampler: YDT/YT	Received Date and Time: 6/23/2015 3:29:59 PM	Received By: JCross
-------------------------------	--------------------------	--------------------	---	------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.2 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.34 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.55 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-020

SAMPLE INFORMATION

Sample Number: 1506169-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-021

SAMPLE INFORMATION

Sample Number: 1506169-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-022

SAMPLE INFORMATION

Sample Number: 1506169-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	39.7 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.7 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.06 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.17 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-022

SAMPLE INFORMATION

Sample Number: 1506169-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-023

SAMPLE INFORMATION

Sample Number: 1506169-023
Location: 12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.67 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.6 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.8 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.91 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.07 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-023

SAMPLE INFORMATION

Sample Number: 1506169-023 Customer Sample Number:
Location: 12 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-024

SAMPLE INFORMATION

Sample Number: 1506169-024
Location: 12F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.2 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	28.4 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	11.8 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.03 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-024

SAMPLE INFORMATION

Sample Number: 1506169-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-025

SAMPLE INFORMATION

Sample Number: 1506169-025
Location: 13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-026

SAMPLE INFORMATION

Sample Number: 1506169-026
Location: 13F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
6/19/2015	9:00	YDT/YT	6/23/2015 3:29:59 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.9 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	24.9 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.32 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-026

SAMPLE INFORMATION


Sample Number: 1506169-026
Location: 13F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-027

SAMPLE INFORMATION

Sample Number: 1506169-027
Location: 14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.9 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.81 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	49.9 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	26.1 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.22 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.42 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-027

SAMPLE INFORMATION

Sample Number: 1506169-027 Customer Sample Number:
Location: 14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-029

SAMPLE INFORMATION

Sample Number: 1506169-029 Customer Sample Number:
Location: 15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-030

SAMPLE INFORMATION

Sample Number: 1506169-030
Location: 15F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.7 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	22.1 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.10 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-030

SAMPLE INFORMATION


Sample Number: 1506169-030
Location: 15F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-031

SAMPLE INFORMATION

Sample Number: 1506169-031
Location: 16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.59 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	13.3 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	23.0 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.25 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.09 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-031

SAMPLE INFORMATION


Sample Number: 1506169-031
Location: 16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-032

SAMPLE INFORMATION

Sample Number: 1506169-032
Location: 16F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	42.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	20.9 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.93 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-032

SAMPLE INFORMATION


Sample Number: 1506169-032
Location: 16F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-033

SAMPLE INFORMATION

Sample Number: 1506169-033
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.3 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.54 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	13.2 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	22.4 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.25 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.81 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-033

SAMPLE INFORMATION


Sample Number: 1506169-033
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-034

SAMPLE INFORMATION

Sample Number: 1506169-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-035

SAMPLE INFORMATION

Sample Number: 1506169-035 Customer Sample Number:
Location: 18 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-036

SAMPLE INFORMATION

Sample Number: 1506169-036
Location: 18F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	20.1 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.18 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-036

SAMPLE INFORMATION


Sample Number: 1506169-036
Location: 18F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-037

SAMPLE INFORMATION

Sample Number: 1506169-037
Location: 19
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.7 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.50 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.2 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	21.6 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.12 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.79 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-037

SAMPLE INFORMATION

Sample Number: 1506169-037 Customer Sample Number:
Location: 19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-038

SAMPLE INFORMATION

Sample Number: 1506169-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-039

SAMPLE INFORMATION

Sample Number: 1506169-039
Location: 20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.7 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.52 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	11.3 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	21.5 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.12 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.52 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-039

SAMPLE INFORMATION


Sample Number: 1506169-039
Location: 20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-040

SAMPLE INFORMATION

Sample Number: 1506169-040
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	19.1 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.95 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-040

SAMPLE INFORMATION


Sample Number: 1506169-040
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-041

SAMPLE INFORMATION

Sample Number: 1506169-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-042

SAMPLE INFORMATION

Sample Number: 1506169-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-043

SAMPLE INFORMATION

Sample Number: 1506169-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-044

SAMPLE INFORMATION

Sample Number: 1506169-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.5 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.82 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	19.4 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	26.7 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.35 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	8.58 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-044

SAMPLE INFORMATION

Sample Number: 1506169-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-045

SAMPLE INFORMATION

Sample Number: 1506169-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.2 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.75 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	18.5 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	25.2 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.13 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.69 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-045

SAMPLE INFORMATION

Sample Number: 1506169-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-046

SAMPLE INFORMATION

Sample Number: 1506169-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.8 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.82 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	19.1 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	24.5 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	9.84 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.34 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-046

SAMPLE INFORMATION

Sample Number: 1506169-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-047

SAMPLE INFORMATION

Sample Number: 1506169-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	49.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.75 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	17.9 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	23.1 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.82 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	8.72 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-047

SAMPLE INFORMATION

Sample Number: 1506169-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-048

SAMPLE INFORMATION

Sample Number: 1506169-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.4 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.09 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	21.4 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	23.1 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.98 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.81 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-048

SAMPLE INFORMATION

Sample Number: 1506169-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-049

SAMPLE INFORMATION

Sample Number: 1506169-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.4 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.81 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	18.1 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	23.5 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.62 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	91.5 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-049

SAMPLE INFORMATION

Sample Number: 1506169-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-050

SAMPLE INFORMATION

Sample Number: 1506169-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-051

SAMPLE INFORMATION

Sample Number: 1506169-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.2 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.68 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.5 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.4 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.94 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	19.2 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-051

SAMPLE INFORMATION

Sample Number: 1506169-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-052

SAMPLE INFORMATION

Sample Number: 1506169-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	48.3 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.82 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	17.1 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.0 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.86 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	10.4 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-052

SAMPLE INFORMATION

Sample Number: 1506169-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-053

SAMPLE INFORMATION

Sample Number: 1506169-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-054

SAMPLE INFORMATION

Sample Number: 1506169-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.6 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.68 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.6 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	30.6 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.88 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.82 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-054

SAMPLE INFORMATION

Sample Number: 1506169-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-055

SAMPLE INFORMATION

Sample Number: 1506169-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-056

SAMPLE INFORMATION

Sample Number: 1506169-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-057

SAMPLE INFORMATION

Sample Number: 1506169-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-058

SAMPLE INFORMATION

Sample Number: 1506169-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-059

SAMPLE INFORMATION

Sample Number: 1506169-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 6/19/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 6/23/2015 3:29:59 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.0 ug/L	8/6/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.48 ug/L	8/6/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.4 ug/L	8/6/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	20.6 ug/L	8/6/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.16 ug/L	8/6/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.86 ug/L	8/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1506169-059

SAMPLE INFORMATION

Sample Number: 1506169-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1506169-060

SAMPLE INFORMATION

Sample Number: 1506169-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
6/19/2015 9:00 YDT/YT 6/23/2015 3:29:59 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-001

SAMPLE INFORMATION


Sample Number: 1507045-001
Location: 01
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-002

SAMPLE INFORMATION

Sample Number: 1507045-002 Customer Sample Number:
Location: 01F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	23.6 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	24.9 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	13.6 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.24 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-002

SAMPLE INFORMATION

Sample Number: 1507045-002 Customer Sample Number:
Location: 01F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-003

SAMPLE INFORMATION

Sample Number: 1507045-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-004

SAMPLE INFORMATION

Sample Number: 1507045-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-005

SAMPLE INFORMATION


Sample Number: 1507045-005
Location: 03
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-006

SAMPLE INFORMATION

Sample Number: 1507045-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-007

SAMPLE INFORMATION

Sample Number: 1507045-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	28.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	25.0 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.45 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.51 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-007

SAMPLE INFORMATION

Sample Number: 1507045-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-008

SAMPLE INFORMATION

Sample Number: 1507045-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-009

SAMPLE INFORMATION

Sample Number: 1507045-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-010

SAMPLE INFORMATION

Sample Number: 1507045-010
Customer Sample Number:
Location: 05F
Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015
Collection Time: 8:30
Sampler: CW/YDT
Received Date and Time: 7/8/2015 2:05:05 PM
Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	24.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	22.8 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.56 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.30 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-010

SAMPLE INFORMATION

Sample Number: 1507045-010 Customer Sample Number:
Location: 05F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-011

SAMPLE INFORMATION


Sample Number: 1507045-011
Location: 06
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-012

SAMPLE INFORMATION

Sample Number: 1507045-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-013

SAMPLE INFORMATION

Sample Number: 1507045-013
Location: 07
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	26.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	31.2 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.66 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.79 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-013

SAMPLE INFORMATION


Sample Number: 1507045-013
Location: 07
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-014

SAMPLE INFORMATION

Sample Number: 1507045-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-015

SAMPLE INFORMATION


Sample Number: 1507045-015
Location: 08
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-016

SAMPLE INFORMATION

Sample Number: 1507045-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-017

SAMPLE INFORMATION

Sample Number: 1507045-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	23.3 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	29.1 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.00 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.91 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-017

SAMPLE INFORMATION

Sample Number: 1507045-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-018

SAMPLE INFORMATION

Sample Number: 1507045-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-019

SAMPLE INFORMATION

Sample Number: 1507045-019
Location: 10
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015	Collection Time: 8:30	Sampler: CW/YDT	Received Date and Time: 7/8/2015 2:05:05 PM	Received By: TPasquale
------------------------------	--------------------------	--------------------	--	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	23.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	26.7 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.80 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.87 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-019

SAMPLE INFORMATION


Sample Number: 1507045-019
Location: 10
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-020

SAMPLE INFORMATION

Sample Number: 1507045-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	21.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	24.5 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.16 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.00 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-020

SAMPLE INFORMATION

Sample Number: 1507045-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-021

SAMPLE INFORMATION

Sample Number: 1507045-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-022

SAMPLE INFORMATION

Sample Number: 1507045-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	20.4 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	32.2 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.12 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.87 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-022

SAMPLE INFORMATION

Sample Number: 1507045-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-023

SAMPLE INFORMATION

Sample Number: 1507045-023
Location: 12
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015	Collection Time: 8:30	Sampler: CW/YDT	Received Date and Time: 7/8/2015 2:05:05 PM	Received By: TPasquale
------------------------------	--------------------------	--------------------	--	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	18.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	82.9 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.42 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.86 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-023

SAMPLE INFORMATION


Sample Number: 1507045-023
Location: 12
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-024

SAMPLE INFORMATION

Sample Number: 1507045-024
Location: 12F
LPR 411 7TH ST NE (FILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 7/8/2015
Collection Time: 8:30
Sampler: CW/YDT
Received Date and Time: 7/8/2015 2:05:05 PM
Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	17.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	77.7 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.47 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.09 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-024

SAMPLE INFORMATION

Sample Number: 1507045-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-025

SAMPLE INFORMATION


Sample Number: 1507045-025
Location: 13
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-026

SAMPLE INFORMATION

Sample Number: 1507045-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-027

SAMPLE INFORMATION


Sample Number: 1507045-027
Location: 14
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-028

SAMPLE INFORMATION

Sample Number: 1507045-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-029

SAMPLE INFORMATION

Sample Number: 1507045-029 Customer Sample Number:
Location: 15 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-030

SAMPLE INFORMATION

Sample Number: 1507045-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-031

SAMPLE INFORMATION

Sample Number: 1507045-031
Location: 16
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	18.0 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	131 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.69 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.38 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-031

SAMPLE INFORMATION

Sample Number: 1507045-031 Customer Sample Number:
Location: 16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-032

SAMPLE INFORMATION

Sample Number: 1507045-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	16.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	115 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.22 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.12 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-032

SAMPLE INFORMATION

Sample Number: 1507045-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-033

SAMPLE INFORMATION

Sample Number: 1507045-033
Location: 17
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	17.6 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	126 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.09 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.28 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-033

SAMPLE INFORMATION


Sample Number: 1507045-033
Location: 17
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-034

SAMPLE INFORMATION

Sample Number: 1507045-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-035

SAMPLE INFORMATION

Sample Number: 1507045-035
Location: 18
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015	Collection Time: 8:30	Sampler: CW/YDT	Received Date and Time: 7/8/2015 2:05:05 PM	Received By: TPasquale
------------------------------	--------------------------	--------------------	--	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	18.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	133 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.88 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.25 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-035

SAMPLE INFORMATION


Sample Number: 1507045-035
Location: 18
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-036

SAMPLE INFORMATION

Sample Number: 1507045-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-037

SAMPLE INFORMATION

Sample Number: 1507045-037 Customer Sample Number:
Location: 19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-038

SAMPLE INFORMATION

Sample Number: 1507045-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	16.7 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	104 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.20 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-038

SAMPLE INFORMATION

Sample Number: 1507045-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-039

SAMPLE INFORMATION

Sample Number: 1507045-039
Location: 20
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	21.7 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	68.4 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.81 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.23 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-039

SAMPLE INFORMATION

Sample Number: 1507045-039 Customer Sample Number:
Location: 20 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-040

SAMPLE INFORMATION

Sample Number: 1507045-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-041

SAMPLE INFORMATION

Sample Number: 1507045-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-042

SAMPLE INFORMATION

Sample Number: 1507045-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	28.6 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	30.8 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.30 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.72 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-042

SAMPLE INFORMATION

Sample Number: 1507045-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-043

SAMPLE INFORMATION

Sample Number: 1507045-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-044

SAMPLE INFORMATION

Sample Number: 1507045-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	27.3 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	27.3 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.97 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.42 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-044

SAMPLE INFORMATION

Sample Number: 1507045-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-045

SAMPLE INFORMATION

Sample Number: 1507045-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-046

SAMPLE INFORMATION

Sample Number: 1507045-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	28.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	24.3 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.27 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.20 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-046

SAMPLE INFORMATION

Sample Number: 1507045-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-047

SAMPLE INFORMATION

Sample Number: 1507045-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-048

SAMPLE INFORMATION

Sample Number: 1507045-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-049

SAMPLE INFORMATION

Sample Number: 1507045-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	26.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	23.8 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.51 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.05 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-049

SAMPLE INFORMATION

Sample Number: 1507045-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-050

SAMPLE INFORMATION

Sample Number: 1507045-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-051

SAMPLE INFORMATION

Sample Number: 1507045-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-052

SAMPLE INFORMATION

Sample Number: 1507045-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-053

SAMPLE INFORMATION

Sample Number: 1507045-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	25.9 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	21.2 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.61 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.60 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-053

SAMPLE INFORMATION

Sample Number: 1507045-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-054

SAMPLE INFORMATION

Sample Number: 1507045-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-055

SAMPLE INFORMATION

Sample Number: 1507045-055
Location: H15
LPR 411 7TH ST NE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 7/8/2015
Collection Time: 8:30
Sampler: CW/YDT
Received Date and Time: 7/8/2015 2:05:05 PM
Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	25.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	26.0 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.29 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.90 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-055

SAMPLE INFORMATION

Sample Number: 1507045-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-056

SAMPLE INFORMATION

Sample Number: 1507045-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-057

SAMPLE INFORMATION

Sample Number: 1507045-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-058

SAMPLE INFORMATION

Sample Number: 1507045-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:  8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-059

SAMPLE INFORMATION

Sample Number: 1507045-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 7/8/2015 Collection Time: 8:30 Sampler: CW/YDT Received Date and Time: 7/8/2015 2:05:05 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	26.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.5 ug/L	25.1 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.28 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.08 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507045-059

SAMPLE INFORMATION

Sample Number: 1507045-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507045-060

SAMPLE INFORMATION

Sample Number: 1507045-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/8/2015 8:30 CW/YDT 7/8/2015 2:05:05 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-001

SAMPLE INFORMATION

Sample Number: 1507145-001 Customer Sample Number:
Location: 01 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507145-002

SAMPLE INFORMATION

Sample Number: 1507145-002 Customer Sample Number:
Location: 01F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-003

SAMPLE INFORMATION

Sample Number: 1507145-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-004

SAMPLE INFORMATION

Sample Number: 1507145-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	30.3 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	15.4 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	91.1 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	22.0 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.13 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-004

SAMPLE INFORMATION

Sample Number: 1507145-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-005

SAMPLE INFORMATION

Sample Number: 1507145-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-006

SAMPLE INFORMATION

Sample Number: 1507145-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-007

SAMPLE INFORMATION

Sample Number: 1507145-007
Location: 04
LPR 3121 MLK AVE SE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 7/21/2015
Collection Time: 9:30
Sampler: CW
Received Date and Time: 7/21/2015 1:48:16 PM
Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.4 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.04 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	17.5 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	106 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.97 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	25.6 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-007

SAMPLE INFORMATION

Sample Number: 1507145-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-008

SAMPLE INFORMATION

Sample Number: 1507145-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-009

SAMPLE INFORMATION

Sample Number: 1507145-009
Location: 05
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	14.2 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	105 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.70 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	39.7 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-009

SAMPLE INFORMATION

Sample Number: 1507145-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-011

SAMPLE INFORMATION

Sample Number: 1507145-011
Location: 06
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:30	Sampler: CW	Received Date and Time: 7/21/2015 1:48:16 PM	Received By: TPasquale
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.4 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.3 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	107 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.14 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.87 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-011

SAMPLE INFORMATION

Sample Number: 1507145-011
Location: 06
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-012

SAMPLE INFORMATION

Sample Number: 1507145-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-013

SAMPLE INFORMATION

Sample Number: 1507145-013
Location: 07
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	108 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.23 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.12 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-013

SAMPLE INFORMATION

Sample Number: 1507145-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-014

SAMPLE INFORMATION

Sample Number: 1507145-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-015

SAMPLE INFORMATION

Sample Number: 1507145-015
Location: 08
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-016

SAMPLE INFORMATION

Sample Number: 1507145-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	28.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	97.8 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.90 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.34 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-016

SAMPLE INFORMATION

Sample Number: 1507145-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-017

SAMPLE INFORMATION

Sample Number: 1507145-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.2 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	110 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.42 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.02 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-017

SAMPLE INFORMATION

Sample Number: 1507145-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-018

SAMPLE INFORMATION

Sample Number: 1507145-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-019

SAMPLE INFORMATION

Sample Number: 1507145-019
Location: 10
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.6 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	112 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.27 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.80 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-019

SAMPLE INFORMATION


Sample Number: 1507145-019
Location: 10
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-020

SAMPLE INFORMATION

Sample Number: 1507145-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-021

SAMPLE INFORMATION

Sample Number: 1507145-021
Location: 11
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.0 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	115 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.42 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.92 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-021


SAMPLE INFORMATION

Sample Number: 1507145-021
Location: 11
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-022

SAMPLE INFORMATION

Sample Number: 1507145-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-023

SAMPLE INFORMATION

Sample Number: 1507145-023
Location: 12
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:30	CW	7/21/2015 1:48:16 PM	TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	30.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	114 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.13 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.04 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-023

SAMPLE INFORMATION

Sample Number: 1507145-023
Location: 12
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-024

SAMPLE INFORMATION

Sample Number: 1507145-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-025

SAMPLE INFORMATION

Sample Number: 1507145-025
Location: 13
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:30	CW	7/21/2015 1:48:16 PM	TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	30.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.0 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	110 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.77 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	19.8 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-025

SAMPLE INFORMATION

Sample Number: 1507145-025
Location: 13
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-026

SAMPLE INFORMATION

Sample Number: 1507145-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	26.6 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	100 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.62 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.08 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-026

SAMPLE INFORMATION

Sample Number: 1507145-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-027

SAMPLE INFORMATION

Sample Number: 1507145-027
Location: 14
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	30.7 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	124 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.41 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.74 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-027

SAMPLE INFORMATION

Sample Number: 1507145-027
Location: 14
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-028

SAMPLE INFORMATION

Sample Number: 1507145-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-029

SAMPLE INFORMATION

Sample Number: 1507145-029
Location: 15
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:30	CW	7/21/2015 1:48:16 PM	TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.3 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	149 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.75 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.4 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-029

SAMPLE INFORMATION


Sample Number: 1507145-029
Location: 15
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-031

SAMPLE INFORMATION

Sample Number: 1507145-031
Location: 16
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:30	Sampler: CW	Received Date and Time: 7/21/2015 1:48:16 PM	Received By: TPasquale
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.0 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	139 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.44 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	18.2 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-031

SAMPLE INFORMATION

Sample Number: 1507145-031
Location: 16
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-033

SAMPLE INFORMATION

Sample Number: 1507145-033
Location: 17
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	131 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.61 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	13.1 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-033

SAMPLE INFORMATION

Sample Number: 1507145-033 Customer Sample Number:
Location: 17 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-034

SAMPLE INFORMATION

Sample Number: 1507145-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-035

SAMPLE INFORMATION

Sample Number: 1507145-035
Location: 18
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:30	CW	7/21/2015 1:48:16 PM	TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	37.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.07 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	19.9 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	106 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.98 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	10.1 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-035

SAMPLE INFORMATION

Sample Number: 1507145-035
Location: 18
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-036

SAMPLE INFORMATION

Sample Number: 1507145-036
Location: 18F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	29.3 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	91.1 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.84 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.14 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507145-036

SAMPLE INFORMATION

Sample Number: 1507145-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-037

SAMPLE INFORMATION

Sample Number: 1507145-037
Location: 19
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:30	CW	7/21/2015 1:48:16 PM	TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	47.8 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.95 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	56.3 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	95.2 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.35 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	8.04 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-037

SAMPLE INFORMATION

Sample Number: 1507145-037
Location: 19
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-038

SAMPLE INFORMATION

Sample Number: 1507145-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-039

SAMPLE INFORMATION

Sample Number: 1507145-039
Location: 20
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:30	CW	7/21/2015 1:48:16 PM	TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	52.6 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.85 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	104 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	94.7 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.74 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.50 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-039

SAMPLE INFORMATION

Sample Number: 1507145-039
Location: 20
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-040

SAMPLE INFORMATION

Sample Number: 1507145-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-041

SAMPLE INFORMATION

Sample Number: 1507145-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	78.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.67 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	105 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	79.3 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	20.6 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	43.4 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-041

SAMPLE INFORMATION

Sample Number: 1507145-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-042

SAMPLE INFORMATION

Sample Number: 1507145-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-044

SAMPLE INFORMATION

Sample Number: 1507145-044
Location: H4
LPR 3121 MLK AVE SE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 7/21/2015
Collection Time: 9:30
Sampler: CW
Received Date and Time: 7/21/2015 1:48:16 PM
Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	55.7 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.19 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	112 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	67.4 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.98 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	176 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507145-044

SAMPLE INFORMATION

Sample Number: 1507145-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-045

SAMPLE INFORMATION

Sample Number: 1507145-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-046

SAMPLE INFORMATION

Sample Number: 1507145-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.81 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	86.6 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	64.1 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.70 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	382 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-046

SAMPLE INFORMATION

Sample Number: 1507145-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507145-047

SAMPLE INFORMATION

Sample Number: 1507145-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-048

SAMPLE INFORMATION

Sample Number: 1507145-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	54.7 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.21 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	108 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	66.3 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.06 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	241 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-049

SAMPLE INFORMATION

Sample Number: 1507145-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-050

SAMPLE INFORMATION

Sample Number: 1507145-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-051

SAMPLE INFORMATION

Sample Number: 1507145-051
Location: H11
LPR 3121 MLK AVE SE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 7/21/2015
Collection Time: 9:30
Sampler: CW
Received Date and Time: 7/21/2015 1:48:16 PM
Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	53.5 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.20 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	122 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	67.7 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.47 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	77.0 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507145-051

SAMPLE INFORMATION

Sample Number: 1507145-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/14/2015
Report Number: M- W1507145-053

SAMPLE INFORMATION

Sample Number: 1507145-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-054

SAMPLE INFORMATION

Sample Number: 1507145-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-055

SAMPLE INFORMATION

Sample Number: 1507145-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	51.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.03 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	93.7 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	73.6 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.39 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	238 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-055

SAMPLE INFORMATION

Sample Number: 1507145-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-056

SAMPLE INFORMATION

Sample Number: 1507145-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-057

SAMPLE INFORMATION

Sample Number: 1507145-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-058

SAMPLE INFORMATION

Sample Number: 1507145-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-059

SAMPLE INFORMATION

Sample Number: 1507145-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	52.1 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.24 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	121 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	168 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.08 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	95.1 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-059

SAMPLE INFORMATION

Sample Number: 1507145-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-060

SAMPLE INFORMATION

Sample Number: 1507145-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 7/21/2015 Collection Time: 9:30 Sampler: CW Received Date and Time: 7/21/2015 1:48:16 PM Received By: TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	68.2 ug/L	8/10/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.49 ug/L	8/10/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	175 ug/L	8/10/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	254 ug/L	8/10/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.39 ug/L	8/10/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	108 ug/L	8/10/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/14/2015
Report Number: M- W1507145-060

SAMPLE INFORMATION

Sample Number: 1507145-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
7/21/2015 9:30 CW 7/21/2015 1:48:16 PM TPasquale

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/14/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-001

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-001
Location: 1
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	29.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	14.7 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	114 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	31.0 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.50 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-001

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-001
Location: 1
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-002
Location: 1F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	26.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	91.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	25.5 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-002

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-002
Location: 1F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-003

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-003
Location: 02
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	28.8 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.8 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	89.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.27 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-003

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-003
Location: 02
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa*
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-004

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-004
Location: 02F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	25.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	82.9 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.66 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-004

SAMPLE INFORMATION


Sample Number: 1507144-004
Location: 02F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-005

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-005
Location: 03
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	28.8 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.1 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	115 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.17 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-005

SAMPLE INFORMATION


Sample Number: 1507144-005
Location: 03
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-006

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-006
Location: 03F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	25.8 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	106 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.29 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-006

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-006
Location: 03F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-007

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-007
Location: 04
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.8 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	117 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.40 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.23 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-007

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-007
Location: 04
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-008

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-008
Location: 04F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	29.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	111 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.01 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-008

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-008
Location: 04F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-009

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-009
Location: 05
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	76.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.75 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.28 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-009

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-009
Location: 05
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-010

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-010
Location: 05F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	75.1 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.43 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-010

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-010
Location: 05F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-011

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-011
Location: 06
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	64.1 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.68 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.49 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-011

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-011
Location: 06
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-012

SAMPLE INFORMATION

Sample Number: 1507144-012
Location: 06F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	60.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.12 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.04 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-012

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-012
Location: 06F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-013

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-013
Location: 07
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.9 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	56.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.93 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.02 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-013

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-013
Location: 07
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-014

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-014
Location: 07F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	53.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.76 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.42 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-014

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-014
Location: 07F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-015

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-015
Location: 08
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	46.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.48 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.05 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-015

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-015
Location: 08
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-016

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-016
Location: 08F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.8 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	45.3 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.06 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.44 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-016

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-016
Location: 08F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-017

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-017
Location: 09
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.1 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	36.9 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.59 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.94 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-017

SAMPLE INFORMATION

Sample Number: 1507144-017
Location: 09
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-018

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-018
Location: 09F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	30.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	32.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.25 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.17 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-018

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-018
Location: 09F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-019

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-019
Location: 10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.7 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.14 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.76 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-019

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-019
Location: 10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-020

SAMPLE INFORMATION

Sample Number: 1507144-020
Location: 10F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.5 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.06 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.13 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-020

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-020
Location: 10F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-021

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-021
Location: 11
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	34.3 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.98 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.95 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-021

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-021
Location: 11
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-022

SAMPLE INFORMATION

Sample Number: 1507144-022
Location: 11F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.1 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	33.5 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.88 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-022

SAMPLE INFORMATION


Sample Number: 1507144-022
Location: 11F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-023

SAMPLE INFORMATION

Sample Number: 1507144-023
Location: 12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	40.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.86 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-023

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-023
Location: 12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-024

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-024
Location: 12F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.6 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	38.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.92 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-024

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-024
Location: 12F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-025

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-025
Location: 13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	48.3 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.71 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-025

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-025
Location: 13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-026

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-026
Location: 13F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.9 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	43.1 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.72 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-026

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-026
Location: 13F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-027

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-027
Location: 14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	11.0 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	50.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.81 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-027

SAMPLE INFORMATION


Sample Number: 1507144-027
Location: 14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-028

SAMPLE INFORMATION

Sample Number: 1507144-028
Location: 14F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	31.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	45.5 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.44 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-028

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-028
Location: 14F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-029

SAMPLE INFORMATION

Sample Number: 1507144-029
Location: 15
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.5 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	42.3 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.87 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-029

SAMPLE INFORMATION


Sample Number: 1507144-029
Location: 15
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-030

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-030
Location: 15F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.1 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	40.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.55 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-030

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-030
Location: 15F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-031

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-031
Location: 16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.1 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	40.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.74 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-031

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-031
Location: 16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-032

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-032
Location: 16F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.6 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	37.6 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.96 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-032

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-032
Location: 16F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-033

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-033
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	33.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	36.6 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.66 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-033

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-033
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-034

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-034
Location: 17F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.09 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-034

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-034
Location: 17F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-035

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-035
Location: 18
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.5 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.44 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-035

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-035
Location: 18
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-036

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-036
Location: 18F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	30.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	28.6 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.18 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.2 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-036

SAMPLE INFORMATION


Sample Number: 1507144-036
Location: 18F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-037

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-037
Location: 19
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	36.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	30.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.65 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-037

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-037
Location: 19
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-038

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-038
Location: 19F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.54 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-038

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-038
Location: 19F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-039

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-039
Location: 20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.5 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	28.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.43 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-039

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-039
Location: 20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-040

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-040
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015	Collection Time: 9:00	Sampler: CW	Received Date and Time: 7/21/2015 1:37:29 PM	Received By: MChicoine
-------------------------------	--------------------------	----------------	---	---------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	32.6 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	26.1 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.24 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-040

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-040
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-041

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-041
Location: H1
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	36.9 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	20.2 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	41.9 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.85 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.33 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-041

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-041
Location: H1
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-042

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-042
Location: H2
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.7 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	36.1 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.29 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-042

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-042
Location: H2
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-043

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-043
Location: H3
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.5 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	34.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.80 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-043

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-043
Location: H3
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-044

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-044
Location: H4
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	12.7 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	33.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.54 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.7 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-044

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-044
Location: H4
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-045

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-045
Location: H5
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	34.7 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.77 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.01 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-045

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-045
Location: H5
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-046

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-046
Location: H6
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.0 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	32.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.89 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-046

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-046
Location: H6
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-047

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-047
Location: H7
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.9 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.68 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-047

SAMPLE INFORMATION


Sample Number: 1507144-047
Location: H7
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number:M- W1507144-048

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-048
Location: H8
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	28.7 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.88 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-048

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-048
Location: H8
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-049

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-049
Location: H9
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.1 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	26.9 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.32 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-049

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-049
Location: H9
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

8/17/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-050

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-050

Customer Sample Number:

Location: H10

Type: Dist.

LPR 3111 MLK AVE SE UNFILTERED

Collection Date:
7/21/2015

Collection Time:
9:00

Sampler:
CW

Received Date and Time:
7/21/2015 1:37:29 PM

Received By:
MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.29 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-050

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-050
Location: H10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-051

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-051
Location: H11
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	36.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	10.2 ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	28.8 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.16 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.47 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-051

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-051
Location: H11
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-052

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-052
Location: H12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	36.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	32.1 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.13 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.49 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-052

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-052
Location: H12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-053

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-053
Location: H13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
7/21/2015	9:00	CW	7/21/2015 1:37:29 PM	MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.2 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.6 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.96 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.78 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-053

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-053
Location: H13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-054

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-054
Location: H14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.7 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.7 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.78 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.12 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-054

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-054
Location: H14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-055

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-055
Location: H15
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	36.5 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	35.2 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.04 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.43 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-055

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-055
Location: H15
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-056

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-056
Location: H16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	29.9 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.06 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.96 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-056

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-056
Location: H16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-057

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-057
Location: H17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	31.7 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.92 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.95 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-057

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-057
Location: H17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-058

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-058
Location: H18
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	34.4 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	27.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.81 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.61 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-058

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-058
Location: H18
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Report Date: 8/17/2015
Report Number: M- W1507144-059

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-059
Location: H19
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	35.3 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	25.5 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.76 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.32 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-059

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION


Sample Number: 1507144-059
Location: H19
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority

Report Date: 8/17/2015
Report Number: M- W1507144-060

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1507144-060

Customer Sample Number:

Location: H20

Type: Dist.

LPR 3111 MLK AVE SE UNFILTERED

Collection Date:
7/21/2015

Collection Time:
9:00

Sampler:
CW

Received Date and Time:
7/21/2015 1:37:29 PM

Received By:
MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	36.9 ug/L	8/13/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/13/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/13/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	26.4 ug/L	8/13/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.93 ug/L	8/13/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.48 ug/L	8/13/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1507144-060

SAMPLE INFORMATION


Sample Number: 1507144-060
Location: H20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 7/21/2015 Collection Time: 9:00 Sampler: CW Received Date and Time: 7/21/2015 1:37:29 PM Received By: MChicoine

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-001

SAMPLE INFORMATION

Sample Number: 1508030-001 Customer Sample Number:
Location: 1 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-002

SAMPLE INFORMATION

Sample Number: 1508030-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-003

SAMPLE INFORMATION

Sample Number: 1508030-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-004

SAMPLE INFORMATION

Sample Number: 1508030-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-005

SAMPLE INFORMATION

Sample Number: 1508030-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-006

SAMPLE INFORMATION

Sample Number: 1508030-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-007

SAMPLE INFORMATION

Sample Number: 1508030-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-008

SAMPLE INFORMATION

Sample Number: 1508030-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-009

SAMPLE INFORMATION

Sample Number: 1508030-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-010

SAMPLE INFORMATION

Sample Number: 1508030-010 Customer Sample Number:
Location: 05F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-011

SAMPLE INFORMATION

Sample Number: 1508030-011 Customer Sample Number:
Location: 06 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-012

SAMPLE INFORMATION

Sample Number: 1508030-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-013

SAMPLE INFORMATION

Sample Number: 1508030-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.9 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	11.3 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8 5 X DILUTION	ug/L	ug/L	50 ug/L	487 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	145 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	126 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.03 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-013

SAMPLE INFORMATION

Sample Number: 1508030-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-014

SAMPLE INFORMATION

Sample Number: 1508030-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-015

SAMPLE INFORMATION

Sample Number: 1508030-015 Customer Sample Number:
Location: 08 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.2 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	11.0 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	433 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	158 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	97.2 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.69 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-015

SAMPLE INFORMATION

Sample Number: 1508030-015 Customer Sample Number:
Location: 08 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-016

SAMPLE INFORMATION

Sample Number: 1508030-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	20.6 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	9.92 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	105 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	60.1 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-016

SAMPLE INFORMATION

Sample Number: 1508030-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-017

SAMPLE INFORMATION

Sample Number: 1508030-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	37.4 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	10.3 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	359 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	153 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	84.1 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.50 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-017

SAMPLE INFORMATION

Sample Number: 1508030-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-018

SAMPLE INFORMATION

Sample Number: 1508030-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-019

SAMPLE INFORMATION

Sample Number: 1508030-019 Customer Sample Number:
Location: 10 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-020

SAMPLE INFORMATION

Sample Number: 1508030-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-021

SAMPLE INFORMATION

Sample Number: 1508030-021
Location: 11
LPR 1333 JONQUIL ST NW UNFILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 8/5/2015
Collection Time: 7:30
Sampler: IC/CW
Received Date and Time: 8/5/2015 10:55:23 AM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	38.8 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	8.70 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	348 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	60.5 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	77.4 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.23 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-021

SAMPLE INFORMATION

Sample Number: 1508030-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-022

SAMPLE INFORMATION

Sample Number: 1508030-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-023

SAMPLE INFORMATION

Sample Number: 1508030-023 Customer Sample Number:
Location: 12 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-024

SAMPLE INFORMATION

Sample Number: 1508030-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 1333 JONQUIL ST NW FILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-025

SAMPLE INFORMATION

Sample Number: 1508030-025 Customer Sample Number:
Location: H1 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-026

SAMPLE INFORMATION

Sample Number: 1508030-026 Customer Sample Number:
Location: H2 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-027

SAMPLE INFORMATION

Sample Number: 1508030-027 Customer Sample Number:
Location: H3 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-028

SAMPLE INFORMATION

Sample Number: 1508030-028 Customer Sample Number:
Location: H4 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	57.3 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	10.1 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8 5 X DILUTION	ug/L	ug/L	50 ug/L	919 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	43.4 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	194 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	9.91 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-028

SAMPLE INFORMATION

Sample Number: 1508030-028 Customer Sample Number:
Location: H4 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-029

SAMPLE INFORMATION

Sample Number: 1508030-029 Customer Sample Number:
Location: H5 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	59.7 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	11.7 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8 5 X DILUTION	ug/L	ug/L	50 ug/L	998 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	36.3 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	222 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	9.69 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-029

SAMPLE INFORMATION

Sample Number: 1508030-029 Customer Sample Number:
Location: H5 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-030

SAMPLE INFORMATION

Sample Number: 1508030-030 Customer Sample Number:
Location: H6 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-031

SAMPLE INFORMATION

Sample Number: 1508030-031 Customer Sample Number:
Location: H7 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-032

SAMPLE INFORMATION

Sample Number: 1508030-032 Customer Sample Number:
Location: H8 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-033

SAMPLE INFORMATION

Sample Number: 1508030-033 Customer Sample Number:
Location: H9 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-034

SAMPLE INFORMATION

Sample Number: 1508030-034 Customer Sample Number:
Location: H10 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-035

SAMPLE INFORMATION

Sample Number: 1508030-035 Customer Sample Number:
Location: H11 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: 8/5/2015 Collection Time: 7:30 Sampler: IC/CW Received Date and Time: 8/5/2015 10:55:23 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508030-036

SAMPLE INFORMATION

Sample Number: 1508030-036 Customer Sample Number:
Location: H12 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	50.9 ug/L	8/14/2015	Rhoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	10.4 ug/L	8/14/2015	Rhoffa
Iron	EPA 200.8 5 X DILUTION	ug/L	ug/L	50 ug/L	556 ug/L	8/14/2015	Rhoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	23.0 ug/L	8/14/2015	Rhoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	125 ug/L	8/14/2015	Rhoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.79 ug/L	8/14/2015	Rhoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508030-036

SAMPLE INFORMATION

Sample Number: 1508030-036 Customer Sample Number:
Location: H12 Type: Dist.
LPR 1333 JONQUIL ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/5/2015 7:30 IC/CW 8/5/2015 10:55:23 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-001

SAMPLE INFORMATION

Sample Number: 1508050-001 Customer Sample Number:
Location: 1 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-002

SAMPLE INFORMATION

Sample Number: 1508050-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-003

SAMPLE INFORMATION

Sample Number: 1508050-003
Location: 02
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015	Collection Time: 7:30	Sampler: IC/DVC	Received Date and Time: 8/7/2015 11:38:13 AM	Received By: JCross
------------------------------	--------------------------	--------------------	---	------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.8 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	21.9 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.83 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.86 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-003

SAMPLE INFORMATION

Sample Number: 1508050-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-004

SAMPLE INFORMATION

Sample Number: 1508050-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-005

SAMPLE INFORMATION

Sample Number: 1508050-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-006

SAMPLE INFORMATION

Sample Number: 1508050-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-007

SAMPLE INFORMATION

Sample Number: 1508050-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-008

SAMPLE INFORMATION

Sample Number: 1508050-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-009

SAMPLE INFORMATION

Sample Number: 1508050-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-010

SAMPLE INFORMATION

Sample Number: 1508050-010
Location: 05F
LPR 411 7TH ST NE (FILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 8/7/2015
Collection Time: 7:30
Sampler: IC/DVC
Received Date and Time: 8/7/2015 11:38:13 AM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	40.4 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	21.5 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.00 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.02 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-010

SAMPLE INFORMATION

Sample Number: 1508050-010 Customer Sample Number:
Location: 05F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-011

SAMPLE INFORMATION

Sample Number: 1508050-011
Location: 06
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.9 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	32.5 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.92 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	6.82 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-011

SAMPLE INFORMATION

Sample Number: 1508050-011 Customer Sample Number:
Location: 06 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-012

SAMPLE INFORMATION

Sample Number: 1508050-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number:M- W1508050-013

SAMPLE INFORMATION

Sample Number: 1508050-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.8 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	37.2 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.95 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	5.77 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-013

SAMPLE INFORMATION

Sample Number: 1508050-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-014

SAMPLE INFORMATION

Sample Number: 1508050-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-015

SAMPLE INFORMATION


Sample Number: 1508050-015
Location: 08
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-016

SAMPLE INFORMATION

Sample Number: 1508050-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-017

SAMPLE INFORMATION

Sample Number: 1508050-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-018

SAMPLE INFORMATION

Sample Number: 1508050-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-019

SAMPLE INFORMATION


Sample Number: 1508050-019
Location: 10
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-020

SAMPLE INFORMATION

Sample Number: 1508050-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-021

SAMPLE INFORMATION

Sample Number: 1508050-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-022

SAMPLE INFORMATION

Sample Number: 1508050-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-023

SAMPLE INFORMATION

Sample Number: 1508050-023
Location: 12
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015	Collection Time: 7:30	Sampler: IC/DVC	Received Date and Time: 8/7/2015 11:38:13 AM	Received By: JCross
------------------------------	--------------------------	--------------------	---	------------------------

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	47.1 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	98.8 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.10 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.03 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-023

SAMPLE INFORMATION


Sample Number: 1508050-023
Location: 12
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-024

SAMPLE INFORMATION

Sample Number: 1508050-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	42.2 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	90.5 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.21 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.06 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-024

SAMPLE INFORMATION

Sample Number: 1508050-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-025

SAMPLE INFORMATION

Sample Number: 1508050-025
Location: 13
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/7/2015	7:30	IC/DVC	8/7/2015 11:38:13 AM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	49.6 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	123 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.33 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.96 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-025

SAMPLE INFORMATION


Sample Number: 1508050-025
Location: 13
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-026

SAMPLE INFORMATION

Sample Number: 1508050-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-027

SAMPLE INFORMATION

Sample Number: 1508050-027 Customer Sample Number:
Location: 14 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-028

SAMPLE INFORMATION

Sample Number: 1508050-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.7 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	ND ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	97.1 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.24 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.37 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-028

SAMPLE INFORMATION

Sample Number: 1508050-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-029

SAMPLE INFORMATION

Sample Number: 1508050-029 Customer Sample Number:
Location: 15 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	52.0 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	95.2 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.32 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.65 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-029

SAMPLE INFORMATION

Sample Number: 1508050-029 Customer Sample Number:
Location: 15 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-030

SAMPLE INFORMATION

Sample Number: 1508050-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-031

SAMPLE INFORMATION

Sample Number: 1508050-031 Customer Sample Number:
Location: 16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-032

SAMPLE INFORMATION

Sample Number: 1508050-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-033

SAMPLE INFORMATION

Sample Number: 1508050-033 Customer Sample Number:
Location: 17 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-034

SAMPLE INFORMATION

Sample Number: 1508050-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-035

SAMPLE INFORMATION

Sample Number: 1508050-035
Location: 18
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	60.5 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	57.2 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.61 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.57 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-035

SAMPLE INFORMATION

Sample Number: 1508050-035 Customer Sample Number:
Location: 18 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-036

SAMPLE INFORMATION

Sample Number: 1508050-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-037

SAMPLE INFORMATION

Sample Number: 1508050-037 Customer Sample Number:
Location: 19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-038

SAMPLE INFORMATION

Sample Number: 1508050-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-039

SAMPLE INFORMATION

Sample Number: 1508050-039
Location: 20
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/7/2015	7:30	IC/DVC	8/7/2015 11:38:13 AM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	56.3 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	37.9 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.79 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.56 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-039

SAMPLE INFORMATION


Sample Number: 1508050-039
Location: 20
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-040

SAMPLE INFORMATION

Sample Number: 1508050-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-041

SAMPLE INFORMATION

Sample Number: 1508050-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-042

SAMPLE INFORMATION

Sample Number: 1508050-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	57.7 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.8 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	26.7 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.01 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.49 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-042

SAMPLE INFORMATION

Sample Number: 1508050-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-043

SAMPLE INFORMATION

Sample Number: 1508050-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	58.1 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	22.9 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.24 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.13 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-043

SAMPLE INFORMATION

Sample Number: 1508050-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-044

SAMPLE INFORMATION

Sample Number: 1508050-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-045

SAMPLE INFORMATION

Sample Number: 1508050-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-046

SAMPLE INFORMATION

Sample Number: 1508050-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	58.0 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	20.0 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.06 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.13 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-046

SAMPLE INFORMATION

Sample Number: 1508050-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-047

SAMPLE INFORMATION

Sample Number: 1508050-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-048

SAMPLE INFORMATION

Sample Number: 1508050-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	56.2 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	19.2 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	1.88 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.99 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-048

SAMPLE INFORMATION

Sample Number: 1508050-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-049

SAMPLE INFORMATION

Sample Number: 1508050-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	59.7 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	20.2 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	2.19 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.10 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-049

SAMPLE INFORMATION

Sample Number: 1508050-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-050

SAMPLE INFORMATION

Sample Number: 1508050-050
Location: H10
LPR 411 7TH ST NE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 8/7/2015
Collection Time: 7:30
Sampler: IC/DVC
Received Date and Time: 8/7/2015 11:38:13 AM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-051

SAMPLE INFORMATION

Sample Number: 1508050-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-052

SAMPLE INFORMATION

Sample Number: 1508050-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-053

SAMPLE INFORMATION

Sample Number: 1508050-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-054

SAMPLE INFORMATION

Sample Number: 1508050-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-056

SAMPLE INFORMATION

Sample Number: 1508050-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-057

SAMPLE INFORMATION

Sample Number: 1508050-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015 Collection Time: 7:30 Sampler: IC/DVC Received Date and Time: 8/7/2015 11:38:13 AM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	60.1 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	20.9 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.71 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.15 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number: M- W1508050-057

SAMPLE INFORMATION

Sample Number: 1508050-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/17/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-058

SAMPLE INFORMATION

Sample Number: 1508050-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-059

SAMPLE INFORMATION

Sample Number: 1508050-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/17/2015
Report Number:M- W1508050-060

SAMPLE INFORMATION

Sample Number: 1508050-060
Customer Sample Number:
Location: H20
Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 8/7/2015
Collection Time: 7:30
Sampler: IC/DVC
Received Date and Time: 8/7/2015 11:38:13 AM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	61.6 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	21.9 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.95 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.33 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/17/2015
Report Number: M- W1508050-060

SAMPLE INFORMATION

Sample Number: 1508050-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/7/2015 7:30 IC/DVC 8/7/2015 11:38:13 AM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/17/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-001

SAMPLE INFORMATION

Sample Number: 1508022-001
Location: 1
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/4/2015	8:00	CW/DVC	8/4/2015 2:37:18 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.0 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	133 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	80.1 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.56 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-001

SAMPLE INFORMATION


Sample Number: 1508022-001
Location: 1
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-002

SAMPLE INFORMATION

Sample Number: 1508022-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-003

SAMPLE INFORMATION

Sample Number: 1508022-003
Location: 02
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/4/2015	8:00	CW/DVC	8/4/2015 2:37:18 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.3 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	130 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.49 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.16 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-003

SAMPLE INFORMATION


Sample Number: 1508022-003
Location: 02
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-004

SAMPLE INFORMATION

Sample Number: 1508022-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	42.9 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	125 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	10.7 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.40 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-005

SAMPLE INFORMATION

Sample Number: 1508022-005
Location: 03
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/4/2015	8:00	CW/DVC	8/4/2015 2:37:18 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	47.1 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	128 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	8.39 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.75 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-005

SAMPLE INFORMATION

Sample Number: 1508022-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-006

SAMPLE INFORMATION

Sample Number: 1508022-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-007

SAMPLE INFORMATION

Sample Number: 1508022-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-008

SAMPLE INFORMATION

Sample Number: 1508022-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-009

SAMPLE INFORMATION

Sample Number: 1508022-009
Location: 05
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	43.0 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	119 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	10.7 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	9.78 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-009

SAMPLE INFORMATION

Sample Number: 1508022-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-010

SAMPLE INFORMATION

Sample Number: 1508022-010 Customer Sample Number:
Location: 05F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-011

SAMPLE INFORMATION

Sample Number: 1508022-011
Location: 06
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/4/2015	8:00	CW/DVC	8/4/2015 2:37:18 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	42.4 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	147 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	6.93 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	10.4 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-011

SAMPLE INFORMATION

Sample Number: 1508022-011 Customer Sample Number:
Location: 06 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-012

SAMPLE INFORMATION

Sample Number: 1508022-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-013

SAMPLE INFORMATION

Sample Number: 1508022-013
Location: 07
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/4/2015	8:00	CW/DVC	8/4/2015 2:37:18 PM	JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.2 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	143 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	9.13 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	7.42 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-013

SAMPLE INFORMATION

Sample Number: 1508022-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-014

SAMPLE INFORMATION

Sample Number: 1508022-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-015

SAMPLE INFORMATION

Sample Number: 1508022-015
Location: 08
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.2 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	142 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	12.5 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	5.17 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-015

SAMPLE INFORMATION

Sample Number: 1508022-015 Customer Sample Number:
Location: 08 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-016

SAMPLE INFORMATION

Sample Number: 1508022-016
Location: 08F
LPR 1527 9TH ST NW FILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 8/4/2015
Collection Time: 8:00
Sampler: CW/DVC
Received Date and Time: 8/4/2015 2:37:18 PM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.5 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	132 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	16.6 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.95 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-016

SAMPLE INFORMATION

Sample Number: 1508022-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-017

SAMPLE INFORMATION

Sample Number: 1508022-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	46.0 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/18/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	151 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	12.3 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	4.10 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-017

SAMPLE INFORMATION

Sample Number: 1508022-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-018

SAMPLE INFORMATION

Sample Number: 1508022-018
Location: 09F
LPR 1527 9TH ST NW FILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 8/4/2015
Collection Time: 8:00
Sampler: CW/DVC
Received Date and Time: 8/4/2015 2:37:18 PM
Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	41.0 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	139 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	14.8 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.17 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-018

SAMPLE INFORMATION

Sample Number: 1508022-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-019

SAMPLE INFORMATION

Sample Number: 1508022-019
Location: 10
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	44.8 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	157 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	11.3 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	3.02 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-019

SAMPLE INFORMATION

Sample Number: 1508022-019 Customer Sample Number:
Location: 10 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-020

SAMPLE INFORMATION

Sample Number: 1508022-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-021

SAMPLE INFORMATION

Sample Number: 1508022-021
Location: 11
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	45.9 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	160 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	7.11 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.96 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-021

SAMPLE INFORMATION


Sample Number: 1508022-021
Location: 11
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-022

SAMPLE INFORMATION

Sample Number: 1508022-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-023

SAMPLE INFORMATION

Sample Number: 1508022-023
Location: 12
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	47.3 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.4 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	155 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.33 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.22 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-023

SAMPLE INFORMATION


Sample Number: 1508022-023
Location: 12
LPR 1527 9TH ST NW UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-024

SAMPLE INFORMATION

Sample Number: 1508022-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	42.1 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.3 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	140 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	9.78 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.9 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-024

SAMPLE INFORMATION

Sample Number: 1508022-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 1527 9TH ST NW FILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-025

SAMPLE INFORMATION

Sample Number: 1508022-025 Customer Sample Number:
Location: H1 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-026

SAMPLE INFORMATION

Sample Number: 1508022-026 Customer Sample Number:
Location: H2 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	49.3 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	125 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	10.8 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	2.36 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-026

SAMPLE INFORMATION

Sample Number: 1508022-026 Customer Sample Number:
Location: H2 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-027

SAMPLE INFORMATION

Sample Number: 1508022-027 Customer Sample Number:
Location: H3 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-028

SAMPLE INFORMATION

Sample Number: 1508022-028 Customer Sample Number:
Location: H4 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-029

SAMPLE INFORMATION

Sample Number: 1508022-029 Customer Sample Number:
Location: H5 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-030

SAMPLE INFORMATION

Sample Number: 1508022-030 Customer Sample Number:
Location: H6 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	56.4 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	51.1 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	5.35 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.36 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-030

SAMPLE INFORMATION

Sample Number: 1508022-030 Customer Sample Number:
Location: H6 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-031

SAMPLE INFORMATION

Sample Number: 1508022-031 Customer Sample Number:
Location: H7 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa
Robert P. Hoffa, Laboratory Manager

8/19/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-032

SAMPLE INFORMATION

Sample Number: 1508022-032 Customer Sample Number:
Location: H8 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	56.6 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.6 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	45.6 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	3.73 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.26 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-032

SAMPLE INFORMATION

Sample Number: 1508022-032 Customer Sample Number:
Location: H8 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-033

SAMPLE INFORMATION

Sample Number: 1508022-033 Customer Sample Number:
Location: H9 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 8/19/2015
Report Number: M- W1508022-034

SAMPLE INFORMATION

Sample Number: 1508022-034 Customer Sample Number:
Location: H10 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

8/19/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-035

SAMPLE INFORMATION

Sample Number: 1508022-035 Customer Sample Number:
Location: H11 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	ug/L	ug/L	10 ug/L	56.2 ug/L	8/14/2015	RHoffa
Manganese	EPA 200.8	ug/L	ug/L	0.2 ug/L	0.5 ug/L	8/14/2015	RHoffa
Iron	EPA 200.8	ug/L	ug/L	10 ug/L	ND ug/L	8/14/2015	RHoffa
Copper	EPA 200.8	ug/L	ug/L	0.2 ug/L	37.8 ug/L	8/14/2015	RHoffa
Zinc	EPA 200.8	ug/L	ug/L	0.5 ug/L	4.96 ug/L	8/14/2015	RHoffa
Lead	EPA 200.8	ug/L	ug/L	0.2 ug/L	1.48 ug/L	8/14/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-035

SAMPLE INFORMATION

Sample Number: 1508022-035 Customer Sample Number:
Location: H11 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: 8/4/2015 Collection Time: 8:00 Sampler: CW/DVC Received Date and Time: 8/4/2015 2:37:18 PM Received By: JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 8/19/2015
Report Number: M- W1508022-036

SAMPLE INFORMATION

Sample Number: 1508022-036 Customer Sample Number:
Location: H12 Type: Dist.
LPR 1527 9TH ST NW UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/4/2015 8:00 CW/DVC 8/4/2015 2:37:18 PM JCross

Parameter	Method	MCL	MDL	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	-----	-----	--------	---------------	---------

Reviewed By: *Robert P. Hoffa* 8/19/2015
Robert P. Hoffa, Laboratory Manager Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0050 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-001

SAMPLE INFORMATION

Sample Number: 1508176-001 Customer Sample Number:
Location: 1 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-002

SAMPLE INFORMATION

Sample Number: 1508176-002
Location: 1F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	25.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.3 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	112 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	73.4 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.48 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-002

SAMPLE INFORMATION

Sample Number: 1508176-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-003

SAMPLE INFORMATION

Sample Number: 1508176-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	30.3 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.6 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	93.3 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	25.8 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.83 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-003

SAMPLE INFORMATION


Sample Number: 1508176-003
Location: 02
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-004

SAMPLE INFORMATION

Sample Number: 1508176-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-005

SAMPLE INFORMATION

Sample Number: 1508176-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-006

SAMPLE INFORMATION


Sample Number: 1508176-006
Location: 03F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-007

SAMPLE INFORMATION

Sample Number: 1508176-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	95.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	11.8 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.66 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-007

SAMPLE INFORMATION

Sample Number: 1508176-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-008

SAMPLE INFORMATION


Sample Number: 1508176-008
Location: 04F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-009

SAMPLE INFORMATION

Sample Number: 1508176-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	40.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	91.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.80 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.29 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-009

SAMPLE INFORMATION


Sample Number: 1508176-009
Location: 05
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-010

SAMPLE INFORMATION

Sample Number: 1508176-010
Location: 05F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	91.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	10.4 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.9 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-010

SAMPLE INFORMATION


Sample Number: 1508176-010
Location: 05F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-011

SAMPLE INFORMATION

Sample Number: 1508176-011 Customer Sample Number:
Location: 06 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	46.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	91.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.28 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.48 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-011

SAMPLE INFORMATION


Sample Number: 1508176-011
Location: 06
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-012

SAMPLE INFORMATION

Sample Number: 1508176-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	43.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	85.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	9.95 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.84 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-012

SAMPLE INFORMATION

Sample Number: 1508176-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-013

SAMPLE INFORMATION

Sample Number: 1508176-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	47.7 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	80.7 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	8.00 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.26 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-013

SAMPLE INFORMATION


Sample Number: 1508176-013
Location: 07
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-014

SAMPLE INFORMATION

Sample Number: 1508176-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-015

SAMPLE INFORMATION


Sample Number: 1508176-015
Location: 08
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-016

SAMPLE INFORMATION

Sample Number: 1508176-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-017

SAMPLE INFORMATION

Sample Number: 1508176-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	58.8 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.76 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.06 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-017

SAMPLE INFORMATION

Sample Number: 1508176-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-018

SAMPLE INFORMATION


Sample Number: 1508176-018
Location: 09F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-019

SAMPLE INFORMATION

Sample Number: 1508176-019 Customer Sample Number:
Location: 10 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	42.7 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	47.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.25 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.94 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-019

SAMPLE INFORMATION


Sample Number: 1508176-019
Location: 10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-020

SAMPLE INFORMATION

Sample Number: 1508176-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	47.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	50.7 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.36 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.48 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-020

SAMPLE INFORMATION


Sample Number: 1508176-020
Location: 10F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-021

SAMPLE INFORMATION


Sample Number: 1508176-021
Location: 11
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-022

SAMPLE INFORMATION

Sample Number: 1508176-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-023

SAMPLE INFORMATION


Sample Number: 1508176-023
Location: 12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-024

SAMPLE INFORMATION

Sample Number: 1508176-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-025

SAMPLE INFORMATION


Sample Number: 1508176-025
Location: 13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-026

SAMPLE INFORMATION


Sample Number: 1508176-026
Location: 13F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-027

SAMPLE INFORMATION

Sample Number: 1508176-027
Location: 14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	49.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.0 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	32.2 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.36 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.5 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-027

SAMPLE INFORMATION

Sample Number: 1508176-027 Customer Sample Number:
Location: 14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-028

SAMPLE INFORMATION

Sample Number: 1508176-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number:M- W1508176-029

SAMPLE INFORMATION

Sample Number: 1508176-029 Customer Sample Number:
Location: 15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	53.0 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.07 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	34.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.24 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.6 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-029

SAMPLE INFORMATION


Sample Number: 1508176-029
Location: 15
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-030

SAMPLE INFORMATION


Sample Number: 1508176-030
Location: 15F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-031

SAMPLE INFORMATION


Sample Number: 1508176-031
Location: 16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-033

SAMPLE INFORMATION

Sample Number: 1508176-033 Customer Sample Number:
Location: 17 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	49.3 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.02 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.4 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.93 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.5 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-033

SAMPLE INFORMATION


Sample Number: 1508176-033
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-034

SAMPLE INFORMATION

Sample Number: 1508176-034
Location: 17F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	30.8 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.32 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.2 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-034

SAMPLE INFORMATION


Sample Number: 1508176-034
Location: 17F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-035

SAMPLE INFORMATION


Sample Number: 1508176-035
Location: 18
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-036

SAMPLE INFORMATION


Sample Number: 1508176-036
Location: 18F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-037

SAMPLE INFORMATION


Sample Number: 1508176-037
Location: 19
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-038

SAMPLE INFORMATION

Sample Number: 1508176-038
Location: 19F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.3 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.11 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.2 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-038

SAMPLE INFORMATION

Sample Number: 1508176-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-039

SAMPLE INFORMATION

Sample Number: 1508176-039 Customer Sample Number:
Location: 20 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	58.7 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.28 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	12.6 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	30.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.80 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-039

SAMPLE INFORMATION


Sample Number: 1508176-039
Location: 20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-040

SAMPLE INFORMATION


Sample Number: 1508176-040
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-041

SAMPLE INFORMATION

Sample Number: 1508176-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	62.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.58 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	24.9 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	51.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	48.1 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	5.38 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-041

SAMPLE INFORMATION

Sample Number: 1508176-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-042

SAMPLE INFORMATION

Sample Number: 1508176-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	56.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.26 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	15.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	39.4 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	8.24 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.46 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-042

SAMPLE INFORMATION

Sample Number: 1508176-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-043

SAMPLE INFORMATION

Sample Number: 1508176-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-044

SAMPLE INFORMATION

Sample Number: 1508176-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	55.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.20 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	11.4 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	37.7 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.42 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.9 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-044

SAMPLE INFORMATION

Sample Number: 1508176-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-045

SAMPLE INFORMATION

Sample Number: 1508176-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-046

SAMPLE INFORMATION

Sample Number: 1508176-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-047

SAMPLE INFORMATION

Sample Number: 1508176-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	56.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.23 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	11.0 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	33.2 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.86 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	0.8 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-047

SAMPLE INFORMATION

Sample Number: 1508176-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-048

SAMPLE INFORMATION

Sample Number: 1508176-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-049

SAMPLE INFORMATION

Sample Number: 1508176-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	56.3 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.28 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	12.2 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	30.2 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.95 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.02 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-049

SAMPLE INFORMATION

Sample Number: 1508176-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-050

SAMPLE INFORMATION

Sample Number: 1508176-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-051

SAMPLE INFORMATION

Sample Number: 1508176-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-052

SAMPLE INFORMATION

Sample Number: 1508176-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-053

SAMPLE INFORMATION

Sample Number: 1508176-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-054

SAMPLE INFORMATION

Sample Number: 1508176-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	60.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.27 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	11.8 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	31.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.45 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.25 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-055

SAMPLE INFORMATION

Sample Number: 1508176-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	61.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.30 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	12.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	31.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.52 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.35 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-055

SAMPLE INFORMATION

Sample Number: 1508176-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-056

SAMPLE INFORMATION

Sample Number: 1508176-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-057

SAMPLE INFORMATION

Sample Number: 1508176-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 8/25/2015 Collection Time: 9:00 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:42:19 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	59.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.24 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	10.5 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.2 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.22 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.11 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508176-057

SAMPLE INFORMATION

Sample Number: 1508176-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-059

SAMPLE INFORMATION

Sample Number: 1508176-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508176-060

SAMPLE INFORMATION

Sample Number: 1508176-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:00 YDT/YT 8/25/2015 2:42:19 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-001

SAMPLE INFORMATION

Sample Number: 1508178-001 Customer Sample Number:
Location: 1 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	133 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.15 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	14.4 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	87.3 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	133 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	10.6 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-001

SAMPLE INFORMATION


Sample Number: 1508178-001
Location: 1
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-002

SAMPLE INFORMATION

Sample Number: 1508178-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-003

SAMPLE INFORMATION

Sample Number: 1508178-003
Location: 02
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.9 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	83.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	11.3 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	4.17 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-003

SAMPLE INFORMATION


Sample Number: 1508178-003
Location: 02
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-004

SAMPLE INFORMATION

Sample Number: 1508178-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	40.0 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	82.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	18.2 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.47 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-004

SAMPLE INFORMATION


Sample Number: 1508178-004
Location: 02F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-005

SAMPLE INFORMATION

Sample Number: 1508178-005 Customer Sample Number:
Location: 03 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-006

SAMPLE INFORMATION


Sample Number: 1508178-006
Location: 03F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-007

SAMPLE INFORMATION

Sample Number: 1508178-007
Customer Sample Number:
Location: 04
Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 8/25/2015
Collection Time: 9:30
Sampler: YDT/YT
Received Date and Time: 8/25/2015 2:55:54 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-008

SAMPLE INFORMATION

Sample Number: 1508178-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	79.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	11.4 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.46 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-008

SAMPLE INFORMATION

Sample Number: 1508178-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-009

SAMPLE INFORMATION

Sample Number: 1508178-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-010

SAMPLE INFORMATION


Sample Number: 1508178-010
Location: 05F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-011

SAMPLE INFORMATION

Sample Number: 1508178-011
Location: 06
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	43.3 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	80.9 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.99 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.81 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-011

SAMPLE INFORMATION


Sample Number: 1508178-011
Location: 06
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508178-012

SAMPLE INFORMATION

Sample Number: 1508178-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-013

SAMPLE INFORMATION

Sample Number: 1508178-013
Location: 07
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	40.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	73.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.08 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.29 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-013

SAMPLE INFORMATION


Sample Number: 1508178-013
Location: 07
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-014

SAMPLE INFORMATION


Sample Number: 1508178-014
Location: 07F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-015

SAMPLE INFORMATION

Sample Number: 1508178-015
Location: 08
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	74.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.86 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.38 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-015

SAMPLE INFORMATION

Sample Number: 1508178-015 Customer Sample Number:
Location: 08 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-016

SAMPLE INFORMATION

Sample Number: 1508178-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	40.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	75.8 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	8.01 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.56 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-016

SAMPLE INFORMATION


Sample Number: 1508178-016
Location: 08F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-017

SAMPLE INFORMATION

Sample Number: 1508178-017
Location: 09
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	73.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.58 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.31 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-017

SAMPLE INFORMATION


Sample Number: 1508178-017
Location: 09
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-018

SAMPLE INFORMATION

Sample Number: 1508178-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	74.4 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	8.08 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.56 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508178-018

SAMPLE INFORMATION

Sample Number: 1508178-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-019

SAMPLE INFORMATION

Sample Number: 1508178-019
Location: 10
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	70.7 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	9.78 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.44 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-019

SAMPLE INFORMATION


Sample Number: 1508178-019
Location: 10
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-020

SAMPLE INFORMATION

Sample Number: 1508178-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	40.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	72.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.53 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.59 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-020

SAMPLE INFORMATION


Sample Number: 1508178-020
Location: 10F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-021

SAMPLE INFORMATION

Sample Number: 1508178-021
Location: 11
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	42.0 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	65.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.47 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	4.41 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-021

SAMPLE INFORMATION

Sample Number: 1508178-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-022

SAMPLE INFORMATION

Sample Number: 1508178-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-023

SAMPLE INFORMATION

Sample Number: 1508178-023
Location: 12
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	60.8 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.44 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.38 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-023

SAMPLE INFORMATION


Sample Number: 1508178-023
Location: 12
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-024

SAMPLE INFORMATION


Sample Number: 1508178-024
Location: 12F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-025

SAMPLE INFORMATION

Sample Number: 1508178-025
Location: 13
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	43.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	70.9 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.63 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.59 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-025

SAMPLE INFORMATION


Sample Number: 1508178-025
Location: 13
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-026

SAMPLE INFORMATION

Sample Number: 1508178-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	71.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.79 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.61 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-026

SAMPLE INFORMATION


Sample Number: 1508178-026
Location: 13F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-027

SAMPLE INFORMATION

Sample Number: 1508178-027
Location: 14
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	45.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	70.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.20 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	19.4 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-027

SAMPLE INFORMATION

Sample Number: 1508178-027 Customer Sample Number:
Location: 14 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-028

SAMPLE INFORMATION


Sample Number: 1508178-028
Location: 14F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-029

SAMPLE INFORMATION

Sample Number: 1508178-029
Location: 15
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	44.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	68.2 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.10 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	11.4 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-029

SAMPLE INFORMATION


Sample Number: 1508178-029
Location: 15
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-030

SAMPLE INFORMATION

Sample Number: 1508178-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	46.7 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	74.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.36 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	6.22 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-030

SAMPLE INFORMATION

Sample Number: 1508178-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-031

SAMPLE INFORMATION

Sample Number: 1508178-031
Location: 16
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	52.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.9 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	72.8 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.71 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	7.95 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-031

SAMPLE INFORMATION


Sample Number: 1508178-031
Location: 16
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-032

SAMPLE INFORMATION

Sample Number: 1508178-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	45.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.4 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	66.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.14 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	4.97 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-032

SAMPLE INFORMATION

Sample Number: 1508178-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-033

SAMPLE INFORMATION


Sample Number: 1508178-033
Location: 17
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-034

SAMPLE INFORMATION


Sample Number: 1508178-034
Location: 17F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-035

Report revised on 9/15/15 by MC.
For Lab Sample Number 1508178-035, the Location ID was
changed from 18F to 18 as reported on the associated chain-of-
custody form.

SAMPLE INFORMATION

Sample Number: 1508178-035
Location: 18
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	55.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.52 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	13.6 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	51.7 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.03 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	8.65 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-035

SAMPLE INFORMATION


Sample Number: 1508178-035
Location: 18
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-036

SAMPLE INFORMATION

Sample Number: 1508178-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	47.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	50.7 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.97 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	6.18 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-036

SAMPLE INFORMATION


Sample Number: 1508178-036
Location: 18F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-037

Report revised on 9/15/15 by MC.
For Lab Sample Number 1508178-037, the Location ID was changed from 19F to 19 as reported on the associated chain-of-custody form.

SAMPLE INFORMATION

Sample Number: 1508178-037
Location: 19
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date:	Collection Time:	Sampler:	Received Date and Time:	Received By:
8/25/2015	9:30	YDT/YT	8/25/2015 2:55:54 PM	JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	58.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.68 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	16.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	49.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.95 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	8.41 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-037

SAMPLE INFORMATION


Sample Number: 1508178-037
Location: 19
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508178-038

SAMPLE INFORMATION

Sample Number: 1508178-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-039

SAMPLE INFORMATION

Sample Number: 1508178-039
Location: 20
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	53.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.38 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	10.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	39.3 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.69 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	6.76 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-039

SAMPLE INFORMATION


Sample Number: 1508178-039
Location: 20
LPR 3121 MLK AVE SE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-040

SAMPLE INFORMATION

Sample Number: 1508178-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 3121 MLK AVE SE (FILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.2 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	39.9 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.75 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	4.76 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-040

SAMPLE INFORMATION


Sample Number: 1508178-040
Location: 20F
LPR 3121 MLK AVE SE (FILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-041

SAMPLE INFORMATION

Sample Number: 1508178-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment: 10 x dilution. Reanalysis was performed on 9/10/15 at 0853 by AJP.

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-042

SAMPLE INFORMATION

Sample Number: 1508178-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	70.9 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.33 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	29.3 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	50.2 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	9.25 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	53.3 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-042

SAMPLE INFORMATION

Sample Number: 1508178-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-043

SAMPLE INFORMATION

Sample Number: 1508178-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	73.7 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.83 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	35.8 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	55.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.25 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	30.7 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-043

SAMPLE INFORMATION

Sample Number: 1508178-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-044

SAMPLE INFORMATION

Sample Number: 1508178-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	67.4 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.35 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	27.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	48.9 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.49 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	25.7 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508178-044

SAMPLE INFORMATION

Sample Number: 1508178-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-045

SAMPLE INFORMATION

Sample Number: 1508178-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	69.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.61 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	29.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	50.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.35 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	27.9 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-045

SAMPLE INFORMATION

Sample Number: 1508178-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-046

SAMPLE INFORMATION

Sample Number: 1508178-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	69.5 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.56 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	29.0 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	49.5 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.02 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	25.2 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-046

SAMPLE INFORMATION

Sample Number: 1508178-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-047

SAMPLE INFORMATION

Sample Number: 1508178-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	71.0 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.70 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	31.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	50.6 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.74 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	22.7 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-047

SAMPLE INFORMATION

Sample Number: 1508178-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-048

SAMPLE INFORMATION

Sample Number: 1508178-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	70.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.75 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	32.3 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	49.4 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.55 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	21.0 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-048

SAMPLE INFORMATION

Sample Number: 1508178-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-049

SAMPLE INFORMATION

Sample Number: 1508178-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	76.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	3.12 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	40.0 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	53.3 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.76 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	37.3 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-049

SAMPLE INFORMATION

Sample Number: 1508178-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-050

SAMPLE INFORMATION

Sample Number: 1508178-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	76.4 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.96 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	39.3 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	52.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.20 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	27.6 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508178-050

SAMPLE INFORMATION

Sample Number: 1508178-050 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-051

SAMPLE INFORMATION

Sample Number: 1508178-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-052

SAMPLE INFORMATION

Sample Number: 1508178-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: 8/25/2015 Collection Time: 9:30 Sampler: YDT/YT Received Date and Time: 8/25/2015 2:55:54 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	73.4 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.81 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	37.4 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	56.0 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.00 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	149 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-052

SAMPLE INFORMATION

Sample Number: 1508178-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-053

SAMPLE INFORMATION

Sample Number: 1508178-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	65.8 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.02 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	22.1 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	78.3 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.98 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	56.4 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-053

SAMPLE INFORMATION

Sample Number: 1508178-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-054

SAMPLE INFORMATION

Sample Number: 1508178-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	70.4 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.32 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	32.0 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	94.8 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	9.66 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	47.2 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-054

SAMPLE INFORMATION

Sample Number: 1508178-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-055

SAMPLE INFORMATION

Sample Number: 1508178-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment: 2 X dilution - due to ISTD interference. Reanalysis was performed on 9/10/15 at 0854 by AJP.

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-056

SAMPLE INFORMATION

Sample Number: 1508178-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment: 5 x dilution due ISTD interference. Reanalysis was performed on 9/10/15 at 0856 by AJP.

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 9/14/2015
Report Number: M- W1508178-057

SAMPLE INFORMATION

Sample Number: 1508178-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-058

SAMPLE INFORMATION

Sample Number: 1508178-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	74.6 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.54 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	37.3 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	79.1 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.01 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	14.0 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-058

SAMPLE INFORMATION

Sample Number: 1508178-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-059

SAMPLE INFORMATION

Sample Number: 1508178-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	72.1 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	2.24 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	31.9 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	73.4 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.91 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	21.5 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-059

SAMPLE INFORMATION

Sample Number: 1508178-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-060

SAMPLE INFORMATION

Sample Number: 1508178-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	68.7 ug/L	9/3/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.96 ug/L	9/3/2015	TPasquale
Iron	EPA 200.8	10 ug/L	25.6 ug/L	9/3/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	60.4 ug/L	9/3/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.77 ug/L	9/3/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	13.7 ug/L	9/3/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/14/2015
Report Number: M- W1508178-060

SAMPLE INFORMATION

Sample Number: 1508178-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3121 MLK AVE SE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
8/25/2015 9:30 YDT/YT 8/25/2015 2:55:54 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

9/14/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level MDL = Minimum Detection Level RDL = Reporting Detection Limit ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-001

SAMPLE INFORMATION

Sample Number: 1509025-001 Customer Sample Number:
Location: 1 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-002

SAMPLE INFORMATION

Sample Number: 1509025-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-003

SAMPLE INFORMATION

Sample Number: 1509025-003
Location: 02
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	24.6 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.89 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.36 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-003

SAMPLE INFORMATION

Sample Number: 1509025-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-004

SAMPLE INFORMATION

Sample Number: 1509025-004
Location: 02F
LPR 411 7TH ST NE (FILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	36.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.2 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	24.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	11.7 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.67 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-005

SAMPLE INFORMATION


Sample Number: 1509025-005
Location: 03
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-006

SAMPLE INFORMATION

Sample Number: 1509025-006 Customer Sample Number:
Location: 03F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-007

SAMPLE INFORMATION

Sample Number: 1509025-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	42.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	27.9 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.66 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.16 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-007

SAMPLE INFORMATION

Sample Number: 1509025-007 Customer Sample Number:
Location: 04 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-008

SAMPLE INFORMATION

Sample Number: 1509025-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	37.3 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.2 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	25.5 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.16 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.40 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-008

SAMPLE INFORMATION

Sample Number: 1509025-008 Customer Sample Number:
Location: 04F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-009

SAMPLE INFORMATION

Sample Number: 1509025-009 Customer Sample Number:
Location: 05 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.9 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	31.2 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.19 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.05 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-009

SAMPLE INFORMATION


Sample Number: 1509025-009
Location: 05
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-010

SAMPLE INFORMATION

Sample Number: 1509025-010 Customer Sample Number:
Location: 05F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-011

SAMPLE INFORMATION

Sample Number: 1509025-011 Customer Sample Number:
Location: 06 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	42.1 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	31.7 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.94 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.22 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-011

SAMPLE INFORMATION

Sample Number: 1509025-011
Location: 06
LPR 411 7TH ST NE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-012

SAMPLE INFORMATION

Sample Number: 1509025-012 Customer Sample Number:
Location: 06F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-013

SAMPLE INFORMATION

Sample Number: 1509025-013
Location: 07
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	39.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	31.7 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.01 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.32 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-013

SAMPLE INFORMATION

Sample Number: 1509025-013 Customer Sample Number:
Location: 07 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-014

SAMPLE INFORMATION

Sample Number: 1509025-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.6 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	29.4 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	8.16 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.76 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-014

SAMPLE INFORMATION

Sample Number: 1509025-014 Customer Sample Number:
Location: 07F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-015

SAMPLE INFORMATION

Sample Number: 1509025-015
Location: 08
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	36.3 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	39.6 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.48 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	5.14 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-015

SAMPLE INFORMATION

Sample Number: 1509025-015
Location: 08
LPR 411 7TH ST NE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-016

SAMPLE INFORMATION

Sample Number: 1509025-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	30.5 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	35.4 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.99 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	4.07 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-016

SAMPLE INFORMATION

Sample Number: 1509025-016 Customer Sample Number:
Location: 08F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-017

SAMPLE INFORMATION

Sample Number: 1509025-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.4 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	43.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.80 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	8.06 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-017

SAMPLE INFORMATION

Sample Number: 1509025-017 Customer Sample Number:
Location: 09 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-018

SAMPLE INFORMATION

Sample Number: 1509025-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	28.9 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	37.8 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	7.18 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	6.49 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-018

SAMPLE INFORMATION

Sample Number: 1509025-018 Customer Sample Number:
Location: 09F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number:M- W1509025-019

SAMPLE INFORMATION

Sample Number: 1509025-019 Customer Sample Number:
Location: 10 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.5 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.6 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	43.2 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.44 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	7.95 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-019

SAMPLE INFORMATION

Sample Number: 1509025-019 Customer Sample Number:
Location: 10 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-020

SAMPLE INFORMATION

Sample Number: 1509025-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	28.9 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	39.4 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.08 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	6.71 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-020

SAMPLE INFORMATION

Sample Number: 1509025-020 Customer Sample Number:
Location: 10F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-021

SAMPLE INFORMATION

Sample Number: 1509025-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.8 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	59.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.51 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	7.43 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-021

SAMPLE INFORMATION

Sample Number: 1509025-021 Customer Sample Number:
Location: 11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-022

SAMPLE INFORMATION

Sample Number: 1509025-022 Customer Sample Number:
Location: 11F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-023

SAMPLE INFORMATION


Sample Number: 1509025-023
Location: 12
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-024

SAMPLE INFORMATION

Sample Number: 1509025-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	30.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	107 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.69 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.42 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-024

SAMPLE INFORMATION

Sample Number: 1509025-024 Customer Sample Number:
Location: 12F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-025

SAMPLE INFORMATION

Sample Number: 1509025-025
Location: 13
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	37.4 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	133 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.12 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.68 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-025

SAMPLE INFORMATION

Sample Number: 1509025-025 Customer Sample Number:
Location: 13 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number:M- W1509025-026

SAMPLE INFORMATION

Sample Number: 1509025-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	31.6 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	122 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.21 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.36 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-026

SAMPLE INFORMATION

Sample Number: 1509025-026 Customer Sample Number:
Location: 13F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-027

SAMPLE INFORMATION

Sample Number: 1509025-027 Customer Sample Number:
Location: 14 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-028

SAMPLE INFORMATION

Sample Number: 1509025-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.4 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	98.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.63 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.30 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-028

SAMPLE INFORMATION

Sample Number: 1509025-028 Customer Sample Number:
Location: 14F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-029

SAMPLE INFORMATION

Sample Number: 1509025-029 Customer Sample Number:
Location: 15 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-030

SAMPLE INFORMATION

Sample Number: 1509025-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	33.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	104 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.18 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.30 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-030

SAMPLE INFORMATION

Sample Number: 1509025-030 Customer Sample Number:
Location: 15F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-031

SAMPLE INFORMATION

Sample Number: 1509025-031 Customer Sample Number:
Location: 16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	39.5 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	120 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.00 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.53 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-031

SAMPLE INFORMATION

Sample Number: 1509025-031 Customer Sample Number:
Location: 16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-032

SAMPLE INFORMATION

Sample Number: 1509025-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	112 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.49 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.27 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-032

SAMPLE INFORMATION

Sample Number: 1509025-032 Customer Sample Number:
Location: 16F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-033

SAMPLE INFORMATION

Sample Number: 1509025-033
Location: 17
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	39.9 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.8 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	123 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.46 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.53 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-033

SAMPLE INFORMATION


Sample Number: 1509025-033
Location: 17
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-034

SAMPLE INFORMATION

Sample Number: 1509025-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	33.6 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	112 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.92 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.23 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-034

SAMPLE INFORMATION

Sample Number: 1509025-034 Customer Sample Number:
Location: 17F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-035

SAMPLE INFORMATION


Sample Number: 1509025-035
Location: 18
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-036

SAMPLE INFORMATION

Sample Number: 1509025-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	34.2 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	112 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.62 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.28 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-036

SAMPLE INFORMATION

Sample Number: 1509025-036 Customer Sample Number:
Location: 18F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-037

SAMPLE INFORMATION

Sample Number: 1509025-037 Customer Sample Number:
Location: 19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-038

SAMPLE INFORMATION

Sample Number: 1509025-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	35.1 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	ND ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	89.7 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.89 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.23 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-038

SAMPLE INFORMATION

Sample Number: 1509025-038 Customer Sample Number:
Location: 19F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number:M- W1509025-039

SAMPLE INFORMATION

Sample Number: 1509025-039
Location: 20
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	44.4 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.08 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	59.9 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.16 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.59 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-039

SAMPLE INFORMATION


Sample Number: 1509025-039
Location: 20
LPR 411 7TH ST NE (UNFILTERED)

Customer Sample Number:
Type: Dist.

Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-040

SAMPLE INFORMATION

Sample Number: 1509025-040
Location: 20F
LPR 411 7TH ST NE (FILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	37.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	0.2 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	55.6 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.08 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	1.17 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-040

SAMPLE INFORMATION

Sample Number: 1509025-040 Customer Sample Number:
Location: 20F Type: Dist.
LPR 411 7TH ST NE (FILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-041

SAMPLE INFORMATION

Sample Number: 1509025-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	69.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	5.35 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	10.4 ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	47.7 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	16.5 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	7.07 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-041

SAMPLE INFORMATION

Sample Number: 1509025-041 Customer Sample Number:
Location: H1 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-042

SAMPLE INFORMATION

Sample Number: 1509025-042 Customer Sample Number:
Location: H2 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-043

SAMPLE INFORMATION

Sample Number: 1509025-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	49.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.56 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	32.7 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.42 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.26 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-043

SAMPLE INFORMATION

Sample Number: 1509025-043 Customer Sample Number:
Location: H3 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-044

SAMPLE INFORMATION

Sample Number: 1509025-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	49.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.66 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.7 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	6.65 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.59 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-044

SAMPLE INFORMATION

Sample Number: 1509025-044 Customer Sample Number:
Location: H4 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-045

SAMPLE INFORMATION

Sample Number: 1509025-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	49.2 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.51 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.6 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	4.33 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.49 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-045

SAMPLE INFORMATION

Sample Number: 1509025-045 Customer Sample Number:
Location: H5 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-046

SAMPLE INFORMATION

Sample Number: 1509025-046 Customer Sample Number:
Location: H6 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-047

SAMPLE INFORMATION

Sample Number: 1509025-047 Customer Sample Number:
Location: H7 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-048

SAMPLE INFORMATION

Sample Number: 1509025-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.42 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	25.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.11 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.32 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-048

SAMPLE INFORMATION

Sample Number: 1509025-048 Customer Sample Number:
Location: H8 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-049

SAMPLE INFORMATION

Sample Number: 1509025-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.3 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.39 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	25.6 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.34 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.34 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-049

SAMPLE INFORMATION

Sample Number: 1509025-049 Customer Sample Number:
Location: H9 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-050

SAMPLE INFORMATION

Sample Number: 1509025-050
Customer Sample Number:
Location: H10
Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	47.7 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.41 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	24.5 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.00 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.64 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-050

SAMPLE INFORMATION

Sample Number: 1509025-050
Customer Sample Number:
Location: H10
Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-051

SAMPLE INFORMATION

Sample Number: 1509025-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	47.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.38 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	23.0 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.28 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.15 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-051

SAMPLE INFORMATION

Sample Number: 1509025-051 Customer Sample Number:
Location: H11 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-052

SAMPLE INFORMATION

Sample Number: 1509025-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	46.6 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.36 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	22.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.60 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.14 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-052

SAMPLE INFORMATION

Sample Number: 1509025-052 Customer Sample Number:
Location: H12 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-053

SAMPLE INFORMATION

Sample Number: 1509025-053 Customer Sample Number:
Location: H13 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number:M- W1509025-054

SAMPLE INFORMATION

Sample Number: 1509025-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	47.8 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.52 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	25.9 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.61 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	3.39 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-054

SAMPLE INFORMATION

Sample Number: 1509025-054 Customer Sample Number:
Location: H14 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-055

SAMPLE INFORMATION

Sample Number: 1509025-055 Customer Sample Number:
Location: H15 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.5 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.46 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.8 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	3.26 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.62 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-055

SAMPLE INFORMATION

Sample Number: 1509025-055
Location: H15
LPR 411 7TH ST NE (UNFILTERED)
Customer Sample Number:
Type: Dist.
Collection Date: 9/1/2015
Collection Time: 7:30
Sampler: CW/DVC
Received Date and Time: 9/3/2015 1:35:33 PM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-056

SAMPLE INFORMATION

Sample Number: 1509025-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	79.0 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.60 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	15.1 ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	28.0 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	5.29 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.53 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-056

SAMPLE INFORMATION

Sample Number: 1509025-056 Customer Sample Number:
Location: H16 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-057

SAMPLE INFORMATION

Sample Number: 1509025-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: 9/1/2015 Collection Time: 7:30 Sampler: CW/DVC Received Date and Time: 9/3/2015 1:35:33 PM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	48.5 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.45 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	25.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.52 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.51 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-057

SAMPLE INFORMATION

Sample Number: 1509025-057 Customer Sample Number:
Location: H17 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-058

SAMPLE INFORMATION

Sample Number: 1509025-058 Customer Sample Number:
Location: H18 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-059

SAMPLE INFORMATION

Sample Number: 1509025-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	49.6 ug/L	9/22/2015	TPasquale
Manganese	EPA 200.8	0.2 ug/L	1.48 ug/L	9/22/2015	TPasquale
Iron	EPA 200.8	10 ug/L	ND ug/L	9/22/2015	TPasquale
Copper	EPA 200.8	0.2 ug/L	26.3 ug/L	9/22/2015	TPasquale
Zinc	EPA 200.8	0.5 ug/L	2.64 ug/L	9/22/2015	TPasquale
Lead	EPA 200.8	0.2 ug/L	2.54 ug/L	9/22/2015	TPasquale

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/6/2015
Report Number: M- W1509025-059

SAMPLE INFORMATION

Sample Number: 1509025-059 Customer Sample Number:
Location: H19 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015
Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/6/2015
Report Number: M- W1509025-060

SAMPLE INFORMATION

Sample Number: 1509025-060 Customer Sample Number:
Location: H20 Type: Dist.
LPR 411 7TH ST NE (UNFILTERED)
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/1/2015 7:30 CW/DVC 9/3/2015 1:35:33 PM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/6/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-001

SAMPLE INFORMATION

Sample Number: 1509170-001
Location: 1
LPR 3111 MLK AVE SE UNFILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.6 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	114 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	53.1 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.04 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-001

SAMPLE INFORMATION

Sample Number: 1509170-001
Customer Sample Number:
Location: 1
Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number:M- W1509170-002

SAMPLE INFORMATION

Sample Number: 1509170-002 Customer Sample Number:
Location: 1F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-003

SAMPLE INFORMATION

Sample Number: 1509170-003 Customer Sample Number:
Location: 02 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-004

SAMPLE INFORMATION

Sample Number: 1509170-004 Customer Sample Number:
Location: 02F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-005

SAMPLE INFORMATION

Sample Number: 1509170-005 Customer Sample Number:
Location: 04 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-006

SAMPLE INFORMATION

Sample Number: 1509170-006 Customer Sample Number:
Location: 04F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	30.5 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.3 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	91.3 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	8.63 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.4 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-006

SAMPLE INFORMATION

Sample Number: 1509170-006 Customer Sample Number:
Location: 04F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-007

SAMPLE INFORMATION

Sample Number: 1509170-007 Customer Sample Number:
Location: 05 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-008

SAMPLE INFORMATION

Sample Number: 1509170-008 Customer Sample Number:
Location: 05F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-009

SAMPLE INFORMATION

Sample Number: 1509170-009 Customer Sample Number:
Location: 06 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-010

SAMPLE INFORMATION

Sample Number: 1509170-010
Location: 06F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.5 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	120 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	12.8 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.8 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-010

SAMPLE INFORMATION

Sample Number: 1509170-010 Customer Sample Number:
Location: 06F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-011

SAMPLE INFORMATION

Sample Number: 1509170-011 Customer Sample Number:
Location: 07 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-012

SAMPLE INFORMATION

Sample Number: 1509170-012 Customer Sample Number:
Location: 07F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-013

SAMPLE INFORMATION

Sample Number: 1509170-013 Customer Sample Number:
Location: 08 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-014

SAMPLE INFORMATION

Sample Number: 1509170-014 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	31.7 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	50.6 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	8.10 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.0 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-014

SAMPLE INFORMATION

Sample Number: 1509170-014 Customer Sample Number:
Location: 08F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-015

SAMPLE INFORMATION

Sample Number: 1509170-015 Customer Sample Number:
Location: 09 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-016

SAMPLE INFORMATION

Sample Number: 1509170-016
Location: 09F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.2 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	37.9 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	6.24 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.9 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-016

SAMPLE INFORMATION

Sample Number: 1509170-016 Customer Sample Number:
Location: 09F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-017

SAMPLE INFORMATION

Sample Number: 1509170-017 Customer Sample Number:
Location: 10 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	40.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.9 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	33.8 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.78 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.18 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-017

SAMPLE INFORMATION


Sample Number: 1509170-017
Location: 10
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 10/15/2015
 Report Number:M- W1509170-018

SAMPLE INFORMATION

Sample Number: 1509170-018 Customer Sample Number:
 Location: 10F Type: Dist.
 LPR 3111 MLK AVE SE FILTERED
 Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	30.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	35.4 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	6.82 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-018

SAMPLE INFORMATION

Sample Number: 1509170-018
Location: 10F
LPR 3111 MLK AVE SE FILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-019

SAMPLE INFORMATION

Sample Number: 1509170-019 Customer Sample Number:
Location: 11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	57.3 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	3.92 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	11.7 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	39.5 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.62 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.9 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-019

SAMPLE INFORMATION


Sample Number: 1509170-019
Location: 11
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-020

SAMPLE INFORMATION

Sample Number: 1509170-020
Location: 11F
LPR 3111 MLK AVE SE FILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	30.4 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	13.1 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	39.2 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	8.16 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-020

SAMPLE INFORMATION

Sample Number: 1509170-020 Customer Sample Number:
Location: 11F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-021

SAMPLE INFORMATION

Sample Number: 1509170-021 Customer Sample Number:
Location: 12 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	37.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.01 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	46.1 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.53 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-021

SAMPLE INFORMATION


Sample Number: 1509170-021
Location: 12
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-022

SAMPLE INFORMATION


Sample Number: 1509170-022
Location: 12F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-023

SAMPLE INFORMATION


Sample Number: 1509170-023
Location: 13
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-024

SAMPLE INFORMATION

Sample Number: 1509170-024 Customer Sample Number:
Location: 13F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	46.4 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	6.87 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.3 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-024

SAMPLE INFORMATION

Sample Number: 1509170-024
Location: 13F
LPR 3111 MLK AVE SE FILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-025

SAMPLE INFORMATION

Sample Number: 1509170-025 Customer Sample Number:
Location: 14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	35.9 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.0 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	41.6 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.50 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-025

SAMPLE INFORMATION


Sample Number: 1509170-025
Location: 14
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-027

SAMPLE INFORMATION

Sample Number: 1509170-027 Customer Sample Number:
Location: 15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-028

SAMPLE INFORMATION

Sample Number: 1509170-028
Location: 15F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.3 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	41.0 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	9.72 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.4 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-028

SAMPLE INFORMATION

Sample Number: 1509170-028 Customer Sample Number:
Location: 15F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number:M- W1509170-029

SAMPLE INFORMATION

Sample Number: 1509170-029
Location: 16
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.0 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.05 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	36.9 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.41 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-029

SAMPLE INFORMATION

Sample Number: 1509170-029 Customer Sample Number:
Location: 16 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-030

SAMPLE INFORMATION

Sample Number: 1509170-030
Location: 16F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.2 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	37.5 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	6.68 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.2 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-030

SAMPLE INFORMATION


Sample Number: 1509170-030
Location: 16F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-031

SAMPLE INFORMATION

Sample Number: 1509170-031
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.5 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.10 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	31.4 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.04 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.5 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-031

SAMPLE INFORMATION


Sample Number: 1509170-031
Location: 17
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-032

SAMPLE INFORMATION

Sample Number: 1509170-032 Customer Sample Number:
Location: 17F Type: Dist.
LPR 3111 MLK AVE SE FILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-033

SAMPLE INFORMATION


Sample Number: 1509170-033
Location: 18
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-034

SAMPLE INFORMATION

Sample Number: 1509170-034
Location: 18F
LPR 3111 MLK AVE SE FILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.6 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	28.8 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	5.40 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.2 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-034

SAMPLE INFORMATION


Sample Number: 1509170-034
Location: 18F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-035

SAMPLE INFORMATION

Sample Number: 1509170-035 Customer Sample Number:
Location: 19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-036

SAMPLE INFORMATION


Sample Number: 1509170-036
Location: 19F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-037

SAMPLE INFORMATION


Sample Number: 1509170-037
Location: 20
LPR 3111 MLK AVE SE UNFILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-038

SAMPLE INFORMATION

Sample Number: 1509170-038
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	32.0 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	0.7 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	26.8 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	5.58 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.2 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-038

SAMPLE INFORMATION


Sample Number: 1509170-038
Location: 20F
LPR 3111 MLK AVE SE FILTERED

Customer Sample Number:
Type: Dist.

Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-039

SAMPLE INFORMATION

Sample Number: 1509170-039 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	43.5 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.46 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	16.9 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	35.3 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	7.01 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.19 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-039

SAMPLE INFORMATION

Sample Number: 1509170-039 Customer Sample Number:
Location: H1 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-040

SAMPLE INFORMATION

Sample Number: 1509170-040 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.2 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.16 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	11.1 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	30.6 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	4.17 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.7 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-040

SAMPLE INFORMATION

Sample Number: 1509170-040 Customer Sample Number:
Location: H2 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-041

SAMPLE INFORMATION

Sample Number: 1509170-041 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	37.4 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.11 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	31.4 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.06 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-041

SAMPLE INFORMATION

Sample Number: 1509170-041 Customer Sample Number:
Location: H3 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-042

SAMPLE INFORMATION

Sample Number: 1509170-042 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	39.3 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.19 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	10.7 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	30.9 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.97 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.6 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-042

SAMPLE INFORMATION

Sample Number: 1509170-042 Customer Sample Number:
Location: H4 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number:M- W1509170-043

SAMPLE INFORMATION

Sample Number: 1509170-043 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	42.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.32 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	12.9 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	35.0 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.39 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.8 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-043

SAMPLE INFORMATION

Sample Number: 1509170-043 Customer Sample Number:
Location: H5 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-044

SAMPLE INFORMATION

Sample Number: 1509170-044
Customer Sample Number:
Location: H6
Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	43.5 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.36 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	13.8 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	32.4 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.45 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.8 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-044

SAMPLE INFORMATION

Sample Number: 1509170-044 Customer Sample Number:
Location: H6 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-045

SAMPLE INFORMATION

Sample Number: 1509170-045 Customer Sample Number:
Location: H7 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-046

SAMPLE INFORMATION

Sample Number: 1509170-046 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	44.2 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.36 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	14.2 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	29.5 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	3.42 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.0 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-046

SAMPLE INFORMATION

Sample Number: 1509170-046 Customer Sample Number:
Location: H8 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-047

SAMPLE INFORMATION

Sample Number: 1509170-047 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	41.7 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.35 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	12.0 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	27.0 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.75 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.9 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-047

SAMPLE INFORMATION

Sample Number: 1509170-047 Customer Sample Number:
Location: H9 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-048

SAMPLE INFORMATION

Sample Number: 1509170-048 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	42.9 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.33 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	13.2 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	28.2 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.66 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.15 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-048

SAMPLE INFORMATION

Sample Number: 1509170-048 Customer Sample Number:
Location: H10 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-049

SAMPLE INFORMATION

Sample Number: 1509170-049 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	43.0 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.36 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	12.7 ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	28.5 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.78 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	0.9 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-049

SAMPLE INFORMATION

Sample Number: 1509170-049 Customer Sample Number:
Location: H11 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-050

SAMPLE INFORMATION

Sample Number: 1509170-050
Location: H12
LPR 3111 MLK AVE SE UNFILTERED
Customer Sample Number:
Type: Dist.
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	36.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.14 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	26.1 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.14 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.16 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-050

SAMPLE INFORMATION

Sample Number: 1509170-050 Customer Sample Number:
Location: H12 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-051

SAMPLE INFORMATION

Sample Number: 1509170-051 Customer Sample Number:
Location: H13 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-052

SAMPLE INFORMATION

Sample Number: 1509170-052 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	36.8 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.16 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	28.9 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.06 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.55 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-052

SAMPLE INFORMATION

Sample Number: 1509170-052 Customer Sample Number:
Location: H14 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-053

SAMPLE INFORMATION

Sample Number: 1509170-053 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.1 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.20 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	28.0 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.24 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.65 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-053

SAMPLE INFORMATION

Sample Number: 1509170-053 Customer Sample Number:
Location: H15 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-054

SAMPLE INFORMATION

Sample Number: 1509170-054 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.6 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.21 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	25.6 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.38 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.68 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-054

SAMPLE INFORMATION

Sample Number: 1509170-054 Customer Sample Number:
Location: H16 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-055

SAMPLE INFORMATION

Sample Number: 1509170-055
Customer Sample Number:
Location: H17
Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015
Collection Time: 9:00
Sampler: CW/DM
Received Date and Time: 9/24/2015 10:22:11 AM
Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.7 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.23 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	25.6 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.37 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.64 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001


Report Date: 10/15/2015
Report Number: M- W1509170-055

SAMPLE INFORMATION

Sample Number: 1509170-055 Customer Sample Number:
Location: H17 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number:M- W1509170-056

SAMPLE INFORMATION

Sample Number: 1509170-056 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	38.1 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.21 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	23.4 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	2.04 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.61 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-056

SAMPLE INFORMATION

Sample Number: 1509170-056 Customer Sample Number:
Location: H18 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-057

SAMPLE INFORMATION

Sample Number: 1509170-057 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: 9/22/2015 Collection Time: 9:00 Sampler: CW/DM Received Date and Time: 9/24/2015 10:22:11 AM Received By: JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
Aluminum	EPA 200.8	10 ug/L	39.1 ug/L	10/6/2015	RHoffa
Manganese	EPA 200.8	0.2 ug/L	1.26 ug/L	10/6/2015	RHoffa
Iron	EPA 200.8	10 ug/L	ND ug/L	10/6/2015	RHoffa
Copper	EPA 200.8	0.2 ug/L	22.0 ug/L	10/6/2015	RHoffa
Zinc	EPA 200.8	0.5 ug/L	1.97 ug/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.2 ug/L	1.65 ug/L	10/6/2015	RHoffa

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-057

SAMPLE INFORMATION

Sample Number: 1509170-057 Customer Sample Number:
Location: H19 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

METALS REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: M- W1509170-058

SAMPLE INFORMATION

Sample Number: 1509170-058 Customer Sample Number:
Location: H20 Type: Dist.
LPR 3111 MLK AVE SE UNFILTERED
Collection Date: Collection Time: Sampler: Received Date and Time: Received By:
9/22/2015 9:00 CW/DM 9/24/2015 10:22:11 AM JCross

Parameter	Method	RDL	Result	Analysis Date	Analyst
-----------	--------	-----	--------	---------------	---------

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

5900 MacArthur Blvd. NW, Washington DC 20016 Phone (202) 764-0449 Fax (202) 764-2401

Comment:

MCL = Maximum Contaminant Level

RDL = Reporting Detection Limit

ND=Non-Detect

Iron results are for informational purposes only and cannot be used for compliance.

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-001	1 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	92.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	117 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	38.5 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	7.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	2.7 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	100 ug/L	10/16/2015	RHoffa
1509174-002	1F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	30.0 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	97.2 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	0.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	85.8 ug/L	10/16/2015	RHoffa
1509174-003	02 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	26.3 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	112.0 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	16.3 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	3.2 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.2 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	12.0 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-004	02F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	19.2 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	102 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.6 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	13.6 ug/L	10/16/2015	RHoffa
1509174-005	03 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	25.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	114 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	15.7 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	3.3 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.2 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	10.8 ug/L	10/16/2015	RHoffa
1509174-006	03F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	19.9 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	106 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.1 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.6 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	12.7 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-007	04 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	30.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	115 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	17.4 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	3.5 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.1 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	9.2 ug/L	10/16/2015	RHoffa
1509174-008	04F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	22.2 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	101 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.2 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	10.2 ug/L	10/16/2015	RHoffa
1509174-009	05 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	34.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	118 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	16.6 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	3.5 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.0 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.4 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-010	05F 3121 MLK Ave SE	Dist.						
LPR	Filtered							
			Aluminum	200.8	10	26.2 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	108 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.4 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	9.0 ug/L	10/16/2015	RHoffa
1509174-011	06 3121 MLK Ave SE	Dist.						
LPR	Unfiltered							
			Aluminum	200.8	10	35.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	124 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	16.3 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.0 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.6 ug/L	10/16/2015	RHoffa
1509174-012	06F 3121 MLK Ave SE	Dist.						
LPR	Filtered							
			Aluminum	200.8	10	28.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	113 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.3 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-013	07 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	38.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	126 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	16.9 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.4 ug/L	10/16/2015	RHoffa
1509174-014	07F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	30.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	112 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.6 ug/L	10/16/2015	RHoffa
1509174-015	08 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	37.1 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	121 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	13.1 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.5 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-016	08F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	30.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	110 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	2.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.4 ug/L	10/16/2015	RHoffa
1509174-017	09 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	38.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	110 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	11.8 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.2 ug/L	10/16/2015	RHoffa
1509174-018	09F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	31.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	104 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	2.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.8 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-019	10 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	39.9 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	103 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	3.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.0 ug/L	10/16/2015	RHoffa
1509174-020	10F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	39.0 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	96.5 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	1.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.8 ug/L	10/16/2015	RHoffa
1509174-021	11 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	38.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	96.4 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	10.2 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.1 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.7 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-022	11F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	32.2 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	91.1 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	2.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	9.8 ug/L	10/16/2015	RHoffa
1509174-023	12 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	35.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	97.9 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	10.7 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	5.3 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.1 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	11.5 ug/L	10/16/2015	RHoffa
1509174-024	12F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	26.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	88.2 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	2.4 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	13.1 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-025	13 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	29.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	82.4 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	10.2 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	7.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.0 ug/L	10/16/2015	RHoffa
1509174-026	13F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	22.7 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	75.8 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.1 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.3 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	11.8 ug/L	10/16/2015	RHoffa
1509174-027	14 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	31.3 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	92.0 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	10.3 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.9 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-028	14F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	23.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	85.2 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	5.5 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.2 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.6 ug/L	10/16/2015	RHoffa
1509174-029	15 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	38.3 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	192 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	12.8 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.2 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.3 ug/L	10/16/2015	RHoffa
1509174-030	15F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	29.6 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	162 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	6.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.6 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	6.7 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-031	16 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	40.1 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	256 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	10.2 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	8.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.1 ug/L	10/16/2015	RHoffa
1509174-032	16F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	36.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	217 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	4.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.3 ug/L	10/16/2015	RHoffa
1509174-033	17 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	40.7 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	256 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	10.4 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.9 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-034	17F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	32.0 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	229 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	6.6 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.0 ug/L	10/16/2015	RHoffa
1509174-035	18 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	39.7 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	222 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	10.8 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.3 ug/L	10/16/2015	RHoffa
1509174-036	18F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	33.1 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	206 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	7.6 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	9.0 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-037	19 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	40.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	180 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	11.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	11.1 ug/L	10/16/2015	RHoffa
1509174-038	19F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	33.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	167 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	8.6 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	12.8 ug/L	10/16/2015	RHoffa
1509174-039	20 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	40.6 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	164 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	10.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	1.5 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	9.6 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-040	20F 3121 MLK Ave SE	Dist.						
LPR	Filtered		Aluminum	200.8	10	32.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	151 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	ND ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	7.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	0.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	10.6 ug/L	10/16/2015	RHoffa
1509174-041	H1 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	104 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	136 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	110 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	20.5 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	2.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	30.6 ug/L	10/16/2015	RHoffa
1509174-042	H2 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	51.9 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	80.6 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	26.8 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	35.5 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	2.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.5 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-043	H3 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	58.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	74.9 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	38.7 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	23.3 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.2 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.6 ug/L	10/16/2015	RHoffa
1509174-044	H4 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	62.7 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	72.9 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	44.3 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.4	55.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.7 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.5 ug/L	10/16/2015	RHoffa
1509174-045	H5 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	57.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	66.6 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	37.7 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	57.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	6.7 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-046	H6 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	60.8 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	69.9 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	41.8 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	34.2 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.6 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	62.9 ug/L	10/16/2015	RHoffa
1509174-047	H7 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	54.9 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	62.4 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	32.6 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	27.4 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.1 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.3 ug/L	10/16/2015	RHoffa
1509174-048	H8 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	57.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	63.4 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	35.8 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	36.8 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.4 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	6.9 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-049	H9 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	69.5 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	77.2 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	69.9 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	35.9 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.7 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.0 ug/L	10/16/2015	RHoffa
1509174-050	H10 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	64.6 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	63.9 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	54.5 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	35.3 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	4.2 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.4 ug/L	10/16/2015	RHoffa
1509174-051	H11 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	73.3 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	67.3 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	66.3 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	45.6 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	5.1 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.9 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-052	H12 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	68.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	63.0 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	55.1 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	32.0 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	4.5 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.9 ug/L	10/16/2015	RHoffa
1509174-053	H13 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	71.2 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	62.1 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	64.8 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	46.8 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	5.1 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	8.1 ug/L	10/16/2015	RHoffa
1509174-054	H14 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	88.4 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	85.8 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	109 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	69.5 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	5.9 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.8 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-055 LPR	H15 3121 MLK Ave SE Unfiltered	Dist.	Aluminum	200.8	10	74.0 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	87.6 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	63.1 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	262 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	4.8 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.7 ug/L	10/16/2015	RHoffa
1509174-056 LPR	H16 3121 MLK Ave SE Unfiltered	Dist.	Aluminum	200.8	10	58.1 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	77.0 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	39.9 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	92.8 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.5 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.7 ug/L	10/16/2015	RHoffa
1509174-057 LPR	H17 3121 MLK Ave SE Unfiltered	Dist.	Aluminum	200.8	10	57.1 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	77.7 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	39.3 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	48.7 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.5 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	4.8 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
 Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
 Sewer Authority
 Maureen Schmelling
 Bureau of Water Services
 301 Bryant Street, NW
 Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015 Sampler: cw/dm Received Date: 9/24/2015 Received by: Lneal
 Collection Time: 9:00:00 AM Received Time: 1:50:00 PM

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
1509174-058	H18 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	60.1 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	78.8 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	54.3 ug/L	10/16/2015	RHoffa
			Lead	200.8	0.2	31.1 ug/L	10/16/2015	RHoffa
			Manganese	200.8	0.5	3.7 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	5.1 ug/L	10/16/2015	RHoffa
1509174-059	H19 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	81.2 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	98.7 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	71.7 ug/L	10/16/2015	RHoffa
			Lead	200.8	1.0	49.7 ug/L	11/9/2015	TPasquale
			Manganese	200.8	0.5	5.7 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	6.2 ug/L	10/16/2015	RHoffa
1509174-060	H20 3121 MLK Ave SE	Dist.						
LPR	Unfiltered		Aluminum	200.8	10	105 ug/L	10/16/2015	RHoffa
			Copper	200.8	0.2	146 ug/L	10/16/2015	RHoffa
			Iron	200.8	10	101 ug/L	10/16/2015	RHoffa
			Lead	200.8	1.0	50.4 ug/L	11/9/2015	TPasquale
			Manganese	200.8	0.5	7.6 ug/L	10/16/2015	RHoffa
			Zinc	200.8	0.2	7.5 ug/L	10/16/2015	RHoffa

ND = Non-Detect; RDL = Reporting Detection Limit; Comment: Iron results are for informational purposes only and cannot be used for compliance

US Army Corps of Engineers
Washington Aqueduct Laboratory
Lab Certification Number: DC00005

Metals Report

District of Columbia Water and
Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/19/2015

Report Number: M- W1509174

Collection Date: 9/24/2015
Collection Time: 9:00:00 AM

Sampler: cw/dm

Received Date: 9/24/2015
Received Time: 1:50:00 PM

Received by: Lneal

Sample Number	Location	Type	Parameter	EPA Method	RDL	Result	Analysis Date	Analyst
---------------	----------	------	-----------	------------	-----	--------	---------------	---------

Reviewed By:

Robert P. Hoffa

11/19/2015

Robert P. Hoffa, Laboratory Manager

Date

DC Water Fountain and Sink Samples

At the request of DC Water's Union, DC Water's water quality staff collected lead samples from all locations that are used by employees for drinking purposes. Sample sites included fountains and sinks at all DC Water owned facilities.

Sampling procedures included flushing lines for several minutes, stagnating for at least 15 hours and collecting samples using 250 mL plastic bottles. All samples were analyzed by the Washington Aqueduct.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1406195-008

SAMPLE INFORMATION

Sample Number: 1406195-008 Customer Sample Number: Project: UNION
Location: BP8 5000 OVERLOOK AVE. COF 4TH Type: Dist.
 FLOOR (FOUNTAIN #2 LOW)

Collection Date: 6/24/2014 Collection Time: 10:55 Sampler: HB Received Date and Time: 6/24/2014 3:03:14 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	< 0.01 mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.048 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	6/27/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1406195-011

SAMPLE INFORMATION

Sample Number: 1406195-011 Customer Sample Number: Project: UNION
Location: BP11 5000 OVERLOOK AVE. COF 5TH Type: Dist.
 FLOOR (FOUNTAIN #2 LOW)

Collection Date: 6/24/2014 Collection Time: 11:10 Sampler: HB Received Date and Time: 6/24/2014 3:03:14 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	< 0.01 mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.043 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	0.0002 mg/L	6/27/2014	RHoffa

Comment:

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1406195-013

SAMPLE INFORMATION

Sample Number: 1406195-013 Customer Sample Number: Project: UNION
Location: BP14 5000 OVERLOOK AVE. CMF Type: Dist.
 MACHINE SHOP

Collection Date: 6/24/2014 Collection Time: 12:05 Sampler: HB Received Date and Time: 6/24/2014 3:03:14 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	ND mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.019 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	ND mg/L	6/27/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1406195-014

SAMPLE INFORMATION

Sample Number: 1406195-014 Customer Sample Number: Project: UNION
Location: BP15 5000 OVERLOOK AVE. CMF Type: Dist.
 MAINTENANCE SHOP

Collection Date: 6/24/2014 Collection Time: 12:15 Sampler: HB Received Date and Time: 6/24/2014 3:03:14 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	0.015 mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.124 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	6/27/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority

Report Date: 7/9/2014
Report Number: LC-W1406211-015

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1406211-015 Customer Sample Number: Project: UNION
Location: BP35 5000 OVERLOOK AVE SOLID Type: Dist.
 PROCESSING 2F TOP STAIR

Collection Date: 6/26/2014 Collection Time: 9:20 Sampler: HB Received Date and Time: 6/26/2014 2:29:05 PM Received By: ASanders

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	0.015 mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.140 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	6/27/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 7/9/2014
Report Number: LC-W1406211-016

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1406211-016 Customer Sample Number: Project: UNION
Location: BP36 5000 OVERLOOK AVE VISITORS Type: Dist.
CENTER 1ST FL #1(HIGH)

Collection Date: 6/26/2014 Collection Time: 9:55 Sampler: HB Received Date and Time: 6/26/2014 2:29:05 PM Received By: ASanders

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	ND mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.001 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	ND mg/L	6/27/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority

Report Date: 7/9/2014
Report Number: LC-W1406211-017

Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

SAMPLE INFORMATION

Sample Number: 1406211-017 Customer Sample Number: Project: UNION
Location: BP37 5000 OVERLOOK AVE VISITORS Type: Dist.
CENTER 1ST FL #2(LOW)

Collection Date: 6/26/2014 Collection Time: 10:10 Sampler: HB Received Date and Time: 6/26/2014 2:29:05 PM Received By: ASanders

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	ND mg/L	6/27/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.001 mg/L	6/27/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	ND mg/L	6/27/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-003

SAMPLE INFORMATION

Sample Number: 1407008-003 Customer Sample Number: Project: UNION
Location: 3-B BRYANT ST. 1ST FLOOR SOUTH Type: Dist.

Collection Date: 7/1/2014 Collection Time: 10:00 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	0.011 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.061 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

7/9/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-005

SAMPLE INFORMATION

Sample Number: 1407008-005 Customer Sample Number: Project: UNION
Location: 5-B BRYANT ST. 2ND FLOOR NORTH Type: Dist.
LOW

Collection Date: 7/1/2014 Collection Time: 10:15 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	< 0.01 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.103 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-006

SAMPLE INFORMATION

Sample Number: 1407008-006 Customer Sample Number: Project: UNION
Location: 6-B BRYANT ST. 2ND FLOOR SOUTH Type: Dist.

Collection Date: 7/1/2014 Collection Time: 10:25 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	0.013 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.048 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

7/9/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-007

SAMPLE INFORMATION

Sample Number: 1407008-007 Customer Sample Number: Project: UNION
Location: 7-B BRYANT ST. 3RD FLOOR NW HIGH Type: Dist.

Collection Date: 7/1/2014 Collection Time: 10:35 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	< 0.01 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.106 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

7/9/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-008

SAMPLE INFORMATION

Sample Number: 1407008-008 Customer Sample Number: Project: UNION
Location: 8-B BRYANT ST. 3RD FLOOR NW LOW Type: Dist.

Collection Date: 7/1/2014 Collection Time: 10:40 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	0.012 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.099 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

7/9/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-015

SAMPLE INFORMATION

Sample Number: 1407008-015 Customer Sample Number: Project: UNION
Location: 17-B BRYANT ST. KITCHEN 3RD FLOOR Type: Dist.

Collection Date: 7/1/2014 Collection Time: 10:45 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	< 0.01 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.077 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

7/9/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/9/2014
Report Number: LC-W1407008-016

SAMPLE INFORMATION

Sample Number: 1407008-016 Customer Sample Number: Project: UNION
Location: 18-B BRYANT ST KITCHEN 1ST FLOOR Type: Dist.

Collection Date: 7/1/2014 Collection Time: 9:20 Sampler: HB Received Date and Time: 7/1/2014 2:52:56 PM Received By: TPasquale

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.9 ug/L	0.01 mg/L	0.015 mg/L	7/2/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.03 ug/L	0.0002 mg/L	0.039 mg/L	7/2/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.02 ug/L	0.0002 mg/L	< 0.0002 mg/L	7/2/2014	RHoffa

Comment:

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

7/9/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/4/2014
Report Number: LC-W1408178-004

SAMPLE INFORMATION

Sample Number: 1408178-004 Customer Sample Number: Project: UNION
Location: 7-O O STREET BUILDING H (1ST FLOOR) (NORTH) Type: Dist.

Collection Date: 8/21/2014 Collection Time: 11:10 Sampler: HB Received Date and Time: 8/21/2014 2:51:17 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	8/26/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.286 mg/L	8/26/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	ND mg/L	8/26/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

9/4/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/4/2014
Report Number: LC-W1408178-005

SAMPLE INFORMATION

Sample Number: 1408178-005 Customer Sample Number: Project: UNION
Location: 8-O O STREET BUILDING H (1ST FLOOR) (SOUTH) Type: Dist.

Collection Date: 8/21/2014 Collection Time: 11:20 Sampler: HB Received Date and Time: 8/21/2014 2:51:17 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	8/26/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.421 mg/L	8/26/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0004 mg/L	8/26/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

9/4/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/4/2014
Report Number: LC-W1408178-006

SAMPLE INFORMATION

Sample Number: 1408178-006 Customer Sample Number: Project: UNION
Location: 9-O O STREET BUILDING H (2ND FLOOR) Type: Dist.

Collection Date: 8/21/2014 Collection Time: 11:45 Sampler: HB Received Date and Time: 8/21/2014 2:51:17 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.060 mg/L	8/26/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.592 mg/L	8/26/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0028 mg/L	8/26/2014	RHoffa

Comment:

ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Michael Chicoine, Laboratory Manager

9/4/2014

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/4/2014
Report Number: LC-W1408178-008

SAMPLE INFORMATION

Sample Number: 1408178-008 Customer Sample Number: Project: UNION
Location: 13-O O STREET BUILDING FLEET SHOP Type: Dist.

Collection Date: 8/21/2014 Collection Time: 10:25 Sampler: HB Received Date and Time: 8/21/2014 2:51:17 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.057 mg/L	8/26/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.094 mg/L	8/26/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	0.0004 mg/L	8/26/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

9/4/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 9/4/2014
Report Number: LC-W1408178-010

SAMPLE INFORMATION

Sample Number: 1408178-010 Customer Sample Number: Project: UNION
Location: 1-R FORT RENO 1ST FLOOR Type: Dist.

Collection Date: 8/21/2014 Collection Time: 8:30 Sampler: HB Received Date and Time: 8/21/2014 2:51:17 PM Received By: JCross

Parameter	Method	Action Level	MDL	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	8/26/2014	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.055 mg/L	8/26/2014	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	ND mg/L	8/26/2014	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Michael Chicoine, Laboratory Manager

9/4/2014
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507011-002


SAMPLE INFORMATION

Sample Number: 1507011-002 Customer Sample Number: Project: UNION
Location: BP14 5000 OVERLOOK AVE CMF Type: Dist.
 MACHINE SHOP

Collection Date: 7/1/2015 Collection Time: 13:48 Sampler: DM Received Date and Time: 7/2/2015 9:22:57 AM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	ND mg/L	7/17/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.005 mg/L	7/17/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	ND mg/L	7/17/2015	RHoffa

Comment:
ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

7/23/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507011-003

SAMPLE INFORMATION

Sample Number: 1507011-003 Customer Sample Number: Project: UNION
Location: BP15 5000 OVERLOOK AVE CMF Type: Dist.
 MAINTENENCE SHOP

Collection Date: 7/1/2015 Collection Time: 12:32 Sampler: DM Received Date and Time: 7/2/2015 9:22:57 AM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.040 mg/L	7/17/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.086 mg/L	7/17/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	ND mg/L	7/17/2015	RHoffa

Comment:


ND=Non-Detect

MDL = Minimum Detection Level

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 7/23/2015
Report Number: LC-W1507011-007

SAMPLE INFORMATION

Sample Number: 1507011-007 Customer Sample Number: Project: UNION
Location: BP21 5000 OVERLOOK AVE MAIN LAB Type: Dist.
1ST FLOOR #1 (HIGH)


Collection Date: 7/1/2015 Collection Time: 12:51 Sampler: DM Received Date and Time: 7/2/2015 9:22:57 AM Received By: LGallimore

Parameter	Method	Action Level	MDL	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	ug/L	0.01 mg/L	0.152 mg/L	7/17/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	ug/L	0.0002 mg/L	0.358 mg/L	7/17/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	ug/L	0.0002 mg/L	ND mg/L	7/17/2015	RHoffa

Comment:

ND=Non-Detect MDL = Minimum Detection Level RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

7/23/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-001

SAMPLE INFORMATION

Sample Number: 1509206-001 Customer Sample Number: Project: UNION
Location: 1-B BRYANT ST 1ST FLOOR (NORTH- Type: Dist.
HIGH)

Collection Date: 9/30/2015 Collection Time: 10:30 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.054 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/6/2015	RHoffa

Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:

Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-003

SAMPLE INFORMATION

Sample Number: 1509206-003 Customer Sample Number: Project: UNION
Location: 3-B BRYANT ST 1ST FLOOR (SOUTH) Type: Dist.

Collection Date: 9/30/2015 Collection Time: 10:15 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.051 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/6/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-004

SAMPLE INFORMATION

Sample Number: 1509206-004 Customer Sample Number: Project: UNION
Location: 4-B BRYANT ST 2ND FLOOR (NORTH - HIGH) Type: Dist.

Collection Date: 9/30/2015 Collection Time: 10:05 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.078 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/6/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-006


SAMPLE INFORMATION

Sample Number: 1509206-006 Customer Sample Number: Project: UNION
Location: 6-B BRYANT ST 2ND FLOOR (SOUTH) Type: Dist.

Collection Date: 9/30/2015 Collection Time: 9:50 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.055 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/6/2015	RHoffa

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

10/15/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-009

SAMPLE INFORMATION

Sample Number: 1509206-009 Customer Sample Number: Project: UNION
Location: 9-B BRYANT ST 3RD FLOOR (SOUTH- Type: Dist.
HIGH)

Collection Date: 9/30/2015 Collection Time: 9:35 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.011 mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.090 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	10/6/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-010

SAMPLE INFORMATION

Sample Number: 1509206-010 Customer Sample Number: Project: UNION
Location: 10-B BRYANT ST 3RD FLOOR (SOUTH- Type: Dist.
LOW)

Collection Date: 9/30/2015 Collection Time: 9:40 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.012 mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.096 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	10/6/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-013

SAMPLE INFORMATION

Sample Number: 1509206-013 Customer Sample Number: Project: UNION
Location: 13-B BRYANT ST 1ST FLOOR SHOP Type: Dist.
(HIGH)

Collection Date: 9/30/2015 Collection Time: 11:10 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.064 mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.102 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/6/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 10/15/2015
Report Number: LC-W1509206-014

SAMPLE INFORMATION

Sample Number: 1509206-014 Customer Sample Number: Project: UNION
Location: 14-B BRYANT ST 1ST FLOOR SHOP Type: Dist.
(LOW)

Collection Date: 9/30/2015 Collection Time: 11:15 Sampler: HB Received Date and Time: 9/30/2015 2:54:40 PM Received By: LGallimore

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.061 mg/L	10/6/2015	RHoffa
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.106 mg/L	10/6/2015	RHoffa
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	10/6/2015	RHoffa


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:



Robert P. Hoffa, Laboratory Manager

10/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510139-001

SAMPLE INFORMATION

Sample Number: 1510139-001 Customer Sample Number: Project: UNION
Location: BP1 5000 OVERLOOK AVE. COF 2ND FLOOR (FOUNTAIN 1HIGH) Type: Dist.

Collection Date: 10/21/2015 Collection Time: 10:45 Sampler: HB Received Date and Time: 10/21/2015 1:42:48 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.027 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/9/2015	TPasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510139-003

SAMPLE INFORMATION

Sample Number: 1510139-003 Customer Sample Number: Project: UNION
Location: BP3 5000 OVERLOOK AVE. COF 2ND Type: Dist.
 FLOOR (FOUNTAIN #3)

Collection Date: 10/21/2015 Collection Time: 10:35 Sampler: HB Received Date and Time: 10/21/2015 1:42:48 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.098 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0033 mg/L	11/9/2015	TPasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510139-006


SAMPLE INFORMATION

Sample Number: 1510139-006 Customer Sample Number: Project: UNION
Location: BP6 5000 OVERLOOK AVE. COF 3RD Type: Dist.
 FLOOR (FOUNTAIN #3)

Collection Date: 10/21/2015 Collection Time: 10:20 Sampler: HB Received Date and Time: 10/21/2015 1:42:48 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.193 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/9/2015	TPasquale

Comment: ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510139-007


SAMPLE INFORMATION

Sample Number: 1510139-007 Customer Sample Number: Project: UNION
Location: BP7 5000 OVERLOOK AVE. COF 4TH FLOOR (FOUNTAIN 1 HIGH) Type: Dist.

Collection Date: 10/21/2015 Collection Time: 10:13 Sampler: HB Received Date and Time: 10/21/2015 1:42:48 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.034 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510139-009

SAMPLE INFORMATION

Sample Number: 1510139-009 Customer Sample Number: Project: UNION
Location: BP9 5000 OVERLOOK AVE. COF 4TH Type: Dist.
 FLOOR (FOUNTAIN #3)

Collection Date: 10/21/2015 Collection Time: 10:05 Sampler: HB Received Date and Time: 10/21/2015 1:42:48 PM Received By: JCross


Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.072 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	ND mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510139-011

SAMPLE INFORMATION

Sample Number: 1510139-011 Customer Sample Number: Project: UNION
Location: BP11 5000 OVERLOOK AVE. COF 5TH FLOOR (FOUNTAIN #2 LOW) Type: Dist.

Collection Date: 10/21/2015 Collection Time: 9:55 Sampler: HB Received Date and Time: 10/21/2015 1:42:48 PM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	ND mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.040 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0003 mg/L	11/9/2015	TPasquale


Comment:

ND=Non-Detect

RDL = Reporting Detection Limit

Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By:


Robert P. Hoffa, Laboratory Manager

11/16/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD AND COPPER REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 11/16/2015
Report Number: LC-W1510153-001


SAMPLE INFORMATION

Sample Number: 1510153-001 Customer Sample Number: Project: UNION
Location: BP-13 5000 OVERLOOK AVE IT BUILDING Type: Dist.

Collection Date: 10/22/2015 Collection Time: 9:40 Sampler: HB Received Date and Time: 10/22/2015 Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Iron	EPA 200.8	mg/L	0.01 mg/L	0.018 mg/L	11/9/2015	TPasquale
Copper	EPA 200.8	1.30 mg/L	0.0002 mg/L	0.257 mg/L	11/9/2015	TPasquale
Lead	EPA 200.8	0.015 mg/L	0.0002 mg/L	0.0007 mg/L	11/9/2015	TPasquale

Comment:
ND=Non-Detect RDL = Reporting Detection Limit
Iron results are for informational purposes only and cannot be used for compliance.

Reviewed By: 
Robert P. Hoffa, Laboratory Manager

11/16/2015
Date

DC Water - Other Research

DC Water collected samples from Fort Reno Water Quality Building tap and spiked the samples.

The samples were analyzed by the Washington Aqueduct.

This attached sample analysis data contains personal information of DC Water's customers, such as names and home addresses, the disclosure of which would constitute a violation of D.C. Code § 2-534(a)(2) and 5 U.S.C. § 552(b)(6). If EPA is requested to produce the sampling analysis data in whole or in part, in order to maintain confidentiality, the personal information must be redacted from the documents produced.

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511203-001

SAMPLE INFORMATION


Sample Number: 1511203-001 Customer Sample Number: Program: Misc
Location: 1 TAP Type: Dist.
Collection Date: 11/30/2015 Collection Time: 9:00 Sampler: HB Received Date and Time: 11/30/2015 10:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511203-002

SAMPLE INFORMATION


Sample Number: 1511203-002 Customer Sample Number: Program: Misc
Location: 2 FILTERED TAP Type: Dist.
Collection Date: 11/30/2015 Collection Time: 9:15 Sampler: HB Received Date and Time: 11/30/2015 10:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	ND ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511203-003

SAMPLE INFORMATION


Sample Number: 1511203-003 Customer Sample Number: Program: Misc
Location: 3 SPIKE UNFILTERED Type: Dist.
Collection Date: 11/30/2015 Collection Time: 9:20 Sampler: HB Received Date and Time: 11/30/2015 10:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	26.7 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:



Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

US Army Corps of Engineers
Washington Aqueduct Laboratory

Lab Certification Number: DC00005

LEAD REPORT

District of Columbia Water and Sewer
Authority
Maureen Schmelling
Bureau of Water Services
301 Bryant Street, NW
Washington, DC 20001

Report Date: 12/15/2015
Report Number: LC-W1511203-004

SAMPLE INFORMATION


Sample Number: 1511203-004 Customer Sample Number: Program: Misc
Location: 4 SPIKE FILTERED Type: Dist.
Collection Date: 11/30/2015 Collection Time: 9:25 Sampler: HB Received Date and Time: 11/30/2015 10:50:00 AM Received By: JCross

Parameter	Method	Action Level	RDL	Result	Analysis Date	Analyst
Lead	EPA 200.8	15 ug/L	0.2 ug/L	21.6 ug/L	12/14/2015	RHoffa

Comment:
ND=Non-Detect

RDL = Reporting Detection Limit

Reviewed By:




Robert P. Hoffa, Laboratory Manager

12/15/2015

Date

Attachment 3

Customer Letter Distribution Certification



Certification of Consumer Notification of Tap Results

Water System Name: DC Water and Sewer Authority (DC Water)

PWSID: DC000002

Monitoring Period to which the notice applies: July 2015 – December 2015

Dates results were received from laboratory: See Attached Table C.6 from Report

Dates results were provided to customers: See Attached Table C.6 from Report

DC Water hereby certifies that its lead consumer notice has been provided to each person it serves at the specific sampling site from which the sample was tested. DC Water also certifies that these results and the following information were provided to such persons within 30 days of receiving the test results from the laboratory consistent with the requirements of 40 CFR 141.85(d):

- √ Individual tap results from lead tap water monitoring carried out under the requirements of §141.86.
- √ An explanation of the health effects of lead.
- √ Steps that consumers can take to reduce exposure to lead in drinking water.
- √ Contact information for DC Water.
- √ The maximum contaminant level goals and action levels for lead, and the definitions of these two term from §141.153(c).

Certified by:

Name Jessica Edwards-Brandt
 Title Manager, Water Quality, Drinking Water Division
 Phone # 202-364-3123 Date January 8, 2016

Notices were distributed to all customers by mail.

Sincerely,

Jessica Edwards-Brandt
Manager, Drinking Water Division

Attachment: Sample copy of Customer Notification of Tap Results



Month, day, year

«First_name» «Last_Name»

«Address»

Washington, DC «Zip_Code»

Dear «First_name» «Last_Name»:

Thank you for participating in DC Water’s Lead and Copper Compliance Monitoring Program. Your participation helps us assess the effectiveness of the U.S. Army Corps of Engineers Washington Aqueduct corrosion control treatment to minimize corrosion of lead service pipes, household plumbing and fixtures that may contribute to lead and copper concentrations in drinking water.

Below are the test results from the two water samples that you collected from your household tap:

- First draw: Measures lead release from household plumbing and fixtures, especially potential sources near the tap where the sample is collected. This sample is required by the Environmental Protection Agency (EPA).
- Second draw: Measures lead release from the lead service pipe and household plumbing. DC Water voluntarily collects this sample to assess the contribution of lead in water from the lead service line.

Sample	Lead Level (ppb)	Copper Level (ppb)
First Draw		
Second Draw		

Service Line Material

Public Space: Lead

Private Property: Lead

If this information is inaccurate, please contact the Drinking Water Division at 202-612-3440.

DC Water recommends that you filter your water to minimize potential lead exposure if lead is present in your drinking water, if you have pipes or plumbing fixtures that contain lead, or if you don’t know the material type. If you are pregnant, nursing or have children under age six, use cold, filtered tap water for drinking and cooking until all sources of lead are removed. This includes water used for making infant formula, beverages and ice.

The potential for lead in drinking water varies among homes in the District. Drinking water is essentially lead-free when it leaves the Washington Aqueduct treatment plant, but lead can enter water when it comes in contact with pipes or plumbing fixtures that contain lead. As noted above, your property has a lead service pipe, which connects the water main in the street to household plumbing. DC Water operates a lead service replacement program and will replace the public portion of the service line during a water main replacement, or if you agree to replace the portion on your private property.

Under the authority of the Safe Drinking Water Act, EPA set a Maximum Contaminant Level Goal (MCLG) for lead at zero and for copper at 1,300 parts per billion (ppb). The MCLG is the level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety. EPA also set an action level for lead at 15 ppb and for copper at 1,300 ppb. The action level is the concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow. These requirements are triggered if more than 10 percent of all first draw samples collected during any monitoring period exceed the action levels. Your lead and copper results may be higher or lower than the action levels, which does not reflect DC Water’s compliance with the LCR. DC Water will notify all customers if the District’s water exceeds the lead or copper action level.

Lead can pose significant health risks if too much of it enters the body. The greatest risk of lead exposure is to infants, young children and pregnant women. It can cause damage to the brain and kidneys, and can interfere with the production of red blood cells that carry oxygen to all parts of the body. Scientists have linked the effects of lead on the brain with lowered IQ in children. Adults with kidney problems and high blood pressure can be affected by low levels of lead more than healthy adults. Lead from other sources (such as lead-based paint and contaminated soil) can increase a person's overall exposure, which adds to the effects of lead in water.

The District Department of the Environment (DDOE) offers information on blood lead testing for young children, pregnant women and nursing mothers. For more information on minimizing lead exposure, contact DDOE at 202-654-6036 or visit www.ddoe.dc.gov or visit EPA's website at www.epa.gov/lead.

DC Water strongly encourages residents to take the following steps to reduce lead exposure:

Remove lead sources

- Replace your lead service pipe with copper. For more information about lead pipe replacement, contact the Drinking Water Division at 202-612-3440.
- Replace household galvanized plumbing. When lead is released from a lead service pipe and passes through galvanized plumbing (particularly over decades of use), lead can accumulate on the inside, corroded walls of this plumbing. Lead release from galvanized pipes can continue even after a lead service pipe is replaced.
- Install lead-free plumbing fixtures certified to meet NSF Standard 61 Annex G (NSF 61-G). Effective in 2014, fixtures that are labeled "lead-free" cannot contain more than 0.25 percent lead. Flush cold water taps, with the aerator removed, at highest flow rate for 5 minutes once a day for 3 days after installing new household pipes or fixtures.

Use filtered tap water

- Be sure to select a filter certified to meet NSF Standard 53 for lead removal. The filter package should specifically list the device as certified for removing the contaminant "lead."
- We recommend devices that are installed at your faucet tap (also known as point-of-use) or pitcher-style filters. Visit the NSF International website for certified drinking water filters at www.nsf.org/Certified/DWTU or call 1-800-673-8010.
- Be sure to routinely replace filter cartridges according to the manufacturer's instructions.

Do not use your hot water tap for drinking and cooking

- Always use cold tap water, then heat water if necessary. Boiling water does not reduce lead levels.
- Hot tap water can cause a greater amount of lead to release from plumbing. Always use cold tap water, including water used for making ice, beverages and infant formula.

Run the cold water tap when water is not used for several hours

- Run your water before using it for drinking or cooking. Once you notice a temperature change, continue running your water for 2 more minutes to receive fresh water from the water main.
- Lead and other metals can dissolve in water when it sits in pipes for a few hours.

Remove and clean faucet aerators

- Lead particles and sediment can collect in the aerator screen located at the tip of your faucet.

For more information, contact the Drinking Water Division at 202-612-3440 or visit www.dewater.com/lead.

Sincerely,



Jessica Edwards-Brandt
Manager, Drinking Water Division



Month, day, year

«First_name» «Last_Name»

«Address»

Washington, DC «Zip_Code»

Dear «First_name» «Last_Name»:

Thank you for participating in DC Water’s Lead and Copper Compliance Monitoring Program. Your participation helps us assess the effectiveness of the U.S. Army Corps of Engineers Washington Aqueduct corrosion control treatment to minimize corrosion of lead service pipes, household plumbing and fixtures that may contribute to lead and copper concentrations in drinking water.

Below are the test results from the two water samples that you collected from your household tap:

- First draw: Measures lead release from household plumbing and fixtures, especially potential sources near the tap where the sample is collected. This sample is required by the Environmental Protection Agency (EPA).
- Second draw: Measures lead release from the lead service pipe and household plumbing. DC Water voluntarily collects this sample to assess the contribution of lead in water from the lead service line.

Sample	Lead Level (ppb)	Copper Level (ppb)
First Draw		
Second Draw		

Service Line Material

Public Space: Lead

Private Property: Non-lead

If this information is inaccurate, please contact the Drinking Water Division at 202-612-3440.

DC Water recommends that you filter your water to minimize potential lead exposure if lead is present in your drinking water, if you have pipes or plumbing fixtures that contain lead, or if you don’t know the material type. If you are pregnant, nursing or have children under age six, use cold, filtered tap water for drinking and cooking until all sources of lead are removed. This includes water used for making infant formula, beverages and ice.

The potential for lead in drinking water varies among homes in the District. Drinking water is essentially lead-free when it leaves the Washington Aqueduct treatment plant, but lead can enter water when it comes in contact with pipes or plumbing fixtures that contain lead. As noted above, your property has a lead service pipe, which connects the water main in the street to household plumbing. DC Water operates a lead service replacement program and will replace the public portion of the service line during a water main replacement, or if you agree to replace the portion on your private property.

Under the authority of the Safe Drinking Water Act, EPA set a Maximum Contaminant Level Goal (MCLG) for lead at zero and for copper at 1,300 parts per billion (ppb). The MCLG is the level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety. EPA also set an action level for lead at 15 ppb and for copper at 1,300 ppb. The action level is the concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow. These requirements are triggered if more than 10 percent of all first draw samples collected during any monitoring period exceed the action levels. Your lead and copper results may be higher or lower than the action levels, which does not reflect DC Water’s compliance with the LCR. DC Water will notify all customers if the District’s water exceeds the lead or copper action level.

Lead can pose significant health risks if too much of it enters the body. The greatest risk of lead exposure is to infants, young children and pregnant women. It can cause damage to the brain and kidneys, and can interfere with the production of red blood cells that carry oxygen to all parts of the body. Scientists have linked the effects of lead on the brain with lowered IQ in children. Adults with kidney problems and high blood pressure can be affected by low levels of lead more than healthy adults. Lead from other sources (such as lead-based paint and contaminated soil) can increase a person's overall exposure, which adds to the effects of lead in water.

The District Department of the Environment (DDOE) offers information on blood lead testing for young children, pregnant women and nursing mothers. For more information on minimizing lead exposure, contact DDOE at 202-654-6036 or visit www.ddoe.dc.gov or visit EPA's website at www.epa.gov/lead.

DC Water strongly encourages residents to take the following steps to reduce lead exposure:

Remove lead sources

- Replace your lead service pipe with copper. For more information about lead pipe replacement, contact the Drinking Water Division at 202-612-3440.
- Replace household galvanized plumbing. When lead is released from a lead service pipe and passes through galvanized plumbing (particularly over decades of use), lead can accumulate on the inside, corroded walls of this plumbing. Lead release from galvanized pipes can continue even after a lead service pipe is replaced.
- Install lead-free plumbing fixtures certified to meet NSF Standard 61 Annex G (NSF 61-G). Effective in 2014, fixtures that are labeled "lead-free" cannot contain more than 0.25 percent lead. Flush cold water taps, with the aerator removed, at highest flow rate for 5 minutes once a day for 3 days after installing new household pipes or fixtures.

Use filtered tap water

- Be sure to select a filter certified to meet NSF Standard 53 for lead removal. The filter package should specifically list the device as certified for removing the contaminant "lead."
- We recommend devices that are installed at your faucet tap (also known as point-of-use) or pitcher-style filters. Visit the NSF International website for certified drinking water filters at www.nsf.org/Certified/DWTU or call 1-800-673-8010.
- Be sure to routinely replace filter cartridges according to the manufacturer's instructions.

Do not use your hot water tap for drinking and cooking

- Always use cold tap water, then heat water if necessary. Boiling water does not reduce lead levels.
- Hot tap water can cause a greater amount of lead to release from plumbing. Always use cold tap water, including water used for making ice, beverages and infant formula.

Run the cold water tap when water is not used for several hours

- Run your water before using it for drinking or cooking. Once you notice a temperature change, continue running your water for 2 more minutes to receive fresh water from the water main.
- Lead and other metals can dissolve in water when it sits in pipes for a few hours.

Remove and clean faucet aerators

- Lead particles and sediment can collect in the aerator screen located at the tip of your faucet.

For more information, contact the Drinking Water Division at 202-612-3440 or visit www.dewater.com/lead.

Sincerely,



Jessica Edwards-Brandt
Manager, Drinking Water Division



Month, day, year

«First_name» «Last_Name»

«Address»

Washington, DC «Zip_Code»

Dear «First_name» «Last_Name»:

Thank you for participating in DC Water’s Lead and Copper Compliance Monitoring Program. Your participation helps us assess the effectiveness of the U.S. Army Corps of Engineers Washington Aqueduct corrosion control treatment to minimize corrosion of lead service pipes, household plumbing and fixtures that may contribute to lead and copper concentrations in drinking water.

Below are the test results from the two water samples that you collected from your household tap:

- First draw: Measures lead release from household plumbing and fixtures, especially potential sources near the tap where the sample is collected. This sample is required by the Environmental Protection Agency (EPA).
- Second draw: Measures lead release from the lead service pipe and household plumbing. DC Water voluntarily collects this sample to assess the contribution of lead in water from the lead service line.

Sample	Lead Level (ppb)	Copper Level (ppb)
First Draw		
Second Draw		

Service Line Material

Public Space: Non-lead

Private Property: Lead

If this information is inaccurate, please contact the Drinking Water Division at 202-612-3440.

DC Water recommends that you filter your water to minimize potential lead exposure if lead is present in your drinking water, if you have pipes or plumbing fixtures that contain lead, or if you don’t know the material type. If you are pregnant, nursing or have children under age six, use cold, filtered tap water for drinking and cooking until all sources of lead are removed. This includes water used for making infant formula, beverages and ice.

The potential for lead in drinking water varies among homes in the District. Drinking water is essentially lead-free when it leaves the Washington Aqueduct treatment plant, but lead can enter water when it comes in contact with pipes or plumbing fixtures that contain lead. As noted above, your property has a lead service pipe, which connects the water main in the street to household plumbing. DC Water operates a lead service replacement program and will replace the public portion of the service line during a water main replacement, or if you agree to replace the portion on your private property.

Under the authority of the Safe Drinking Water Act, EPA set a Maximum Contaminant Level Goal (MCLG) for lead at zero and for copper at 1,300 parts per billion (ppb). The MCLG is the level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety. EPA also set an action level for lead at 15 ppb and for copper at 1,300 ppb. The action level is the concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow. These requirements are triggered if more than 10 percent of all first draw samples collected during any monitoring period exceed the action levels. Your lead and copper results may be higher or lower than the action levels, which does not reflect DC Water’s compliance with the LCR. DC Water will notify all customers if the District’s water exceeds the lead or copper action level.

Lead can pose significant health risks if too much of it enters the body. The greatest risk of lead exposure is to infants, young children and pregnant women. It can cause damage to the brain and kidneys, and can interfere with the production of red blood cells that carry oxygen to all parts of the body. Scientists have linked the effects of lead on the brain with lowered IQ in children. Adults with kidney problems and high blood pressure can be affected by low levels of lead more than healthy adults. Lead from other sources (such as lead-based paint and contaminated soil) can increase a person's overall exposure, which adds to the effects of lead in water.

The District Department of the Environment (DDOE) offers information on blood lead testing for young children, pregnant women and nursing mothers. For more information on minimizing lead exposure, contact DDOE at 202-654-6036 or visit www.ddoe.dc.gov or visit EPA's website at www.epa.gov/lead.

DC Water strongly encourages residents to take the following steps to reduce lead exposure:

Remove lead sources

- Replace your lead service pipe with copper. For more information about lead pipe replacement, contact the Drinking Water Division at 202-612-3440.
- Replace household galvanized plumbing. When lead is released from a lead service pipe and passes through galvanized plumbing (particularly over decades of use), lead can accumulate on the inside, corroded walls of this plumbing. Lead release from galvanized pipes can continue even after a lead service pipe is replaced.
- Install lead-free plumbing fixtures certified to meet NSF Standard 61 Annex G (NSF 61-G). Effective in 2014, fixtures that are labeled "lead-free" cannot contain more than 0.25 percent lead. Flush cold water taps, with the aerator removed, at highest flow rate for 5 minutes once a day for 3 days after installing new household pipes or fixtures.

Use filtered tap water

- Be sure to select a filter certified to meet NSF Standard 53 for lead removal. The filter package should specifically list the device as certified for removing the contaminant "lead."
- We recommend devices that are installed at your faucet tap (also known as point-of-use) or pitcher-style filters. Visit the NSF International website for certified drinking water filters at www.nsf.org/Certified/DWTU or call 1-800-673-8010.
- Be sure to routinely replace filter cartridges according to the manufacturer's instructions.

Do not use your hot water tap for drinking and cooking

- Always use cold tap water, then heat water if necessary. Boiling water does not reduce lead levels.
- Hot tap water can cause a greater amount of lead to release from plumbing. Always use cold tap water, including water used for making ice, beverages and infant formula.

Run the cold water tap when water is not used for several hours

- Run your water before using it for drinking or cooking. Once you notice a temperature change, continue running your water for 2 more minutes to receive fresh water from the water main.
- Lead and other metals can dissolve in water when it sits in pipes for a few hours.

Remove and clean faucet aerators

- Lead particles and sediment can collect in the aerator screen located at the tip of your faucet.

For more information, contact the Drinking Water Division at 202-612-3440 or visit www.dewater.com/lead.

Sincerely,



Jessica Edwards-Brandt
Manager, Drinking Water Division